

NOTICE OF
CHANGES

THIS DOCUMENT REPLACES
DESIGN DATA SHEETS 304-1 &
304-2

INCH-POUND
MIL-HDBK-299(SH)
NOTICE 1
15 OCTOBER 1991

MILITARY HANDBOOK

CABLE COMPARISON HANDBOOK
DATA PERTAINING TO ELECTRICAL SHIPBOARD CABLE

TO ALL HOLDERS OF MIL-HDBK-299(SH):

1. THE FOLLOWING PAGES OF MIL-HDBK-299(SH) HAVE BEEN REVISED AND SUPERSEDE THE PAGES LISTED:

NEW PAGE	DATE	SUPERSEDED PAGE	DATE
v	15 October 1991	v	3 April 1989
vi	15 October 1991	vi	3 April 1989
vii	15 October 1991	--	NEW PAGE
viii	15 October 1991	--	NEW PAGE
75	15 October 1991	75	3 April 1989
76	15 October 1991	76	3 April 1989
77	15 October 1991	77	3 April 1989
78	15 October 1991	78	3 April 1989
79	15 October 1991	79	3 April 1989
80	15 October 1991	80	3 April 1989
81	15 October 1991	81	3 April 1989
82	15 October 1991	82	3 April 1989
83	15 October 1991	83	3 April 1989
84	15 October 1991	84	3 April 1989
85	15 October 1991	85	3 April 1989
86	15 October 1991	86	3 April 1989
87	15 October 1991	87	3 April 1989
88	15 October 1991	88	3 April 1989
89	15 October 1991	89	3 April 1989
90	15 October 1991	90	3 April 1989
91	15 October 1991	91	3 April 1989
92	15 October 1991	92	3 April 1989
93	15 October 1991	93	3 April 1989
94	15 October 1991	94	3 April 1989
95	15 October 1991	95	3 April 1989
96	15 October 1991	96	3 April 1989
97	15 October 1991	97	3 April 1989
98	15 October 1991	98	3 April 1989
99	15 October 1991	99	3 April 1989
100	15 October 1991	100	3 April 1989
101	15 October 1991	101	3 April 1989
102	15 October 1991	102	3 April 1989
103	15 October 1991	103	3 April 1989
104	15 October 1991	104	3 April 1989

AMSC N/A

FSC 6145

DISTRIBUTION STATEMENT A. Approved for public release; distribution is unlimited.

MIL-HDBK-299(SH)
NOTICE 1
27 AUGUST 1991

NEW PAGE	DATE	SUPERSEDED PAGE	DATE
105	15 October 1991	105	3 April 1989
106	15 October 1991	--	NEW PAGE
107	15 October 1991	--	NEW PAGE
108	15 October 1991	--	NEW PAGE
109	15 October 1991	--	NEW PAGE
110	15 October 1991	--	NEW PAGE
111	15 October 1991	--	NEW PAGE
112	15 October 1991	--	NEW PAGE
113	15 October 1991	--	NEW PAGE
114	15 October 1991	--	NEW PAGE
115	15 October 1991	--	NEW PAGE
116	15 October 1991	--	NEW PAGE
117	15 October 1991	--	NEW PAGE
118	15 October 1991	--	NEW PAGE
119	15 October 1991	--	NEW PAGE
120	15 October 1991	--	NEW PAGE
121	15 October 1991	--	NEW PAGE
122	15 October 1991	--	NEW PAGE
123	15 October 1991	--	NEW PAGE
124	15 October 1991	--	NEW PAGE
125	15 October 1991	--	NEW PAGE
126	15 October 1991	--	NEW PAGE
127	15 October 1991	--	NEW PAGE
128	15 October 1991	--	NEW PAGE
129	15 October 1991	--	NEW PAGE
130	15 October 1991	--	NEW PAGE
131	15 October 1991	--	NEW PAGE
132	15 October 1991	--	NEW PAGE
133	15 October 1991	--	NEW PAGE
134	15 October 1991	--	NEW PAGE
135	15 October 1991	--	NEW PAGE
136	15 October 1991	--	NEW PAGE
137	15 October 1991	--	NEW PAGE
138	15 October 1991	--	NEW PAGE
139	15 October 1991	--	NEW PAGE
140	15 October 1991	--	NEW PAGE
141	15 October 1991	--	NEW PAGE
142	15 October 1991	--	NEW PAGE

2. RETAIN THIS NOTICE AND INSERT BEFORE TABLE OF CONTENTS.

MIL-HDBK-299(SH)

NOTICE 1

15 OCTOBER 1991

3. Holders of MIL-HDBK-299(SH) will verify that page changes and additions indicated above have been entered. This notice page will be retained as a check sheet. This issuance, together with appended pages, is a separate publication. Each notice is to be retained by stocking points until the military handbook is completely revised or canceled.

Preparing activity:

Navy - SH

(Project 6145-N337)

[INCH-POUND]
MIL-HDBK-299(SH)
3 April 1989

MILITARY HANDBOOK

CABLE COMPARISON HANDBOOK
DATA PERTAINING TO ELECTRIC SHIPBOARD CABLE



AMSC N/A

DISTRIBUTION STATEMENT A Approved for public release; distribution unlimited

FSC 6145

MIL-HDBK-299(SH)
3 April 1989

DEPARTMENT OF DEFENSE
Washington, DC 20362-5101

Cable Comparison Handbook

1. This specification is approved for use within the Naval Sea Systems Command, Department of the Navy, and is available for use by all Departments and Agencies of the Department of Defense.
2. Beneficial comments (recommendations, additions, deletions) and any pertinent data which may be of use in improving this document should be addressed to: Commander, Naval Sea Systems Command, SEA 55Z3, Department of the Navy, Washington, DC 20362-5101 by using the self-addressed Standardization Document Improvement Proposal (DD Form 1426) appearing at the end of this document or by letter.

FOREWORD

1. This document supplements departmental manuals, directives, military standards, and so forth, and provides basic information on shipboard cables. It contains listings of shipboard cables, data tables, and supersession information, and should provide valuable facts and guidance to personnel responsible for the design, handling, installation, and maintenance of shipboard cable.
2. The "Cable Comparison Handbook" was first published in 1946 to facilitate utilization of electrical shipboard cable, and to assist in the planning of cable installations. A reprint was issued in 1948, and revised editions were printed in 1953, 1956, 1960, 1964, 1975, and 1977. This 1988 edition contains information on current cables. The information is based on current data, Section 304 of the General Specifications for Ships of the United States Navy, and MIL-C-915, MIL-C-24640, and MIL-C-24643.
3. For many years most of the shipboard power and lighting cables for fixed installation used silicone-glass insulation, polyvinyl chloride jacket, aluminum armor, and watertight construction. It was determined that cables with all of these features were not necessary for many applications, especially for applications within watertight compartments and non-critical areas above the watertightness level. Therefore, for applications within watertight compartments and non-critical areas, a new family of non-watertight lower cost cables was designed. This new family of cables is electrically and dimensionally interchangeable with silicone-glass insulated cables of equivalent sizes, and is covered by MIL-C-915.

Additionally, cables jacketed with polyvinyl chloride presented the dangers of toxic fumes and dense, impenetrable smoke when undergoing combustion. These hazards became increasingly evident when an electrical fire smoldered through the cable ways aboard the DDG 19 (USS TATTNALL). Because of the overwhelming amount of smoke and fumes, firefighters were unable to effectively control the fire, and a large amount of damage resulted. A new family of low smoke, low toxic cable, constructed with a polyolefin jacket vice polyvinyl chloride jacket, conforms to rigid toxic and smoke indexes and effectively reduces the hazards associated with the polyvinyl chloride jacketed cables. The new low smoke cable is covered by MIL-C-24643.

A family of lightweight cables has also been introduced to aid in the elimination of excessive weight from the fleet. Considering the substantial amount of cable present on a ship or submarine, a reduction in cable weight will have a considerable impact on the overall load, thus improving performance and increasing efficiency. This new family of lightweight cables is constructed from cross-linked polyalkene and mica polyimide insulation, and a cross-linked polyolefin jacket. The lightweight cable is covered by MIL-C-24640.
4. Cables are listed in this handbook by general classification according to application and design. Electrical shipboard cables are under control of the Defense Industrial Supply Center, and are covered in Navy Stock List of General Stores, FSC 6145.

MIL-HDBK-299(SH)
3 April 1989

CONTENTS

	<u>Page</u>
Paragraph 1.	
1.1	SCOPE
	Scope
2.	REFERENCED DOCUMENTS
2.1	Government documents
2.1.1	Specifications
2.2	Order of precedence
3.	DEFINITIONS
3.1	Ampacity
3.2	Circuit integrity
4.	GENERAL DESCRIPTION OF DATA AND CABLE TYPES
4.1	General description of data and cable types
4.1.1	Cable types and construction
4.1.2	Identification information
4.1.3	Cable available through military specifications
4.1.4	Commercially-available cables
4.1.5	Supersession data
4.1.6	Physical characteristics and electrical ratings of cables
4.1.7	Ampacity derating factors
4.1.8	Ampacity ratings for degaussing cable
5.	DETAILED REQUIREMENTS
5.1	Cable types and construction characteristics (as specified in MIL-C-24643) list
5.2	Cable types and construction characteristics (as specified in MIL-C-24640) list
5.3	Cable types and construction characteristics (as specified in MIL-C-915) list
5.4	Identification information
5.4.1	Standard identification code (STD)
5.4.2	Telephone identification code (TEL)
5.4.2.1	Conductor pairing
5.4.3	Special identification code (SPL)
5.4.4	Twisted pair identification code
5.4.5	Twisted triad identification code
5.4.6	Letter identification code (LTR)
5.4.7	Methods of applying identification
5.4.7.1	Method 1
5.4.7.2	Method 2
5.4.7.3	Method 3
5.4.7.4	Method 4
5.4.7.5	Method 5
5.4.7.6	Method 6
5.4.8	Manufacturer's identification tape
5.4.9	Year of manufacture

MIL-HDBK-299(SH)
 NOTICE 1
 15 OCTOBER 1991

CONTENTS- Continued

Paragraph		Page
	5.5 Brief explanation of cable ratings and characteristics tables.....	28
	5.5.1 First five columns.....	28
	5.5.2 Overall diameter.....	28
	5.5.3 Rated voltage, ampacity, and minimum radius of bend.....	28
	5.5.4 Conductor identification.....	28
	5.6 Cable classification (MIL-C-24643).....	28
	5.7 Cable classification (MIL-C-24640).....	55
	5.8 Cable classification (MIL-C-915).....	64
	5.9 Ampacity rating.....	72
	6. NOTES.....	74
	6.1 Subject term (key word) listing.....	74

TABLES

Table		Page
	I MIL-C-24643 cable application data.....	19
	II MIL-C-24640 cable application data.....	21
	III MIL-C-915 cable application data.....	23
	IV Commercial cable application data.....	23
	V Suppression data.....	24
	VI MIL-C-24643 cable ratings and characteristics.....	30
	VII MIL-C-24640 cable ratings and characteristics.....	56
	VIII MIL-C-915 cable ratings and characteristics.....	65
	IX Ampacity derating factors for ambient temperatures above 50°C.....	72
	X Ampacities of degaussing cable.....	73
	XI Impedances for LSTSGU cables, 60 Hz electronic and communication systems.....	96
	XII Impedances for LSTSGU cables, 400 Hz electronic and communication systems.....	96
	XIII Drop factors for LSTSGU cables, 450V, three-phase 60 Hz power systems.....	97
	XIV Drop factors for LSTSGU cables, 450V, three-phase 400 Hz power systems.....	98
	XV Drop factors for LS6SGU cables, 450V, three-phase 400 Hz power systems.....	99

MIL-HDBK-299(SH)
 NOTICE 1
 15 OCTOBER 1991

CONTENTS - Continued

		TABLES	Page
Table	XVI	Drop factors for LSTSGU cables, 120V, three-phase/single-phase, 60 Hz lighting systems, using I or I.....	100
	XVII	Drop factors for LSTSGU cables, 120V, three-phase/single-phase, 60 Hz lighting systems, using P or P.....	101
	XVIII	Dc conductor resistances at 20°C.....	134
	XIX	Dc stranded conductor resistances at 20°C..	135
	XX	Dc stranded conductor resistances at 65°C..	136
	XXI	Dc stranded conductor resistances at 45°C..	137
	XXII	Skin effect ratio.....	138
	XXIII	Dc to ac resistance conversion ratios.....	138
	XXIV	Ac resistances for SG conductors at 65°C...	139
	XXV	Ac resistances for SG conductors at 45°C...	139
	XXVI	Ac resistances for 6SG conductors at 65°C..	140
	XXVII	Reactances for SG conductors per MIL-C-24643.....	141
	XXVIII	Reactances for 6SG conductors at 65°C.....	142

FIGURES

Figure	1	Single-phase circuit representation.....	104
	2	Single-phase voltage and current phasor diagram.....	105
	3	Three-phase Circuit Representation.....	109
	4	Three-phase voltage and current phasor diagram.....	110
	5	Three-phase voltage and current phasor diagram.....	115
	6	Three-phase four-wire systems.....	122
	7	Three-phase unbalanced systems.....	125
	8	Three-phase unbalanced currents.....	126
	9	Positive sequence currents.....	127
	10	Negative sequence currents.....	128

MIL-HDBK-299(SH)
NOTICE 1
15 OCTOBER 1991

CONTENTS - Continued

APPENDIX

Paragraph	10.	SCOPE.....	75
	10.1	Scope.....	75
	20.	APPLICABLE DOCUMENTS.....	75
	20.1	Government documents.....	75
	20.2	Nongovernment Publications.....	75
	30.	DEFINITIONS.....	76
	30.1	Symbols and abbreviations.....	76
	40.	GENERAL EQUATIONS FOR CABLE VOLTAGE DROP CALCULATIONS.....	78
	40.1	Voltage drop calculations for dc systems.....	78
	40.1.1	Two-wire circuits.....	78
	40.2	Voltage drop calculation for ac systems.....	78
	40.2.1	Single-phase circuits.....	78
	40.2.2	Three-phase circuits.....	78
	40.3	Voltage drop calculations using drop factors.....	79
	40.3.1	Lighting systems.....	79
	40.3.2	Power systems.....	79
	50.	CURRENT CALCULATIONS FOR AC SYSTEMS.....	80
	50.1	Single-phase circuits.....	80
	50.2	Three-phase delta circuits.....	80
	50.2.1	Balanced systems.....	80
	50.2.2	Balanced/unbalanced systems.....	81
	50.3	Three-phase four-wire circuits.....	82
	50.4	Example of voltage drop calculations.....	82
	60.	VOLTAGE DROP CALCULATIONS FOR UNBALANCED SYSTEMS BY SYMMETRICAL COMPONENT METHOD..	87
	60.1	Calculation procedure.....	88
	60.2	Example of voltage drop calculations.....	90
	70.	CABLE IMPEDANCE AND DROP FACTORS.....	94
	70.1	Drop factor calculations.....	95
	70.1.1	Power systems.....	95
	70.1.2	Lighting systems.....	95
	80.	DERIVATION OF VOLTAGE DROP EQUATIONS FOR DC SYSTEMS.....	102

MIL-HDBK-299(SH)

NOTICE 1

15 OCTOBER 1991

CONTENTS - Continued

80.1	SINGLE-WIRE CIRCUITS.....	102
80.2	TWO-WIRE CIRCUITS.....	103
90.	DERIVATION OF VOLTAGE DROP EQUATIONS FOR SINGLE-PHASE/POWER SYSTEMS.....	104
100.	DERIVATION OF VOLTAGE DROP EQUATIONS FOR THREE-PHASE/LIGHTING SYSTEMS.....	109
110.	DERIVATION OF VOLTAGE EQUATIONS DROP FOR THREE-PHASE/LIGHTING SYSTEMS USING WATTS AND VARS.....	114
120.	DERIVATION OF VOLTAGE DROP EQUATIONS FOR THREE-PHASE FOUR-WIRE SYSTEMS.....	122
130.	DERIVATION OF VOLTAGE DROP EQUATIONS FOR UNBALANCED SYSTEMS BY SYMMETRICAL COMPONENT METHOD.....	125
140.	DERIVATION OF CABLE RESISTANCES AND REACTANCES.....	134
140.1	Calculations of cable resistances.....	134
140.2	Calculations of cable reactances.....	140

- viii -

NEW PAGE.

MIL-HDBK-299(SH)
3 April 1989

1. SCOPE

1.1 Scope. This handbook is intended to aid supply and installing activities in utilization of electric shipboard cable, particularly in the selection of alternate or substitute cables for use in lieu of specified types and sizes which might not be immediately available. It is also intended to aid in selecting currently available items for replacement of obsolete items. This handbook does not cover shore-use cable, magnet wire, coaxial cables, or radio frequency special cables used in connection with minesweeping and harbor defense.

2. REFERENCED DOCUMENTS

2.1 Government documents.

2.1.1 Specifications. Unless otherwise specified, the following specifications of the issue listed in that issue of the Department of Defense Index of Specifications and Standards (DoDISS) specified in the solicitation form a part of this handbook to the extent specified herein.

SPECIFICATIONS

MILITARY

- MIL-C-915 - Cable and Cord, Electrical, for Shipboard Use, General Specification for.
- MIL-C-24640 - Cable, Electrical, Lightweight, for Shipboard Use, General Specification for.
- MIL-C-24643 - Cable and Cord, Electrical, Low Smoke, for Shipboard Use, General Specification for.

(Copies of specifications required by contractors in connection with specific acquisition functions should be obtained from the contracting activity or as directed by the contracting officer.)

2.2 Order of precedence. In the event of a conflict between the text of this handbook and the references cited herein, the text of this handbook shall take precedence.

3. DEFINITIONS

3.1 Ampacity. Ampacity is an electrical property denoting current carrying capacity.

3.2 Circuit Integrity. Circuit integrity indicates cable construction and provides added protection that will allow that cable to function for a longer period under fire conditions.

4. GENERAL DESCRIPTION OF DATA AND CABLE TYPES

4.1 General description of date and cable types. General information concerning cable types is specified in 4.1.1 through 4.1.8, below.

4.1.1 Cable types and construction. A list of cable types and construction characteristics is provided in 5.1, 5.2, and 5.3. Cables listed are in accordance with MIL-C-24643 (for low smoke cable), MIL-C-24640 (for lightweight cable), and MIL-C-915 (for shipboard cables). Cables are listed alphabetically within application and design characteristics. This listing provides a brief description of the number of conductors and the type of insulation and jacketing employed in construction.

4.1.2 Identification information. A list of conductor identification methods employed for various types of cables is provided in 5.4.

4.1.3 Cable available through military specifications (tables I, II, and III). Tables I, II, and III provide a listing of cables, available through military specifications, according to general application. This list is intended to aid in the selection of cables for different applications.

4.1.4 Commercially-available cables (table IV). Table IV provides a list of commercially-available cables according to general application.

4.1.5 Supersession data (table V). Table V lists cable types alphabetically using MIL-C-915 cable designations. Cable types which were covered by previous specifications are listed with the corresponding present type.

4.1.6 Physical characteristics and electrical ratings of cables (tables VI, VII, and VIII). Tables VI, VII, and VIII contain information concerning physical characteristics and electrical ratings at normal operating temperatures. Cables must not be loaded in excess of these maximum ratings. Additional explanations applicable to tables VI, VII, and VIII are as follows:

- (a) Cables are listed according to military specification sheet, functional category within that military specification sheet (such as watertight and non-watertight, flexing, and non-flexing, power and lighting, communications and electronics), and size and type designation within each table.
- (b) Rated voltages are not listed for cable types designed for voice communication, analog or digital data transmission, or sending circuits such as sonar and pyrometer. The applicability of these types must be determined from additional circuit parameters such as signal waveform, frequency and peak amplitude, signal fidelity, pulse duration and recurrence frequency, attenuation, and frequency bandwidth.
- (c) The notation Ind/Avg denotes that individual conductors can carry the current listed under Ind, provided the average of all currents in the individual conductors does not exceed the value listed under Avg.
- (d) The measurement point for minimum radius of bend should be that surface of the cable jacket which is on the innermost portion of the cable bend. Dimensions listed are approximately eight times the overall diameter of the cable or cord. However, during installation or operation, a dimension of approximately twelve times the cable overall diameter for conduit bends, sheaves, and other curved surfaces around which the cable or cord may be pulled under tension should be used.

3 April 1989

- (e) Unless otherwise indicated, all conductors are of the same size. Unless otherwise indicated, all conductors are soft, annealed copper. For additional data covering conductor stranding and conductor dimensions, see MIL-C-915, MIL-C-24640, and MIL-C-24643.

4.1.7 Ampacity derating factors (table IX). Table IX lists ampacity derating factors for ambient temperatures above 50 degrees Celsius (°C). (see 5.9).

4.1.8 Ampacity ratings for degaussing cable. Table X lists the ampacity ratings (maximum amperes per conductor) for degaussing cables.

5. DETAILED REQUIREMENTS

5.1 Cable types and construction characteristics (as specified in MIL-C-24643) list. Cable types and construction characteristics (as specified in MIL-C-24643) are as follows:

- LSCVSF - 400-Hertz (Hz) aircraft servicing: three ethylene propylene rubber insulated conductors and one uninsulated conductor, overall cross-linked polyolefin jacket.
- LSDCOP - Double conductor, oil-resistant, portable cord: ethylene propylene rubber or cross-linked polyethylene insulation, and cross-linked polyolefin jacket.
- LSDHOF - Double conductor, heat and oil-resistant, flexible: ethylene propylene rubber insulation, cross-linked polyolefin jacket.
- LSDNW - Double conductor: ethylene propylene rubber or cross-linked polyethylene insulation, cross-linked polyolefin jacket, unarmored.
- LSDNWA - Double conductor: ethylene propylene rubber or cross-linked polyethylene insulation, cross-linked polyolefin jacket, armored.
- LSDPS - Double conductor, power: silicone rubber insulation, glass braid, silicone rubber jacket, armored.
- LSDRW - Double conductor: cross-linked polyethylene insulation, cross-linked polyolefin jacket, unarmored.
- LSDRWA - Double conductor: cross-linked polyethylene insulation, cross-linked polyolefin jacket, armored.
- LSDSGA - Double conductor: silicone rubber and glass braid insulated, cross-linked polyolefin jacket, armored.
- LSDSGU - Double conductor: silicone rubber and glass braid insulated, cross-linked polyolefin jacket, unarmored.
- LSECM - Eight pairs shielded, and eight groups of seven conductors for each group: cross-linked polyethylene insulation for the conductors of each pair, braided shield over each pair; ethylene propylene rubber or cross-linked polyethylene insulation for the conductors of the groups of seven; crosslinked polyolefin jacket, unarmored.
- LSECMA - Eight pairs shielded, and eight groups of seven conductors for each group: cross-linked polyethylene insulation for the conductors of each pair, braided shield over each pair; ethylene propylene rubber or cross-linked polyethylene insulation for the conductors of the groups of seven; cross-linked polyolefin jacket, armored.
- LSFHOF - Four conductors, heat and oil-resistant, flexible: ethylene propylene rubber insulation, cross-linked polyolefin jacket.

3 April 1989

- LSFNW - Four conductors: ethylene propylene rubber or cross-linked polyethylene insulation, cross-linked polyolefin jacket, unarmored.
- LSFNWA - Four conductors: ethylene propylene rubber or cross-linked polyethylene insulation, cross-linked polyolefin jacket, armored.
- LSFPS - Four conductors, power: silicone rubber insulation, glass braid, silicone rubber jacket, armored.
- LSFSGA - Four conductors: silicone rubber and glass insulated, cross-linked polyolefin jacket, armored.
- LSFGU - Four conductors: silicone rubber and glass insulated, cross-linked polyolefin jacket, unarmored.
- LSMA - Multiple conductor: ethylene propylene rubber or cross-linked polyethylene insulation, cross-linked polyolefin jacket, armored.
- LSMCOS - Multiple conductor, oil-resistant, shielded: ethylene propylene rubber or cross-linked polyethylene over pairs, or over assembly, cross-linked polyolefin jacket.
- LSMDU - Multiple conductor, degaussing: ethylene propylene or cross-linked polyethylene insulation, cross-linked polyolefin jacket, unarmored.
- LSMDY - Multiple conductor, degaussing: ethylene propylene or cross-linked polyethylene insulation, cross-linked polyolefin jacket, armored between double-layer jacket.
- LSMHOF - Multiple conductor, heat and oil-resistant, flexible: ethylene propylene rubber or cross-linked polyethylene insulation, cross-linked polyolefin jacket.
- LSMMOP - Multiple conductor, microphone, oil-resistant, portable: ethylene propylene rubber or cross-linked polyethylene insulation, cross-linked polyolefin jacket.
- LSMNW - Multiple conductor: ethylene propylene rubber or cross-linked polyethylene insulation, cross-linked polyolefin jacket, unarmored.
- LSMNWA - Multiple conductor: ethylene propylene rubber or cross-linked polyethylene insulation, cross-linked polyolefin jacket, armored.
- LSMRI - Multiple conductor: ethylene propylene rubber or cross-linked polyethylene insulated, without fillers, no overall jacket.
- LSMS - Multiple conductor, shielded: ethylene propylene rubber or cross-linked polyethylene insulation, overall braided shield, cross-linked polyolefin jacket, unarmored.
- LSMSA - Multiple conductor, shielded: ethylene propylene rubber or cross-linked polyethylene insulation, overall braided shield, cross-linked polyolefin jacket, armored.
- LSMSCA - Multiple conductor: silicone rubber insulated-glass braided conductors, cross-linked polyolefin jacket, armored.
- LSMSCS - Multiple conductor: silicone rubber insulated-glass braided conductors, cross-linked polyolefin jacket, double overall shielded.
- LSMSCU - Multiple conductor: silicone rubber insulated-glass braided conductors, cross-linked polyolefin jacket, unarmored.
- LSMU - Multiple conductor: ethylene propylene rubber or cross-linked polyethylene insulation, cross-linked polyolefin jacket, unarmored.
- LSMUS - Multiple conductor: ethylene propylene rubber or cross-linked polyethylene insulation, cross-linked polyolefin jacket, double overall shielded.
- LSPBTM - Pyrometer base multiple pairs: ethylene propylene rubber or cross-linked polyethylene insulation on one copper and one constantan conductor, cross-linked polyolefin jacket, armored.

MIL-HDBK-299(SH)
3 April 1989

- LSPBTMU - Pyrometer base multiple pairs: ethylene propylene rubber or cross-linked polyethylene insulation on one copper and one constantan conductor, cross-linked polyolefin jacket, unarmored.
- LSPI - Position indicator: silicone rubber insulation, glass braid, shielded pairs, silicone rubber jacket, armored.
- LSSHOF - Single conductor, heat and oil-resistant, flexible: ethylene propylene rubber insulation, cross-linked polyolefin jacket.
- LSSRW - Single conductor, radio: cross-linked polyethylene insulation, cross-linked polyolefin jacket, unarmored.
- LSSRWA - Single conductor, radio: cross-linked polyethylene insulation, cross-linked polyolefin jacket, armored.
- LSSSF - Single conductor: ethylene propylene rubber or cross-linked polyethylene insulation, cross-linked polyolefin jacket.
- LSSSGA - Single conductor: silicone rubber and glass tape insulated, cross-linked polyolefin jacket, armored.
- LSSSGU - Single conductor: silicone rubber and glass tape insulated, cross-linked polyolefin jacket, unarmored.
- LSTCJA - Thermocouple, type J, single pair: one iron and one constantan conductor, extruded silicone rubber insulated, glass braided, cross-linked polyolefin jacket, armored.
- LSTCJU - Thermocouple, type J, single pair: one iron and one constantan conductor, extruded silicone rubber insulated, glass braided, cross-linked polyolefin jacket, unarmored.
- LSTCJX - Thermocouple, type J, multiple pairs: extruded silicone rubber insulated, glass braid on one iron and one constantan conductor for each pair, silicone rubber jacket, armored.
- LSTCKX - Thermocouple, type K, multiple pairs: extruded silicone rubber insulated, glass braid on one Chromel and one Alumel conductor for each pair, silicone rubber jacket, armored.
- LSTCOP - Three conductors, oil-resistant, portable: ethylene propylene rubber or cross-linked polyethylene insulation, cross-linked polyolefin jacket.
- LSTCTA - Thermocouple, type T, single pair: one copper and one constantan conductor, extruded silicone rubber insulated, glass braided, cross-linked polyolefin jacket, armored.
- LSTCTU - Thermocouple, type T, single pair: one copper and one constantan conductor, extruded silicone rubber insulated, glass braided, cross-linked polyolefin jacket, unarmored.
- LSTCTX - Thermocouple, type T, multiple pairs: extruded silicone rubber insulated, glass braid on one copper and one constantan conductor for each pair, cross-linked polyolefin jacket, armored.
- LSTHOF - Three conductors, heat and oil-resistant, flexible: ethylene propylene rubber insulation, cross-linked polyolefin jacket.
- LSTNW - Three conductors: ethylene propylene rubber or cross-linked polyethylene insulation, cross-linked polyolefin jacket, unarmored.
- LSTNWA - Three conductors: ethylene propylene rubber or cross-linked polyethylene insulation, cross-linked polyolefin jacket, armored.
- LSTPNW - Twisted pairs: ethylene propylene or cross-linked polyethylene insulation, cross-linked polyolefin jacket, unarmored.
- LSTPNWA - Twisted pairs: ethylene propylene or cross-linked polyethylene insulation, cross-linked polyolefin jacket, armored.
- LSTPS - Three conductors, power supply: silicone rubber insulation, glass braid, silicone rubber jacket, armored.

MIL-HDBK-299(SH)
3 April 1989

- LSTRW - Three conductors, radio: cross-linked polyethylene insulation, cross-linked polyolefin jacket, unarmored.
- LSTRWA - Three conductors, radio: cross-linked polyethylene insulation, cross-linked polyolefin jacket, armored.
- LSTSGA - Three conductors: extruded silicone rubber and glass insulation, cross-linked polyolefin jacket, armored.
- LSTGU - Three conductors: extruded silicone rubber and glass insulation, cross-linked polyolefin jacket, unarmored.
- LTTOP - Twisted pairs, oil-resistant, portable: ethylene propylene rubber or cross-linked polyethylene insulation, cross-linked polyolefin jacket.
- LSTTRS - Twisted pairs, radio, shielded, flexible: cross-linked polyethylene insulation, braided shield for each pair, cross-linked polyolefin jacket, unarmored.
- LSTTRSA - Twisted pairs, radio, shielded, flexible: cross-linked polyethylene insulation, braided shield for each pair, cross-linked polyolefin jacket, armored.
- LTTSA - Twisted pairs: extruded silicone rubber and polyamide special purpose, cross-linked polyolefin jacket, armored.
- LTTSU - Twisted pairs: extruded silicone rubber and polyamide special purpose, cross-linked polyolefin jacket, unarmored.
- LS1SA - Single, shielded: cross-linked polyethylene insulation, braided shield on each conductor, cross-linked polyolefin jacket, armored.
- LS1SAU - Single, shielded: cross-linked polyethylene insulation, braided shield on each conductor, cross-linked polyolefin jacket, unarmored.
- LS1SMA - Singles, shielded, multiple conductor: cross-linked polyethylene insulation, braided shield on each conductor, cross-linked polyolefin jacket, armored.
- LS1SMU - Singles, shielded, multiple conductor: cross-linked polyethylene insulation, braided shield on each conductor, cross-linked polyolefin jacket, unarmored.
- LS1SMWA - Singles, shielded, multiple conductor: cross-linked polyethylene insulation, braided shield over each conductor, cross-linked polyolefin jacket, armored.
- LS1SMWU - Singles, shielded, multiple conductor: cross-linked polyethylene insulation, braided shield over each conductor, cross-linked polyolefin jacket, unarmored.
- LS1SU - Singles, shielded: cross-linked polyethylene insulated, braided shield on each conductor, cross-linked polyolefin jacket, armored.
- LS1SUA - Singles, shielded: cross-linked polyethylene insulated, braided shield on each conductor, cross-linked polyolefin jacket, unarmored.
- LS1SWA - Singles, shielded: cross-linked polyethylene insulation, braided shield on each conductor, cross-linked polyolefin jacket, armored.
- LS1SWU - Singles, shielded: cross-linked polyethylene insulation, braided shield on each conductor, cross-linked polyolefin jacket, unarmored.
- LS1S50MA - Singles, shielded, 50-ohm, multiple conductor: cross-linked polyethylene insulation, braided shield on each conductor, cross-linked polyolefin jacket, armored.
- LS1S50MU - Singles, shielded, 50-ohm, multiple conductor: cross-linked polyethylene insulation, braided shield on each conductor, cross-linked polyolefin jacket, unarmored.

3 April 1989

- LS1S50MUS - Singles, shielded, 50-ohm, multiple conductor: cross-linked polyethylene insulation, braided shield on each conductor, cross-linked polyolefin jacket, double overall shielded.
- LS1S75MA - Singles, shielded, 75-ohm, multiple conductor: cross-linked polyethylene insulation, braided shield over each conductor, cross-linked polyolefin jacket, armored.
- LS1S75MU - Singles, shielded, 75-ohm, multiple conductor: cross-linked polyethylene insulation, braided shield over each conductor, cross-linked polyolefin jacket, unarmored.
- LS2A - Twisted pairs, shielded: cross-linked polyethylene insulation, overall braided shield, cross-linked polyolefin jacket, armored.
- LS2AU - Twisted pairs, shielded: cross-linked polyethylene insulation, overall braided shield, cross-linked polyolefin jacket, unarmored.
- LS2AUS - Twisted pairs, shielded: cross-linked polyethylene insulation, overall braided shield, cross-linked polyolefin jacket, double overall shielded.
- LS2CS - Pairs, shielded: cross-linked polyethylene insulation, double braided shield overall, cross-linked polyolefin jacket.
- LS2SA - Pairs, shielded: cross-linked polyethylene insulation, braided shield over each pair, cross-linked polyolefin jacket, armored.
- LS2SJ - Pairs, shielded: ethylene propylene rubber or cross-linked polyethylene insulation, overall braided shield, cross-linked polyolefin jacket, unarmored.
- LS2SJA - Pairs, shielded: ethylene propylene rubber or cross-linked polyethylene insulation, overall braided shield, cross-linked polyolefin jacket, armored.
- LS2SU - Pairs, shielded: cross-linked polyethylene insulation, braided shield over each pair, cross-linked polyolefin jacket, unarmored.
- LS2SUS - Pairs, shielded: cross-linked polyethylene insulation, braided shield over each pair, cross-linked polyolefin jacket, double overall shielded.
- LS2SWA - Pairs, shielded: cross-linked polyethylene insulation, braided shield over each pair, cross-linked polyolefin jacket, armored.
- LS2SWAU - Pairs, shielded: cross-linked polyethylene insulation, braided shield over each pair, cross-linked polyolefin jacket, unarmored.
- LS2SWL-7 - Pairs, shielded: cross-linked polyethylene insulation, braided shield over each pair, cross-linked polyolefin jacket, unarmored.
- LS2SWLA-7 - Pairs, shielded: cross-linked polyethylene insulation, braided shield over each pair, cross-linked polyolefin jacket, armored.
- LS2SWU - Pairs, shielded: cross-linked polyethylene insulation, braided shield over each pair, cross-linked polyolefin jacket, unarmored.
- LS2SWUA - Pairs, shielded: cross-linked polyethylene insulation, braided shield over each pair, cross-linked polyolefin jacket, armored.
- LS2U - Pairs: cross-linked polyethylene insulation, overall braided shield, cross-linked polyolefin jacket, unarmored.
- LS2UA - Pairs: cross-linked polyethylene insulation, overall braided shield, cross-linked polyolefin jacket, armored.
- LS2UW-42 - Twisted pairs: cross-linked polyethylene insulation, overall braided shield, cross-linked polyolefin jacket, unarmored.
- LS2UWA-42 - Twisted pairs: cross-linked polyethylene insulation, overall braided shield, cross-linked polyolefin jacket, armored.
- LS2UWS-42 - Twisted pairs: cross-linked polyethylene insulation, overall braided shield, cross-linked polyolefin jacket, double overall shielded.

3 April 1989

- LS2WA - Pairs: cross-linked polyethylene insulation, overall braided shield, cross-linked polyolefin jacket, armored.
- LS2WAU - Pairs: cross-linked polyethylene insulation, overall braided shield, cross-linked polyolefin jacket, unarmored.
- LS3SA - Triads, shielded: cross-linked polyethylene insulation, braided shield over each triad, cross-linked polyolefin jacket, armored.
- LS3SF - Triads, shielded, flexible: cross-linked polyethylene insulation, braided shield over each triad, polyester tape over the assembled triads, cross-linked polyolefin jacket.
- LS3SJ - Triads, shielded: ethylene propylene rubber or cross-linked polyethylene insulation, overall braided shield, cross-linked polyolefin jacket, unarmored.
- LS3SJA - Triads, shielded: ethylene propylene rubber or cross-linked polyethylene insulation, overall braided shield, cross-linked polyolefin jacket, armored.
- LS3SU - Triads, shielded: cross-linked polyethylene insulation, braided shield over each triad, cross-linked polyolefin jacket, armored.
- LS3SUS - Triads, shielded: cross-linked polyethylene insulation, braided shield over each triad, cross-linked polyolefin jacket, double overall shielded.
- LS3SWA - Triads, shielded: cross-linked polyethylene insulation, braided shield over each triad, cross-linked polyolefin jacket, armored.
- LS3SWU - Triads, shielded: cross-linked polyethylene insulation, braided shield over each triad, cross-linked polyolefin jacket, unarmored.
- LS3SWUS - Triads, shielded: cross-linked polyethylene insulation, braided shield over each triad, cross-linked polyolefin jacket, double overall shielded.
- LS3U - Triads: cross-linked polyethylene insulation, marker braid on each triad, cross-linked polyolefin jacket, unarmored.
- LS3UA - Triads: cross-linked polyethylene insulation, marker braid on each triad, cross-linked polyolefin jacket, armored.
- LS4NW8 - Four conductors: cross-linked polyethylene insulation or ethylene propylene rubber, cross-linked polyolefin jacket, unarmored.
- LS4NWA8 - Four conductors: cross-linked polyethylene insulation or ethylene propylene rubber, cross-linked polyolefin jacket, armored.
- LS4SJ - Four conductors, shielded: ethylene propylene rubber or cross-linked polyethylene insulation, overall braided shield, cross-linked polyolefin jacket, unarmored.
- LS4SJA - Four conductors, shielded: ethylene propylene rubber or cross-linked polyethylene insulation, overall braided shield, cross-linked polyolefin jacket, armored.
- LS5KVTSGA - 5000-volt, three conductors: silicone rubber and glass tape insulation, cross-linked polyolefin jacket, armored.
- LS5KVTSGU - 5000-volt, three conductors: silicone rubber and glass tape insulation, cross-linked polyolefin jacket, unarmored.
- LS6SGA - Six conductors: silicone and glass insulation, cross-linked polyolefin jacket, armored.
- LS6SGU - Six conductors: silicone and glass insulation, cross-linked polyolefin jacket, unarmored.
- LS7PS - Seven conductors, power supply: silicone rubber insulation, glass braid, silicone rubber jacket, armored.
- LS7SGA - Seven conductors: silicone rubber and glass insulation, cross-linked polyolefin jacket, armored.

3 April 1989

- LS7SGU - Seven conductors: silicone rubber and glass insulation, cross-linked polyolefin jacket, unarmored.
- LS8NW6 - Eight conductors: cross-linked polyethylene or ethylene propylene rubber insulation, cross-linked polyolefin jacket, unarmored.
- LS8NWA6 - Eight conductors: cross-linked polyethylene or ethylene propylene rubber insulation, cross-linked polyolefin jacket, armored.

5.2 Cable types and construction characteristics (as specified in MIL-C-24640) list. Cable types and construction characteristics (as specified in MIL-C-24640) are as follows:

- DX - Double conductor, power supply: cross-linked polyalkene insulation, cross-linked polyolefin jacket, unarmored.
- DXA - Double conductor, power supply: cross-linked polyalkene insulation, cross-linked polyolefin jacket, armored.
- DXW - Two conductors: mica polyimide insulation, cross-linked polyolefin jacket, unarmored.
- DXOW - Two conductors: mica polyimide insulation, cross-linked polyolefin jacket, overall shielded.
- DXWA - Two conductors: mica polyimide insulation, cross-linked polyolefin jacket, armored.
- FX - Four conductors, power supply: cross-linked polyalkene insulation, cross-linked polyolefin fluoride jacket, unarmored.
- FXA - Four conductors, power supply: cross-linked polyalkene insulation, cross-linked polyolefin fluoride jacket, armored.
- FXW - Four conductors: mica polyimide insulation, cross-linked polyolefin jacket, unarmored.
- FXOW - Four conductors: mica polyimide insulation, cross-linked polyolefin jacket, overall shielded.
- FXWA - Four conductors: mica polyimide insulation, cross-linked polyolefin jacket, armored.
- MXCW - Multi-conductor, control: mica polyimide insulation, cross-linked polyolefin jacket, unarmored.
- MXCOW - Multi-conductor, control: mica polyimide insulation, cross-linked polyolefin jacket, overall shielded.
- MXCWA - Multi-conductor, control: mica polyimide insulation, cross-linked polyolefin jacket, armored.
- MXO - Multi-conductor, power supply: cross-linked polyalkene insulation, cross-linked polyolefin jacket, overall shielded.
- MXSO - Multi-conductor; cross-linked polyalkene insulation, cross-linked polyolefin jacket, overall shielded.
- TTX - Multi-pair, twisted: cross-linked polyalkene insulation, cross-linked polyolefin jacket, unarmored.
- TTXA - Multi-pair, twisted: cross-linked polyalkene insulation, cross-linked polyolefin jacket, armored.
- TTXS - Multi-pair, twisted, shielded: cross-linked polyalkene insulation, cross-linked polyolefin jacket, unarmored.
- TTXSA - Multi-pair, twisted, shielded: cross-linked polyalkene insulation, cross-linked polyolefin jacket, armored.
- TTXSO - Multi-pair, twisted, shielded: cross-linked polyalkene insulation, cross-linked polyolefin jacket, overall shielded.
- TTXW - Multi-pair: mica polyimide insulation, cross-linked polyolefin jacket, unarmored.

- TTXOW - Multi-pair: mica polyimide insulation, cross-linked polyolefin jacket, overall shielded.
- TTXWA - Multi-pair: mica polyimide insulation, cross-linked polyolefin jacket, armored.
- TX - Three conductor, power supply: cross-linked polyolefin insulation, cross-linked polyolefin jacket, unarmored.
- TXA - Three conductor, power supply: cross-linked polyolefin insulation, cross-linked polyolefin jacket, armored.
- TXW - Three conductor, power: mica polyimide insulation; cross-linked polyolefin jacket, unarmored.
- TXOW - Three conductor, power: mica polyimide insulation; cross-linked polyolefin jacket, overall shielded.
- TXWA - Three conductor, power: mica polyimide insulation; cross-linked polyolefin jacket, armored.
- 1XMSO - Multi-conductor, shielded: cross-linked polyalkene insulation, cross-linked polyolefin jacket, overall shielded.
- 1XSOW - Multi-conductor, shielded: cross-linked polyalkene insulation, cross-linked polyolefin jacket, overall shielded.
- 2XAO - Multi-pair, twisted: cross-linked polyalkene insulation, cross-linked polyolefin jacket, overall shielded.
- 2XO - Multi-pair, twisted: cross-linked polyalkene insulation, cross-linked polyolefin jacket, overall shielded.
- 2XOW - Multi-pair, twisted: cross-linked polyalkene insulation, cross-linked polyolefin jacket, overall shielded.
- 2XS - Multi-pair, twisted, shielded: cross-linked polyalkene insulation, cross-linked polyolefin jacket, unarmored.
- 2XSA - Multi-pair, twisted, shielded: cross-linked polyalkene insulation, cross-linked polyolefin jacket, armored.
- 2XSO - Multi-pair, twisted, shielded: cross-linked polyalkene insulation, cross-linked polyolefin jacket, overall shielded.
- 2XSAW - Multi-pair, shielded: cross-linked polyalkene insulation, cross-linked polyolefin jacket, unarmored.
- 2XSAOW - Multi-pair, shielded: cross-linked polyalkene insulation, cross-linked polyolefin jacket, overall shielded.
- 2XSAWA - Multi-pair, shielded: cross-linked polyalkene insulation, cross-linked polyolefin jacket, armored.
- 2XSXO - Multi-pair, twisted, shielded: cross-linked polyalkene insulation, cross-linked polyolefin jacket, overall shielded.
- 2XSW - Multi-pair, shielded: cross-linked polyalkene insulation, cross-linked polyolefin jacket, unarmored.
- 2XSOW - Multi-pair, shielded: cross-linked polyalkene insulation, cross-linked polyolefin jacket, overall shielded.
- 2XSWA - Multi-pair, shielded: cross-linked polyalkene insulation, cross-linked polyolefin jacket, armored.
- 3XS - Multi-triad, twisted, shielded: cross-linked polyalkene insulation, cross-linked polyolefin jacket, unarmored.
- 3XSA - Multi-triad, twisted, shielded: cross-linked polyalkene insulation, cross-linked polyolefin jacket, armored.
- 3XSW - Multi-triad, twisted, shielded: cross-linked polyalkene insulation, cross-linked polyolefin jacket, unarmored.
- 3XSOW - Multi-triad, twisted, shielded: cross-linked polyalkene insulation, cross-linked polyolefin jacket, overall shielded.

- 3XSWA - Multi-triad, twisted, shielded: cross-linked polyalkene insulation, cross-linked polyolefin jacket, armored.
7XW - Seven conductors: mica polyimide insulation, cross-linked polyolefin jacket, unarmored.
7XWA - Seven conductors: mica polyimide insulation, cross-linked polyolefin jacket, armored.

5.3 Cable types and construction characteristics (as specified in MIL-C-915) list. Cable types and construction characteristics (as specified in MIL-C-915) are as follows:

- CVSF - 400-Hz aircraft servicing: three synthetic rubber insulated conductors and one uninsulated conductor, overall polychloroprene jacket.
DLT - Divers lifeline and telephone: four rubber insulated conductors cabled around an insulated steel core, reinforced polychloroprene jacket overall.
DSS - Double conductor, shielded: rubber insulation, overall braided shield, polychloroprene or chlorosulfonated polyethylene jacket.
DSWS - Double conductor, shielded: rubber insulation, overall braided shield, polychloroprene jacket.
FSS - Four conductors, shielded: rubber insulated, overall braided shield, polychloroprene or chlorosulfonated polyethylene jacket.
JAS - Jet aircraft servicing: four rubber insulated conductors, two conductors Navy size 250, two conductors Navy size 6, reinforced polychloroprene jacket.
MCSF-4 - Multiple conductor, acoustic minesweeping, power: two American Wire Gauge (AWG) 6 and two AWG 1 conductors, rubber insulation, reinforced polychloroprene jacket.
MSP - Multiple conductor: fifty-nine conductors, sixteen AWG 22 having fluorocarbon insulation and a braided copper shield, eighteen AWG 20 having polyvinyl chloride insulation and a braided copper shield (nine singles, one triad and three pairs, each shielded), twenty-five Navy size 3 having polyvinyl insulation (eight pairs and three triads, each shielded), polychloroprene jacket.
MSPW - Multiple conductor: fifty-nine conductors; sixteen AWG 22 having fluorocarbon insulation and a braided copper shield, eighteen AWG 20 having polyvinyl chloride insulation and a braided copper shield (nine singles, one triad and three pairs, each shielded), twenty-five Navy size 3 having polyvinyl insulation (eight pairs and three triads, each shielded), polychloroprene jacket, watertight.
MWF - Multiple conductor: rubber or cross-linked polyethylene insulation, arctic type neoprene jacket.
S2S - Two conductors, shielded: cross-linked polyethylene insulations, braided shield, rubber insulation over shield, outer-braided shield; reinforced rubber, insulated, arctic type polychloroprene jacket.
THOF - Three conductors, heat and oil resistant, flexible: synthetic rubber insulation standard thermoplastic jacket on THOF-42, and polychloroprene jacket on THOF-400 and THOF-500.
TRF - Single conductor, flexible: rubber insulation, polychloroprene jacket.
TPUM-6 - Telephone, portable, multiple conductor: copper-clad steel conductors, polypropylene insulation, six pairs cabled, polyurethane jacket applied in two layers.

MIL-HDBK-299(SH)
3 April 1989

- TRXF - Single conductor: polychloroprene jacket.
TSP - Twisted pairs: polyvinyl chloride insulated, special thermoplastic jacket, watertight, unarmored.
TSPA - Twisted pairs: polyvinyl chloride insulated, special thermoplastic jacket, watertight, armored.
TSS - Three conductors, special purpose, shielded: rubber insulation, overall braided shield, polychloroprene or chlorosulfonated polyethylene jacket.
1SWF - Singles, shielded: polyethylene insulation, braided shield on each conductor, arctic type polychloroprene jacket.
2SWF - Pairs, shielded, watertight, flexible: polyethylene insulation, braided shield over each pair, arctic type polychloroprene jacket.
5SS - Five conductors, shielded, sonar: rubber insulation, braided shield on one conductor only, and a braided shield over the assembled five conductors, polychloroprene jacket overall.
7SS - Seven conductors, shielded: rubber insulation, overall braided shield, polychloroprene or chlorosulfonated polyethylene jacket.

5.4 Identification information. Conductors and groups of conductors, such as pairs and triads, are separately identified within a completed cable. The identification codes should be as specified in 5.4.1 through 5.4.9, inclusive.

5.4.1 Standard identification code (STD). The conductor identification code for standard cables should be as follows:

Color, conductor or group no.	Background or base color	First tracer color	Second tracer color
1	Black	---	---
2	White	---	---
3	Red	---	---
4	Green	---	---
5	Orange	---	---
6	Blue	---	---
7	White	Black	---
8	Red	Black	---
9	Green	Black	---
10	Orange	Black	---
11	Blue	Black	---
12	Black	White	---
13	Red	White	---
14	Green	White	---
15	Blue	White	---
16	Black	Red	---
17	White	Red	---
18	Orange	Red	---
19	Blue	Red	---
20	Red	Green	---

MIL-HDBK-299(SH)

3 April 1989

Color, conductor or group no.	Background or base color	First tracer color	Second tracer color
21	Orange	Green	---
22	Black	White	Red
23	White	Black	Red
24	Red	Black	White
25	Green	Black	White
26	Orange	Black	White
27	Blue	Black	White
28	Black	Red	Green
29	White	Red	Green
30	Red	Black	Green
31	Green	Black	Orange
32	Orange	Black	Green
33	Blue	White	Orange
34	Black	White	Orange
35	White	Red	Orange
36	Orange	White	Blue
37	White	Red	Blue
38	Brown	---	---
39	Brown	Black	---
40	Brown	White	---
41	Brown	Red	---
42	Brown	Green	---
43	Brown	Orange	---
44	Brown	Blue	---
45	White	Black	Blue
46	Red	White	Blue
47	Green	Orange	Red
48	Orange	Red	Blue
49	Blue	Red	Orange
50	Black	Orange	Red
51	White	Black	Orange
52	Red	Orange	Black
53	Green	Red	Blue
54	Orange	Black	Blue
55	Blue	Black	Orange
56	Black	Orange	Green
57	White	Orange	Green
58	Red	Orange	Green
59	Green	Black	Blue
60	Orange	Green	Blue

MIL-HDBK-299(SH)

3 April 1989

Color, conductor or group no.	Background or base color	First tracer color	Second tracer color
61	Blue	Green	Orange
62	Black	Red	Blue
63	White	Orange	Blue
64	Red	Black	Blue
65	Green	Orange	Blue
66	Orange	White	Red
67	Blue	White	Red
68	Black	Green	Blue
69	White	Green	Blue
70	Red	Green	Blue
71	Green	White	Red
72	Orange	Red	Black
73	Blue	Red	Black
74	Black	Orange	Blue
75	Red	Orange	Blue
76	Green	Red	Black
77	Orange	White	Green
78	Blue	White	Green
79	Red	White	Orange
80	Green	White	Orange
81	Blue	Black	Green
82	Orange	White	---
83	Green	Red	---
84	Black	Green	---
85	White	Green	---
86	Blue	Green	---
87	Black	Orange	---
88	White	Orange	---
89	Red	Orange	---
90	Green	Orange	---
91	Blue	Orange	---
92	Black	Blue	---
93	White	Blue	---
94	Red	Blue	---
95	Green	Blue	---
96	Orange	Blue	---
97	Yellow	---	---
98	Yellow	Black	---
99	Yellow	White	---
100	Yellow	Red	---

3 April 1989

Color, conductor or group no.	Background or base color	First tracer color	Second tracer color
101	Yellow	Green	---
102	Yellow	Orange	---
103	Yellow	Blue	---
104	Black	Yellow	---
105	White	Yellow	---
106	Red	Yellow	---
107	Green	Yellow	---
108	Orange	Yellow	---
109	Blue	Yellow	---
110	Black	Yellow	Red
111	White	Yellow	Red
112	Green	Yellow	Red
113	Orange	Yellow	Red
114	Blue	Yellow	Red
115	Black	Yellow	White
116	Red	Yellow	White
117	Green	Yellow	White
118	Orange	Yellow	White
119	Blue	Yellow	White
120	Black	Yellow	Green
121	White	Yellow	Green
122	Red	Yellow	Green
123	Orange	Yellow	Green
124	Blue	Yellow	Green
125	Black	Yellow	Blue
126	White	Yellow	Blue
127	Red	Yellow	Blue

5.4.2 Telephone identification code (TEL). The conductor identification code for telephone cables should be as follows:

<u>Color or conductor no.</u>	<u>Color</u>	<u>Color or conductor no.</u>	<u>Color</u>
1	Black	7	Brown
2	White	8	Gray
3	Red	9	Yellow
4	Green	10	Purple
5	Orange	11	Tan
6	Blue	12	Pink

5.4.2.1 Conductor pairing. The pairing of conductors for forming pairs should be as follows:

Number 1 paired with numbers 2 through 12 for next eleven pairs.
Number 2 paired with numbers 3 through 12 for next ten pairs.
Number 3 paired with numbers 4 through 12 for next nine pairs.
Number 4 paired with numbers 5 through 12 for next eight pairs.
Number 5 paired with numbers 6 through 12 for next seven pairs.
Number 6 paired with numbers 7 through 12 for next six pairs.
Number 7 paired with numbers 8 through 12 for next five pairs.
Number 8 paired with numbers 9 through 12 for next four pairs.
Number 9 paired with numbers 10 through 12 for next three pairs.
Number 10 paired with numbers 11 through 12 for next two pairs.
Number 11 paired with number 12.

5.4.3 Special identification code (SPL). The special identification code should be the same conductor identification as specified in 5.4.2.

5.4.4 Twisted pair identification code. This code consists of numbers in sequence running from 1 through the number corresponding to the total quantity of twisted pairs in the cable. Both conductors in each pair must be numbered the same, denoting the sequence number of the pair. Distinction between the two conductors is provided by different colored insulation. Conductors of a cable with a single pair need not be numbered.

5.4.5 Twisted triad identification code. This code consists of numbers in sequence running from 1 through the number corresponding to the total quantity of twisted triads in the cable. Each of the three conductors must be numbered the same, denoting the sequence number of the triad. Distinction between the three conductors is provided by different colored insulation. Conductors of a cable with a single triad need not be numbered.

5.4.6 Letter identification code (LTR). The letter identification code consists of the letters A, B, C, and D printed in block type, and with black, white, red, and green ink, respectively.

5.4.7 Methods of applying identification.

5.4.7.1 Method 1. Identification method 1 consists of surface printing of both number and color designations. The legend should be printed in contrasting color: preferably white ink on black or dark background or black ink on white or light background. The legend is repeated at intervals not exceeding 3 inches. Alternate legends shall be inverted; for example:

10 ORANGE-BLACK 10

The character type should be block or italic and have a height in accordance with the diameter over which it is applied as follows:

MIL-HDBK-299(SH)
3 April 1989

<u>Diameter range (inch)</u>	<u>Height of character (inch, approximate)</u>
0.045 to 0.070	0.025
.070 to .095	1/32
.095 to .115	3/64
.115 to .200	1/16
.190 to .250	5/64
.235 to .375	3/32
.330 and larger	1/8

5.4.7.2 Method 2. Identification method 2 uses opaque white polyester tapes which have been printed with both the number and color designation prior to application. The legend should be printed with black ink, and be repeated at intervals not exceeding 3 inches. The character type should be block, and should be approximately 3/32-inch high.

5.4.7.3 Method 3. Identification method 3 uses solid colors or solid base colors with tracers, as required. The base color may be either the color of the insulation or the color of a coating applied to the insulation. The tracers should be approximately 1/32-inch wide ink stripes of the required color and should be applied helically with 1-1/2 plus or minus 1/4-inch lay. If two tracers are required, the second tracer must be half the width of the first tracer.

5.4.7.4 Method 4. Identification method 4 uses colored braids. Tracers should consist of the required colors applied by three adjacent carriers. Where two tracers are required, they must be applied with reverse lay.

5.4.7.5 Method 5. Identification method 5 uses the printed letter on the outermost insulating tape or the printed letter on a polyester binder tape over the insulating tapes. The letters should be approximately 3/16-inch high and have been printed at intervals not exceeding 3 inches prior to the application of the tape to the conductor. If the insulating tapes are white, no printing is required on the B (white) conductor.

5.4.7.6 Method 6. Identification method 6 consists of numerals printed in ink on the conductor insulation. For conductors having a jacket directly over the insulation, the numerals may be printed in ink on the jacket, at the manufacturer's option. White ink must be used for a red or black background; black ink must be used for a white background. Numeral width should be proportional to the conductor's outside diameter (od) as follows:

<u>Diameter range (inch)</u>	<u>Height of character (inch, approximate)</u>
0.045 to 0.095	0.025
.096 to .120	3/64
.121 to .175	1/16
.176 to .330	3/32
.331 and larger	1/8

3 April 1989

Numerical height should be two and one-half to three times numerical width. Each numeric legend should be underlined. Two-digit legends must have the bottom numeral underlined. Legends should be alternately inverted (see 5.4.7.1) and be repeated at intervals not greater than 1-1/2 inches.

5.4.8 Manufacturer's identification tape. Most cables and cords contain a continuous, thin, moisture-resistant marker tape, not less than 1/10-inch wide. Unless otherwise approved by the Naval Sea Systems Command (NAVSEA), the marker tape must be placed directly under the cable, cord binder tape, or jacket. The tape should be printed to show the following information at intervals not greater than 1 foot: name and location of manufacturer, year of manufacture, specification number (such as MIL-C-24643), and progressive serial number. The serial number is not necessarily a footage marker. A serial number must not be repeated by a manufacturer in any one year for any one type and size of cable or cord.

5.4.9 Year of manufacture. In order to facilitate storage and issue of cable on a first in, first out basis, cable reels, coils, and containers shipped by manufacturers must be marked to show the year of manufacture. Markings consist of a strip approximately 2-inches wide and colored as follows for the particular year of manufacture. These markings are repeated at 5-year intervals, as follows:

<u>Year of manufacture</u>	<u>Identifying color</u>
1979	Blue
1980	White
1981	Red
1982	Green
1983	Orange
1984	Blue
1985	White
1986	Red
1987	Green
1988	Orange
1989	Blue
1990	White
1991	Red
1992	Green
1993	Orange
1994	Blue
1995	White
1996	Red

TABLE I. MIL-C-24643 cable application data. 1/

Application	Cable type 2/	
	Non-flexing service	Repeated flexing service
General usage: For all portions of power, lighting, interior communication, weapons control and electronics systems, except where circuit parameters (such as audio or radio frequency, low-level microphone, synchro, scale voltage, and other types of signals) require special types of cable. Types LSMU, LS3U, LSDNW, LSTNW, LSFNW, LSMNW, LSSHOF, LSDHOF, LSTHOF, LSFHOF, LSMHOF, LSDCOP, LSTCOP, and LSMCOS should be used only for runs that are either totally within one compartment, or totally within two contiguous compartments. However, these type cables must not be used where a watertight deck or watertight bulkhead below flooding water level II (FWL-II) is penetrated. Type SG cable should be used for connections between the ship service generators and their respective switchboards and between sections of the ship service switchboards.	LSDNW LSTNW LSFNW LSMNW LSSHOF LSDHOF LSTHOF LSFHOF LSMHOF LSDCOP LSTCOP LSMCOS	LSSHOF LSDHOF LSTHOF LSFHOF LSMHOF LSDCOP LSTCOP LSMCOS
High voltage - 60 Hz: For 3000- and 5000-volt, three-phase power applications.	LS5KVTSGU	LSMSCU LSMU LS3U
Casualty power.		LSTHOF-42
400-Hz power: For 400-Hz service for static frequency changer cables, bus ties, and feeders where cable of lower impedance is required to reduce voltage drop.	LS6SGU	
Audio and telephone: For audio, telephone, call bell, announcing, and alarm systems. May also be used for other interior communication and weapons control systems, provided ampere rating of the cable and voltage drop for the system are not exceeded. Types LSTPNW and LSTTOP should be used only for runs that are either totally within one compartment, or totally within two contiguous compartments. However, this type cable should not be used where a watertight deck or watertight bulkhead below FWL-II is penetrated.	LSTPNW LSTTSU	LSTTOP

See footnotes at end of table.

MIL-HDBK-299(SH)
3 April 1989

TABLE I. MIL-C-24643 cable application data. 1/ - Continued

Application	Cable type 2/	
	Non-flexing service	Repeated flexing service
Radio	LSSRW LSDRW LSTRW	LSTTRS
Radio frequency: For application up to 2 megahertz (MHz). Maximum total copper operating temperature must not exceed 75°C.		
Degaussing	LSSSGU LSDSGU LSTSGU LSFSGU LS6SGU LSMDU LSMDY LSMSCU	
Thermocouple and pyrometer temperature range: Type TCTX, 125 to 260°C Type TCJX, 150 to 540°C Type TCKX, 260 to 870°C	LSTCTX LSTCJX LSTCKX LSTCJU LSTCTU LSPBTMU	
Shielded circuits: For combat systems, interior communications, lighting, and power circuits, where shielding of 400 Hz (that is, synchro, pulse, scale voltage) signals, or other signals is required. Where a watertight deck or bulkhead below FWL-II is to be penetrated, types LS1SMWU, LS2SWAU, LS1SWU, LS2SWU, LS2UW, LS2WAU, or LS3SWU should be used.	LS1SAU LS1SMU LS1SMUW LS1SWU LS1SU LS1S50MU LS1S75MU LS2AU LS2SJ LS2SWAU LS2SWU	LSTTRS

See footnotes at end of table.

MIL-HDBK-299(SH)
3 April 1989

TABLE I. MIL-C-24643 cable application data. 1/ - Continued

Application	Cable type 2/	
	Non-flexing service	Repeated flexing service
Shielded circuits (continued)	LS2SU LS2UW LS2WAU LS2U LS3SJ LS3SU LS3SWU LS4SJ LSMS	
Microphone circuits		LSMCOS LSMMOP

- 1/ The order of listing of cables for general applications data has no significant meaning for their usage.
 2/ Many cables are manufactured in variations of armored, unarmored, and unarmored with overall shielded (see 5.1). Armored cable is required to be used on all nuclear ships for propulsion plant and reactor compartments and is desirable in all other areas unless technically prohibited. The use of armored cable on non-nuclear ships is optional and to be determined by the overhaul shipyard, except armored cables shall not be installed in weather locations due to EMC considerations.

TABLE II. MIL-C-24640 cable application data. 1/

Application	Cable type 2/	
	Non-flexing service	Repeated flexing service
General usage: For all portions of power, lighting, interior communication, weapons control, and electronics systems, except where circuit parameters (such as, audio or radio frequency, low-level microphone, synchro, scale voltage, and other types of signals) require special types of cable. Types DX, TX, FX and MXO should be used only for runs that are either totally within one compartment, or totally within two contiguous compartments. However, these types of cable should not be used where a watertight deck or watertight bulkhead below FWL-II is penetrated.	DX TX FX DXW TXW FXW 7XW MXC MSCW	

See footnotes at end of table.

TABLE II. MIL-C-24640 cable application data. 1/ - Continued

Application	Cable type 2/	
	Non-flexing service	Repeated flexing service
Audio and telephone: For audio, telephone, call bell, announcing and alarm systems. May also be used for other interior communication and weapons control systems, provided ampere rating of the cable and voltage drop for the system are not exceeded. Type TTX should be used only for runs that are either totally within one compartment, or totally within two contiguous compartments. However, this type of cable should not be used where a watertight deck or watertight bulkhead below FWL-II is penetrated.	TTX TTXW	
Radio frequency: For applications up to two MHz. Maximum total copper operating temperature must not exceed 75°C.	TTXS	
Shielded circuits: For combat systems, interior communications, lighting, and power circuits where shielding of 400-Hz (synchro, pulse, scale voltage, and so forth) signals or other signals is required. Types 1XSOW, 2XSAW, 2XSW, 2XOW, and 3XSW must be used where a watertight deck or bulkhead below FWL-II is to be penetrated.	2XA0 1XMSO 2XS MXSO 3XS 2XO 2XSO 1XSOW 2XSAW 2XSW 2XOW 3XSW	

- 1/ The order of listing of cables for general applications data has no significant meaning for their usage.
- 2/ Many cables are manufactured in variations of armored, unarmored, and unarmored with overall shielding (see 5.2). Armored cable is required to be used on all nuclear ships for propulsion plant and reactor compartments and is desirable in all other areas unless technically prohibited. The use of armored cable on non-nuclear ships is optional and to be determined by the overhaul shipyard, except armored cables shall not be installed in weather locations due to EMC considerations.

TABLE III. MIL-C-915 cable application data. 1/

Application	Cable type 2/	
	Non-flexing service	Repeated flexing service
Outboard submersible: For hydrophones, transducers, outboard dial telephones, retractable antennae and similar equipment. Types MWF, 1SWF, and 2SWF are for hydrophones, transducers, and telephone lines in the weather. Types 1PR-A20E, 1PR-16, 7PR-16, 3PR-16, 1Q-16, ITR-16, and 7SPR-16S are only for submarine outboard use.	MSPW TSPA 1PR-A20E 1PR-16 7PR-16 2SPR-16 3PR-16 1Q-16 ITR-16 7SPR-16S	MSP TSP 5S5 S2S DSS FSS TSS MWF DSWS MCSF 1SWF 2SWF TPUM
Welding electrode circuit		TRF TRXF
Shore-to-ship power		THOF-400 THOF-500
Diver's line and telephone 400-Hz aircraft servicing DC aircraft servicing		DLT CVSF-4 JAS-250

- 1/ The order of listing of cables for general application data has no significant meaning for their usage.
 2/ Many cables are manufactured in variations of armored, unarmored, and unarmored with overall shielding (see 5.3).

TABLE IV. Commercial cable application data. 1/

Application	Cable type repeated flexing service
Cords for portable tools and equipment: For power supply to electric typewriters, office machines, electric drills, sanders, portable extension lights, and similar equipment. Safety ground conductors must be green.	Underwriters approved S, SO, ST, SJ, SJO, SJT

- 1/ The order of listing of cables for general application data has no significant meaning for their usage.

TABLE V. Supersession data.

Previous or present type, and applicable MIL-C-915 specification sheet number	Present type, and applicable specification sheet number	Obsolete type, and detail specification number
CVSF-4...../1	CVSF-4.....MIL-C-915/1	None
CVSF-4...../1	LSCVSF-4.....MIL-C-24643/1	None
DCOP...../3	LSDCOP.....MIL-C-24643/2	None
DHOF...../6	LSDHOF.....MIL-C-24643/3	None
DLT...../5	DLT.....MIL-C-915/5	None
DNW/A...../68	LSDNW/A.....MIL-C-24643/48	None
DPS...../40	LSDPDS.....MIL-C-24643/26	DPS.....MIL-C-23206/3
DRW/A...../73	LSDRW/A.....MIL-C-24643/53	DHRF.....MIL-C-915/4
DSGU/A...../29	LSDSGU/A.....MIL-C-24643/15	DSGA.....MIL-C-2194/2
DSGU/A...../29	LSDSGU/A.....MIL-C-24643/15	DHFRA.....MIL-C-2194/2
DSS...../8	DSS.....MIL-C-915/8	None
DSWS...../7	DSWS.....MIL-C-915/7	None
ECM/A...../54	LSECM/A.....MIL-C-24643/38	ECM.....MIL-C-24145/14
FHOF...../6	LSFHOF.....MIL-C-24643/63	None
FNW/A...../70	LSFNW/A.....MIL-C-24643/50	None
FPS...../40	LSFPS.....MIL-C-24643/26	FPS.....MIL-C-23206/3
FSGU/A...../31	LSFSCU/A.....MIL-C-24643/17	FSGA.....MIL-C-2194/4
FSGU/A...../31	LSFSGU/A.....MIL-C-24643/17	FHFA.....MIL-C-2194/4
FPS...../40	LSFPS.....MIL-C-24643/26	None
FSS...../8	FSS.....MIL-C-915/8	None
JAS...../9	JAS.....MIL-C-915/9	None
MCOS...../11	LSMCOS.....MIL-C-24643/4	None
MCSF...../10	MCSS.....MIL-C-915/10	None
MDU...../12	LSMDU.....MIL-C-24643/5	None
MDY...../13	LSMDY.....MIL-C-24643/6	None
MHOF...../14	LSMHOF.....MIL-C-24643/7	MHFF.....MIL-C-915
MMOP...../15	LSMMOP.....MIL-C-24643/8	None
MNW/A...../71	LSMNW/A.....MIL-C-24643/51	MNW.....MIL-C-915/71
MRI-D...../16	LSMRI-D.....MIL-C-24643/9	None
MRI-T...../16	LSMRI-T.....MIL-C-24643/9	
MS/A...../50	LSMS/A.....MIL-C-24643/34	MS.....MIL-C-24145/10
MS/A...../50	LSMS/A.....MIL-C-24643/34	MA.....MIL-C-24145/10

MIL-HDBK-299(SH)
3 April 1989

TABLE V. Supersession data. - Continued

Previous or present type, and applicable MIL-C-915 specification sheet number	Present type, and applicable specification sheet number	Obsolete type, and detail specification number
MSCU/A/S...../32	LSMSCU/A/S.....MIL-C-24643/18	MSCA.....MIL-C-2194/5
MSCU/A/S...../32	LSMSCU/A/S.....MIL-C-24643/18	MHFA.....MIL-C-2194/5
MSP...../67	MSP.....MIL-C-915/67	None
MSPW...../66	MSPW.....MIL-C-915/66	None
MU/A/S...../43	LSMU/A/S.....MIL-C-24643/29	MA.....MIL-C-24145/3
MWF...../58	MWF.....MIL-C-915/58	MWF.....MIL-C-24145/18
PBTM...../17	LSPBTM.....MIL-C-24643/10	None
PBTMU...../17	LSPBTMU.....MIL-C-24643/10	None
PI...../39	LSPI.....MIL-C-24643/25	PI.....MIL-C-23206/2
SHOF...../6	LSSHOF.....MIL-C-24643/3	None
SRW/A...../73	LSSRW/A.....MIL-C-24643/53	SHFR.....MIL-C-915/4
SSF...../18	LSSSF.....MIL-C-24643/11	None
SSGU/A...../28	LSSSGU/A.....MIL-C-24643/14	SHGA.....MIL-C-2194/1
SSGU/A...../28	LSSSGU/A.....MIL-C-24643/14	SSGA.....MIL-C-2194/1
S2S...../61	S2S.....MIL-C-915/61	S2S.....MIL-C-24145/21
TCJU/A...../35	LSTCJU/A.....MIL-C-24643/21	TCJA.....MIL-C-2194/10
TCJX...../38	LSTCJX.....MIL-C-24643/24	TCJX.....MIL-C-23206/1
TCKX...../38	LSTCKX.....MIL-C-24643/24	TCKX.....MIL-C-23206/1
TCOP...../3	LSTCOP.....MIL-C-24643/2	None
TCTU/A...../35	LSTCTU/A.....MIL-C-24643/21	TCTA.....MIL-C-2194/10
TCTU/A...../35	LSTCTU/A.....MIL-C-24643/21	PBTX.....MIL-C-915
TCTX...../38	LSTCTX.....MIL-C-24643/24	TCTX.....MIL-C-23206/1
THOF...../6	LSTHOF.....MIL-C-24643/3	None
THOF-42...../6	THOF-42.....MIL-C-915/6	None
THOF-400...../6	THOF-400.....MIL-C-915/6	None
THOF-500...../6	THOF-500.....MIL-C-915/6	
TNW/A...../69	LSTNW/A.....MIL-C-24643/49	TNW.....MIL-C-915/69
TPNW/A...../72	LSTPNW/A.....MIL-C-24643/52	None
TPS...../40	LSTPS.....MIL-C-24643/26	TPS.....MIL-C-23206/3
TPUM-6...../79	TPUM-6.....MIL-C-915/79	TPU.....MIL-C-915/19
TRF...../20	TRF.....MIL-C-915/20	None
TRW/A...../73	LSTRW/A.....MIL-C-24643/53	THFR.....MIL-C-915/9
TRXF...../21	TRXF.....MIL-C-915/21	None

MIL-HDBK-299 (SH)
3 April 1989

TABLE V. Supersession data. - Continued

Previous or present type, and applicable MIL-C-915 specification sheet number	Present type, and applicable specification sheet number	Obsolete type, and detail specification number
TSGU/A...../30	LSTSGU/A.....MIL-C-24643/16	THFA.....MIL-C-2194/3
TSGU/A...../30	LSTSGU/A.....MIL-C-24643/16	TSGA.....MIL-C-2194/3
TSP/A...../22	TSP/A.....MIL-C-915/21	TSP.....MIL-C-915/22
TSS...../8	TSS.....MIL-C-915/8	None
TTOP...../24	LSTTOP.....MIL-C-24643/12	None
TTRS/A...../25	LSTTRS/A.....MIL-C-24643/13	TTRS.....MIL-C-915/25
TTSU/A...../37	LSTTSU/A.....MIL-C-24643/23	TTSA.....MIL-C-2194/12
TTSU/A...../37	LSTTSU/A.....MIL-C-24643/23	TTHFWA....MIL-C-915/23
1SA/U...../57	LS1SA/U.....MIL-C-24643/41	1SA.....MIL-C-24145/17
1SMU/A...../56	LS1SMU/A.....MIL-C-24643/40	1SMU.....MIL-C-24145/10
1SMWU/A...../65	LS1SMWU/A.....MIL-C-24643/47	1SMWA....MIL-C-24145/2
1SU/A...../59	LS1SU/A.....MIL-C-24643/42	1SU.....MIL-C-24145/1
1SWF...../47	1SWF.....MIL-C-915/47	1SWF.....MIL-C-24145/7
1SWU/A...../44	LS1SWU/A.....MIL-C-24643/30	1SWA.....MIL-C-24145/4
1S50MU/A/S...../42	LS1S50MU/A/S.....MIL-C-24643/28	1S50MA....MIL-C-24145/2
1S75MU/A...../55	LS1S75MU/A.....MIL-C-24643/39	1S75MA....MIL-C-24145/15
2AU/A/S...../41	LS2AU/A/S.....MIL-C-24643/27	2A.....MIL-C-24145/1
2CS...../80	LS2CS.....MIL-C-24643/58	None
2SJ/A...../60	LS2SJ/A.....MIL-C-24643/43	DBSP.....MIL-C-915/2
2SU/A/S...../45	LS2SU/A/S.....MIL-C-24643/31	None
2SWA/U...../46	LS2SWA/U.....MIL-C-24643/32	2SWA.....MIL-C-24145/6
2SWF...../48	2SWF.....MIL-C-915/48	2SWF.....MIL-C-24145/8
2SWL/A...../77	LS2SWL/A.....MIL-C-24643/56	None
2SWU/A...../49	LS2SWU/A.....MIL-C-24643/33	2SWU.....MIL-C-24145/9
2U/A...../63	LS2U/A.....MIL-C-24643/45	2U.....MIL-C-24145/23
2UW/A/S...../78	LS2UW/A/S.....MIL-C-24643/57	None
2WAU/A...../64	LS2WAU/A.....MIL-C-24643/46	2WA.....MIL-C-24145/24
3SF...../62	LS3SF.....MIL-C-24643/44	3SF.....MIL-C-24145/22
3SJ/A...../60	LS3SJ/A.....MIL-C-24643/43	TBSP.....MIL-C-915/2
3SJ/A...../60	LS3SU/A/S.....MIL-C-24643/35	3SJ.....MIL-C-24145/20
3SU/A/S...../51	LS3SWU/A/S.....MIL-C-24643/36	3SA.....MIL-C-21145/11
3SWU/A/S...../52		3SWA.....MIL-C-24145/12

MIL-HDBK-299 (SH)
3 April 1989

TABLE V. Supersession data. - Continued

Previous or present type, and applicable MIL-C-915 specification sheet number	Present type, and applicable specification sheet number	Obsolete type, and detail specification number
3U/A...../53	LS3U/A.....MIL-C-24643/37	3U.....MIL-C-24145/13
4NW8/A...../76	LS4NW8/A.....MIL-C-24643/55	None
4SJ/A...../60	LS4SJ/A.....MIL-C-24643/43	FBSP.....MIL-C-915/2
4SJ/A...../60	LS4SJ/A.....MIL-C-24643/43	4SJ.....MIL-C-24145/20
5KVTSGU/A...../36	LS5KVTSGU/A.....MIL-C-24643/22	5KVTSGA...MIL-C-2194/11
5SS...../74	5SS.....MIL-C-915/74	None
6SGU/A...../33	LS6SGU/A.....MIL-C-24643/19	6SGA.....MIL-C-2194/6
7PS...../40	LS7PS.....MIL-C-24643/26	7PS.....MIL-C-23206/3
7SGU/A...../34	LS7SGU/A.....MIL-C-24643/20	7SGA.....MIL-C-2194/9
7SS...../8	7SS.....MIL-C-915/8	None
8NW6/A...../75	LS8NW6/A.....MIL-C-24643/54	None

MIL-HDBK-299(SH)
3 April 1989

5.5 Brief explanation of cable ratings and characteristics tables.

5.5.1 First five columns. Each cable is identified by the Military specification and specification sheet number in the left hand column, followed by the type designation, conductor size (AWG or MCM), number of conductors, and conductor cross sectional area (circular mils).

5.5.2 Overall diameter. The "overall diameter" is the overall measurement of the finished cable, and should be the determining dimension in selecting the proper deck or bulkhead stuffing tube size, or multi-cable transit inserts. This diameter is also the determining dimension for stuffing tubes for equipment.

5.5.3 Rated voltage, ampacity, and minimum radius of bend. Electrical characteristics are given under columns headed "Rated voltage" and "Ampacity". "Minimum radius of bend", which is approximately eight times the overall diameter, is also given. Cables must not be used in excess of these ratings.

5.5.4 Conductor identification. The letters in the conductor identification column represent the identification, and the number represents the method of applying the identification. For example, STD-1 means standard identification applied by method 1, which is printing of the number and color designation on the outer surface of the insulation or jacket of each conductor. TEL-3 means telephone identification applied by method 3, which is colored insulation on each conductor. The abbreviations used are as follows:

STD - Standard identification code
TEL - Telephone identification code
SPL - Special identification code
LTR - Letter identification code

5.6 Cable classification (MIL-C-24643). Cables specified in MIL-C-24643 are listed in table VI under the following general classifications:

- (a) Watertight (with circuit integrity), non-flexing service:
 - (1) Power and lighting.
 - (2) Control.
 - (3) Electronic, communication, and instrumentation.
- (b) Watertight, non-flexing service:
 - (1) Power and lighting.
 - (2) Electronic, communication, and instrumentation.
- (c) Non-watertight (with circuit integrity), non-flexing service:
 - (1) Electronic, communication, and instrumentation.

3 April 1989

(d) Non-watertight, non-flexing service:

- (1) Power and lighting.
- (2) Control.
- (3) Electronic, communication, and instrumentation.

(e) Non-watertight, flexing service:

- (1) Power and lighting.
- (2) Control.
- (3) Electronic, communication, and instrumentation.

TABLE VI (a)(1). MIL-C-24643 cable ratings and characteristics, watertight
 (with circuit integrity), non-flexing service,
 (power, and lighting).

MIL-C-	Cable type designation	Conductor size: AWG or MCM	Number of conductors in cable	Area of each conductor (MCM)	Cable overall diameter max. (inches)	Cable weight per ft approx (lbs)	Radius of bend min. (inches)	CDR ID	Rated voltage, max. (RMS)	Ampacity, each conductor (amps. max.)				NSN 6145-01	
										dc or 60 Hz		400 Hz			
										40°C Ambient	50°C Ambient	40°C Ambient	50°C Ambient		
24643/19	LS6SGA-100	0	6	105.600	1.650	2.919	10.0	LTR-5	1000	136	127	272	250	203-0370	
	LS6SGA-125	00	6	133.100	1.840	3.600	11.5	LTR-5	1000	160	147	299	275	201-9513	
	LS6SGA-150	000	6	167.800	2.010	4.468	12.0	LTR-5	1000	188	173	326	300	201-9514	
	LS6SGA-200	0000	6	211.600	2.250	5.613	13.5	LTR-5	1000	219	202	369	340	201-9515	
24643/19	LS6SGU-100	0	6	105.600	1.600	2.820	10.0	LTR-5	1000	136	127	272	250	201-9511	
	LS6SGU-125	00	6	133.100	1.790	3.490	11.5	LTR-5	1000	160	147	299	275	201-9512	
	LS6SGU-150	000	6	167.800	1.960	4.339	12.0	LTR-5	1000	188	173	326	300	203-2370	
	LS6SGU-200	0000	6	211.600	2.200	5.479	13.5	LTR-5	1000	219	202	369	340	203-0369	
24643/26	LSTPS-	6	12	6.530	0.775	0.361	4.5	STD-4	600	35/20 ^{1/2}	—	—	—	#811-8376 ^{4/}	
24643/20	LSTSGA-3	16	7	2.580	.595	.177	4.0	STD-1	1000	15/11	14/10 ^{1/2}	15/11 ^{1/2}	14/10 ^{1/2}	201-9518	
	LSTSGA-4	14	7	4.110	.645	.231	4.0	STD-1	1000	26/14	24/13	26/14	24/13	201-9519	
24643/20	LSTSGU-3	16	7	2.580	.545	.152	4.0	STD-1	1000	15/11	14/10	15/11	14/10	201-9516	
	LSTSGU-4	14	7	4.110	.595	.198	4.0	STD-1	1000	26/14	24/13	26/14	24/13	201-9517	
24643/26	LSDPS-3	16	2	2.580	.455	.121	3.0	STD-4	600	10	—	10	—	156-9511	
	LSDPS-4	14	2	4.110	.489	.141	3.0	STD-4	600	20	—	20	—	#977-6159 ^{4/}	
	LSDPS-6	12	2	6.530	.585	.194	3.5	STD-4	600	28	—	28	—	158-2118	
	LSDPS-9	10	2	10.380	.628	.232	4.0	STD-4	600	41	—	41	—	#542-6699 ^{4/}	
	LSDPS-14	9	2	13.090	.730	.323	4.5	STD-4	600	54	—	54	—	154-4372	
24643/15	LSDSGA-3	16	2	2.580	.441	.109	3.0	STD-1	1000	13	12	13	12	202-9501	
	LSDSGA-4	14	2	4.110	.477	.133	3.0	STD-1	1000	22	20	22	20	203-0367	
	LSDSGA-9	10	2	10.380	.594	.230	4.0	STD-1	1000	44	41	44	41	202-9502	
	LSDSGA-14	9	2	13.090	.720	.297	4.0	STD-1 ^{3/}	1000	60	55	60	55	202-9503	
	LSDSGA-23	7	2	20.820	.831	.410	5.0	STD-1 ^{3/}	1000	78	72	78	72	202-9504	
	LSDSGA-50	3	2	52.620	.961	.740	6.0	LTR-5	1000	126	116	126	116	204-4855	
	LSDSGA-75	1	2	83.690	1.124	1.086	7.0	LTR-5	1000	168	155	168	155	210-2343	
	LSDSGA-100	0	2	105.600	1.217	1.289	7.5	LTR-5	1000	199	183	199	183	204-4856	
	LSDSGA-200	0000	2	211.600	1.633	2.458	10.0	LTR-5	1000	308	284	288	266	204-4857	
	LSDSGA-300	300	2	300.000	1.891	3.326	11.5	LTR-5	1000	413	380	347	319	204-4858	
	LSDSGA-400	400	2	413.600	2.119	4.408	13.0	LTR-5	1000	492	453	337	310	203-0368	

See footnotes at end of table.

TABLE VI (a)(1). MIL-C-24643 Cable ratings and characteristics, watertight
(with circuit integrity), non-flexing service,
(power and lighting). - Continued.

MIL-C.	Cable type designation	Conductor size: AWG or MCM	Number of conductors in cable	Area of each conductor (MCM)	Cable overall diameter max. (inches)	Cable weight per ft approx (lbs)	Radius of bend min. (inches)	CDR ID	Rated voltage, max. (RMS)	Ampacity, each conductor (amps. max)				NSN 6145-01	
										dc or 60 Hz		400 Hz			
										40°C Ambient	50°C Ambient	40°C Ambient	50°C Ambient		
24643/15	LSDSGU-3	16	2	2.580	.391	0.086	3.0	STD-1	1000	13	12	13	12	202-8463	
	LSDSGU-4	14	2	4.110	.427	.106	3.0	STD-1	1000	22	20	22	20	202-2795	
	LSDSGU-9	10	2	10.380	.544	.194	4.0	STD-1	1000	44	41	44	41	202-2796	
	LSDSGU-14	9	2	13.090	.670	.259	4.0	STD-1	1000	60	55	60	55	202-2797	
	LSDSGU-23	7	2	20.820	.781	.363	5.0	STD-12/	1000	78	72	78	72	202-2798	
	LSDSGU-50	3	2	52.620	.911	.681	6.0	LTR-5	1000	126	116	126	116	202-3476	
	LSDSGU-75	1	2	83.690	1.074	1.018	7.0	LTR-5	1000	168	155	168	155	202-3477	
	LSDSGU-100	0	2	105.600	1.167	1.217	7.5	LTR-5	1000	199	183	199	183	202-3390	
	LSDSGU-200	0000	2	211.600	1.583	2.360	10.0	LTR-5	1000	308	284	288	266	202-3628	
	LSDSGU-300	300	2	300.000	1.841	3.213	11.5	LTR-5	1000	413	380	347	319	202-3391	
	LSDSGU-400	400	2	413.600	2.069	4.282	13.0	LTR-5	1000	492	453	337	310	202-8464	
24643/26	LSFPS-	14	9	13.090	0.815	0.452	5.0	STD-4	600	42	—	—	—	156-8790	
24643/17	LSFSGA-3	16	4	2.580	.497	.154	3.0	STD-1	1000	11	10	11	10	202-3481	
	LSFSGA-4	14	4	4.110	.563	.204	3.5	STD-1	1000	18	17	18	17	202-3482	
	LSFSGA-9	10	4	10.380	.680	.336	4.5	STD-1	1000	39	36	39	36	202-3483	
	LSFSGA-23	7	4	20.820	.940	.517	5.5	STD-12/	1000	69	64	69	64	202-3484	
	LSFSGA-50	3	4	52.620	1.100	1.076	6.5	LTR-5	1000	110	101	110	101	202-3299	
	LSFSGA-75	1	4	83.690	1.290	1.289	8.0	LTR-5	1000	148	136	148	136	202-3485	
	LSFSGA-100	0	4	105.600	1.408	1.412	8.5	LTR-5	1000	174	160	170	157	202-8463	
	LSFSGA-150	000	4	167.800	1.675	3.188	10.0	LTR-5	1000	235	216	224	206	202-8466	
	LSFSGA-200	0000	4	211.600	1.870	3.922	11.0	LTR-5	1000	271	250	254	234	202-3511	
24643/17	LSFSGU-3	16	4	2.580	0.447	0.126	3.0	STD-1	1000	11	10	11	10	202-3509	
	LSFSGU-4	14	4	4.110	.513	.172	3.5	STD-1	1000	18	17	18	17	210-2344	
	LSFSGU-9	10	4	10.380	.630	.296	4.5	STD-1	1000	39	36	39	36	202-3510	
	LSFSGU-23	7	4	20.820	.890	.460	5.5	STD-12/	1000	69	64	69	64	202-3479	
	LSFSGU-50	3	4	52.620	1.050	1.015	6.5	LTR-5	1000	110	101	110	101	202-3629	
	LSFSGU-75	1	4	83.690	1.240	1.486	8.0	LTR-5	1000	148	136	148	136	202-6953	
	LSFSGU-100	0	4	105.600	1.358	1.820	8.5	LTR-5	1000	174	160	170	157	202-6956	
	LSFSGU-150	000	4	167.800	1.625	3.105	10.0	LTR-5	1000	235	216	224	206	202-6957	
	LSFSGU-200	0000	4	211.600	1.820	3.819	11.0	LTR-5	1000	271	250	254	234	202-3480	
24643/14	LSSSGA-	50	3	1	52.620	.570	.316	3.5	—	1000	149	137	149	137	202-9492

See footnotes at end of table.

TABLE VI (a)(1). MIL-C-24643 cable ratings and characteristics, watertight
(with circuit integrity), non-flexing service,
(power and lighting). - Continued

MIL-C	Cable type designation	Conductor size: AWG or MCM	Number of conductors in cable	Area of each conductor (MCM)	Cable overall diameter max. (inches)	Cable weight per ft approx (lbs)	Radius of bend min. (inches)	CDR ID	Rated voltage, max (RMS)	Ampacity, each conductor (amps. max)				NSN 6145-01	
										dc or 60 Hz		400 Hz			
										40°C Ambient	50°C Ambient	40°C Ambient	50°C Ambient		
24643/14	LSSSGA-75	1	1	83.690	0.652	0.454	4.0	-	1000	197	181	197	181	202-9493	
	LSSSGA-100	0	1	103.600	.719	.550	4.5	-	1000	232	214	232	214	202-9494	
	LSSSGA-200	0000	1	211.600	.922	1.022	5.5	-	1000	361	332	-	-	202-9493	
	LSSSGA-300	300	1	300.000	1.051	1.369	6.5	-	1000	467	430	-	-	202-9496	
	LSSSGA-400	400	1	413.600	1.168	1.833	7.0	-	1000	575	530	-	-	202-9497	
	LSSSGA-650	650	1	650.000	1.421	2.801	8.5	-	1000	783	722	-	-	204-4854	
	LSSSGA-800	800	1	800.000	1.535	3.429	9.5	-	1000	940	865	-	-	202-9498	
	LSSSGA-1000	1000	1	1000.000	1.670	4.223	10.0	-	1000	1090	950	-	-	202-9499	
	LSSSGA-1600	1600	1	1600.000	2.060	6.489	12.5	-	1000	1450	1270	-	-	202-9500	
	LSSSGA-2000	2000	1	2000.000	2.260	7.753	13.5	-	1000	1630	1450	-	-	201-9496	
24643/14	LSSSGU-50	3	1	52.620	0.520	0.281	3.5	-	1000	149	137	149	137	203-5396	
	LSSSGU-75	1	1	83.690	.602	.414	4.0	-	1000	197	181	197	181	203-0379	
	LSSSGU-100	0	1	105.600	.669	.510	4.5	-	1000	232	214	232	214	205-3647	
	LSSSGU-200	0000	1	211.600	.872	.967	5.5	-	1000	361	332	-	-	202-8471	
	LSSSGU-300	300	1	300.000	1.001	1.309	6.5	-	1000	467	430	-	-	203-6376	
	LSSSGU-400	400	1	413.600	1.118	1.763	7.0	-	1000	575	530	-	-	206-2230	
	LSSSGU-650	650	1	650.000	1.371	2.716	8.5	-	1000	783	722	-	-	203-6377	
	LSSSGU-800	800	1	800.000	1.483	3.338	9.5	-	1000	940	865	-	-	204-2246	
	LSSSGU-1000	1000	1	1000.000	1.620	4.123	10.0	-	1000	1090	950	-	-	203-6378	
	LSSSGU-1600	1600	1	1600.000	2.010	6.368	12.5	-	1000	1450	1270	-	-	203-3648	
24643/26	LSTPS-3	16	3	2.580	0.475	0.129	3.0	STD-4	600	10	-	10	-	#088-9141 ^b	
	LSTPS-4	14	3	4.110	.553	.160	3.5	STD-4	600	17	-	17	-	159-6656	
	LSTPS-6	12	3	6.530	.620	.229	4.0	STD-4	600	23	-	23	-	153-6691 ^d	
	LSTPS-9	10	3	10.380	.657	.299	4.0	STD-4	600	36	-	36	-	#542-6700 ^d	
	LSTPS-14	9	3	13.090	.751	.411	4.5	STD-4	600	47	-	47	-	153-6692	
	LSTPS-23	7	3	20.820	.866	.579	5.5	STD-4	600	64	-	64	-	154-0989	
	LSTPS-30	5	3	33.090	.989	.738	6.0	STD-4	600	77	-	77	-	157-0923	
24643/16	LSTSGA-3	16	3	2.580	.461	.128	3.0	STD-1	1000	11	10	11	10	202-0678	
	LSTSGA-4	14	3	4.410	.499	.156	3.0	STD-1	1000	18	17	18	17	202-0679	
	LSTSGA-9	10	3	10.380	.625	.278	4.0	STD-1	1000	39	36	39	36	202-0680	
	LSTSGA-14	9	3	13.090	.768	.356	4.5	STD-1	1000	51	47	51	47	202-0681	
	LSTSGA-23	7	3	20.820	.862	.492	5.0	STD-1	1000	69	64	69	64	202-0682	

See footnotes at end of table.

TABLE VI (a)(1). MIL-C-24643 cable ratings and characteristics, watertight
 (with circuit integrity), non-flexing service,
 (power and lighting). - Continued

MIL-C-	Cable type designation	Conductor size: AWG or MCM	Number of conductors in cable	Area of each conductor (MCM)	Cable overall diameter max. (inches)	Cable weight per ft approx (lbs)	Radius of bend min. (inches)	CDR ID	Rated voltage, max (RMS)	Ampacity, each conductor (amps, max)				NSN 6143-01	
										dc or 60 Hz		400 Hz			
										40°C Ambient	50°C Ambient	40°C Ambient	50°C Ambient		
24643/16	LSTSGA- 50	3	3	52.620	1.019	0.947	6.5	STD-1	1000	110	101	110	101	202-0683	
	LSTSGA- 75	1	3	83.690	1.184	1.388	7.5	STD-1	1000	148	136	148	136	203-4030	
	LSTSGA- 100	0	3	105.600	1.316	1.696	8.0	STD-1	1000	174	160	174	160	202-0684	
	LSTSGA- 150	000	3	167.800	1.565	2.358	9.5	STD-1	1000	235	216	224	206	202-0685	
	LSTSOA- 200	0000	3	211.600	1.719	3.197	10.5	STD-1	1000	271	250	254	234	202-0686	
	LSTSGA- 300	300	3	300.000	2.007	4.356	12.0	STD-1	1000	348	320	291	269	202-0687	
	LSTSGA- 400	400	3	413.600	2.233	5.829	13.5	STD-1	1000	435	400	398	274	202-0688	
24643/16	LSTSGU- 3	16	3	25.80	0.411	0.099	3.0	STD-1	1000	11	10	11	10	201-9497	
	LSTSGU- 4	14	3	41.10	.449	.125	4.0	STD-1	1000	18	17	18	17	201-9498	
	LSTSGU- 9	10	3	10.380	.375	.241	4.0	STD-1	1000	39	36	39	36	201-9499	
	LSTSGU- 14	9	3	13.090	.718	.313	4.5	STD-1	1000	51	47	51	47	202-3478	
	LSTSGU- 23	7	3	20.820	.812	.443	5.0	STD-1	1000	69	64	69	64	201-9500	
	LSTSGU- 50	3	3	52.620	.969	.886	6.5	STD-1	1000	110	101	110	101	201-9053	
	LSTSGU- 75	1	3	83.690	1.134	1.313	7.5	STD-1	1000	148	136	148	136	201-9501	
	LSTSGU- 100	0	3	103.600	1.266	1.618	8.0	STD-1	1000	174	160	174	160	201-9502	
	LSTSGU- 150	000	3	167.800	1.515	2.465	9.5	STD-1	1000	235	216	224	206	202-9503	
	LSTSGU- 200	0000	3	211.600	1.669	3.086	10.5	STD-1	1000	271	250	254	234	202-0676	
	LSTSGU- 300	300	3	300.000	1.957	4.237	12.0	STD-1	1000	348	320	291	269	202-0677	
	LSTSGU- 400	400	3	413.600	2.203	5.695	13.5	STD-1	1000	435	400	398	274	202-9506	
24643/21	LSSKVTSQA- 100	0	3	105.600	1.790	2.417	11.8	LTR-3	5000	174	160	-	-	201-6514	
	LSSKVTSQA- 150	000	3	167.800	2.000	3.073	13.0	LTR-3	5000	235	216	-	-	201-6515	
	LSSKVTSQA- 250	250	3	250.000	2.270	4.429	14.5	LTR-3	5000	315	290	-	-	201-9054	
	LSSKVTSQA- 350	350	3	350.000	2.500	5.562	15.9	LTR-3	5000	391	360	-	-	201-9055	
	LSSKVTSQA- 400	400	3	413.600	2.650	6.551	16.5	LTR-3	5000	435	400	-	-	202-2050	
24643/23	LSSKVTSGU- 100	0	3	105.600	1.740	2.310	11.8	LTR-3	5000	174	160	-	-	201-6510	
	LSSKVTSGU- 150	000	3	167.800	1.950	2.964	13.0	LTR-3	5000	235	216	-	-	203-6566	
	LSSKVTSGU- 250	250	3	250.000	2.220	4.294	14.5	LTR-3	5000	315	290	-	-	201-6511	
	LSSKVTSGU- 350	350	3	350.000	2.450	5.417	15.9	LTR-3	5000	391	360	-	-	201-6512	
	LSSKVTSGU- 400	400	3	413.600	2.600	6.190	16.5	LTR-3	5000	435	400	-	-	201-6513	

See footnotes at end of table.

TABLE VI (a)(2). MIL-C-24643 cable ratings and characteristics, watertight
 (with circuit integrity), non-flexing service,
 (control). - Continued

MIL-C-	Cable type designation	Conductor size: AWG or MCM	Number of conductors in cable	Area of each conductor (MCM)	Cable overall diameter max. (inches)	Cable weight per ft approx (lbs)	Radius of bend min. (inches)	CDR ID	Rated voltage, max. (RMS)	Ampacity, each conductor (amps. max.)				NSN 6145-01	
										dc or 60 Hz		400 Hz			
										40°C Ambient	50°C Ambient	40°C Ambient	50°C Ambient		
24643/18	LSMSCA- 7	18	7	1.620	0.534	0.176	3.5	STD-1	1000	12/8 ^{1/}	9/6 ^{1/}	12/8 ^{1/}	9/6 ^{1/}	202-2046	
	LSMSCA- 10	18	10	1.620	.672	.267	4.0	STD-1	1000	12/8	9/6	12/8	9/6	202-2047	
	LSMSCA- 14	18	14	1.620	.718	.324	4.5	STD-1	1000	12/8	9/6	12/8	9/6	202-2048	
	LSMSCA- 19	18	19	1.620	.788	.401	5.0	STD-1	1000	12/8	9/6	12/8	9/6	202-2049	
	LSMSCA- 24	18	24	1.620	.905	.522	5.5	STD-1	1000	12/6	9/5	12/6	9/5	203-5392	
	LSMSCA- 30	18	30	1.620	.951	.596	5.5	STD-1	1000	12/6	9/5	12/6	9/5	205-3630	
	LSMSCA- 37	18	37	1.620	1.035	.707	6.0	STD-1	1000	12/6	9/5	12/6	9/5	205-3631	
	LSMSCA- 44	18	44	1.620	1.164	.861	7.0	STD-1	1000	12/5	9/4	12/5	9/4	201-9506	
	LSMSCA- 61	18	61	1.620	1.300	1.058	8.0	STD-1	1000	12/4	9/3	12/4	9/3	201-9507	
	LSMSCA- 91	18	91	1.620	1.530	1.600	9.0	STD-1	1000	12/4	9/3	12/4	9/3	201-9508	
24643/18	LSMSCS- 7	18	7	1.620	0.544	0.244	6.5	STD-1	1000	12/8	9/6	12/8	9/6	201-9509	
	LSMSCS- 10	18	10	1.620	.682	.349	8.5	STD-1	1000	12/8	9/6	12/8	9/6	201-3486	
	LSMSCS- 14	18	14	1.620	.728	.403	9.0	STD-1	1000	12/8	9/6	12/8	9/6	202-6960	
	LSMSCS- 19	18	19	1.620	.798	.509	9.5	STD-1	1000	12/8	9/6	12/8	9/6	202-6961	
	LSMSCS- 24	18	24	1.620	.915	.630	11.5	STD-1	1000	12/6	9/5	12/6	9/5	202-6962	
	LSMSCS- 30	18	30	1.620	.961	.727	12.0	STD-1	1000	12/6	9/5	12/6	9/5	202-6963	
	LSMSCS- 37	18	37	1.620	1.065	.810	13.0	STD-1	1000	12/6	9/5	12/6	9/5	202-6964	
	LSMSCS- 44	18	44	1.620	1.174	.991	14.0	STD-1	1000	12/5	9/4	12/5	9/4	201-9510	
	LSMSCS- 61	18	61	1.620	1.310	1.227	16.0	STD-1	1000	12/4	9/3	12/4	9/3	202-6965	
	LSMSCS- 91	18	91	1.620	1.540	1.887	18.5	STD-1	1000	12/4	9/3	12/4	9/3	202-6966	
24643/18	LSMSCU- 7	18	7	1.620	0.484	0.148	3.5	STD-1	1000	12/8	9/6	12/8	9/6	202-2041	
	LSMSCU- 10	18	10	1.620	.622	.227	4.0	STD-1	1000	12/8	9/6	12/8	9/6	201-9503	
	LSMSCU- 14	18	14	1.620	.668	.280	4.5	STD-1	1000	12/8	9/6	12/8	9/6	201-9504	
	LSMSCU- 19	18	19	1.620	.738	.354	5.0	STD-1	1000	12/8	9/6	12/8	9/6	201-9505	
	LSMSCU- 24	18	24	1.620	.855	.467	5.5	STD-1	1000	12/6	9/5	12/6	9/5	202-6958	
	LSMSCU- 30	18	30	1.620	.901	.539	5.5	STD-1	1000	12/6	9/5	12/6	9/5	202-6959	
	LSMSCU- 37	18	37	1.620	1.002	.648	6.0	STD-1	1000	12/6	9/5	12/6	9/5	202-2042	
	LSMSCU- 44	18	44	1.620	1.114	.793	7.0	STD-1	1000	12/5	9/4	12/5	9/4	202-2043	
	LSMSCU- 61	18	61	1.620	1.250	.982	8.0	STD-1	1000	12/4	9/3	12/4	9/3	202-2044	
	LSMSCU- 91	18	91	1.620	1.480	1.510	9.0	STD-1	1000	12/4	9/3	12/4	9/3	202-2045	

See footnotes at end of table.

MIL-HDBK-299 (SH)
 3 April 1989

TABLE VI (a)(3). MIL-C-24643 cable ratings and characteristics, watertight (with circuit integrity), non-flexing service, (electronic, communication, and instrumentation). - Continued

MIL-C-	Cable type designation	Conductor size: AWG or MCM	Number of conductors in cable	Area of each conductor (MCM)	Cable overall diameter max. (inches)	Cable weight per ft approx (lbs)	Radius of bend min. (inches)	CDR ID	Rated voltage, max. (RMS)	Ampacity, each conductor (amps, max)				NSN 6143-01	
										dc or 60 Hz		400 Hz			
										40°C Ambient	50°C Ambient	40°C Ambient	50°C Ambient		
24643/21	LSTCJA-	4	14	2	4.110	0.480	0.136	3.0	---	—	—	—	—	203-6565	
24643/21	LSTCJU-	4	14	2	4.110	.430	.117	3.0	—	—	—	—	—	201-9520	
24643/24	LSTCJX-	3	16	6	2.828	.742	.231	4.0	—	—	—	—	—	#977-6160 4/ 157-2037 #931-8420 4/	
	LSTCJX-	7	16	14	2.828	.983	.515	5.5	—	—	—	—	—		
	LSTCJX-	12	16	24	2.828	1.269	.844	6.5	—	—	—	—	—		
24643/24	LSTCKX-	1	16	2	2.828	0.456	.108	2.5	—	—	—	—	—	#598-9397 4/ #948-4135 4/ #901-6242 4/ #542-6703 4/	
	LSTCKX-	3	16	6	2.828	.742	.257	4.0	—	—	—	—	—		
	LSTCKX-	7	16	14	2.828	.983	.520	5.5	—	—	—	—	—		
	LSTCKX-	12	16	24	2.828	1.269	.844	6.5	—	—	—	—	—		
24643/21	LSTCTA-	4	14	2	4.110	0.480	.136	3.0	—	—	—	—	—	201-8818	
24643/21	LSTCTU-	4	14	2	4.110	.430	.117	3.0	—	—	—	—	—	201-9521	
24643/24	LSTCTX-	1	21	2	0.895	.350	.108	2.0	—	—	—	—	—	156-8817 4/ #542-6704 4/ #577-3358 4/ #542-6705 4/	
	LSTCTX-	3	21	6	.895	.552	.262	3.5	—	—	—	—	—		
	LSTCTX-	7	21	14	.895	.731	.515	4.0	—	—	—	—	—		
	LSTCTX-	12	21	24	.895	.964	.844	5.0	—	—	—	—	—		
24643/23	LSTTSA-	15	22	3	.640	.380	.083	2.5	TEL-6	300	—	—	—	201-9540	
	LSTTSA-	3	22	6	.640	.500	.137	3.0	TEL-6	300	—	—	—	202-0692	
	LSTTSA-	5	22	10	.640	.590	.195	3.5	TEL-6	300	—	—	—	202-0693	
	LSTTSA-	10	22	20	.640	.725	.296	4.0	TEL-6	300	—	—	—	201-9541	
	LSTTSA-	15	22	30	.640	.850	.415	5.0	TEL-6	300	—	—	—	201-9542	
	LSTTSA-	20	22	40	.640	.920	.504	5.5	TEL-6	300	—	—	—	201-9543	
	LSTTSA-	30	22	60	.640	1.130	.742	6.0	TEL-6	300	—	—	—	202-9537	
	LSTTSA-	40	22	80	.640	1.250	.930	7.0	TEL-6	300	—	—	—	201-9544	
	LSTTSA-	50	22	100	.640	1.450	1.193	7.5	TEL-6	300	—	—	—	202-9538	
	LSTTSA-	60	22	120	.640	1.500	1.317	8.0	TEL-6	300	—	—	—	201-9545	
24643/23	LSTTSU-	15	22	3	.640	0.330	0.066	2.5	TEL-6	300	—	—	—	202-9528	
	LSTTSU-	3	22	6	.640	.450	.113	3.0	TEL-6	300	—	—	—	202-9529	
	LSTTSU-	5	22	10	.640	.540	.167	3.5	TEL-6	300	—	—	—	202-9530	
	LSTTSU-	10	22	20	.640	.675	.262	4.0	TEL-6	300	—	—	—	202-9531	
	LSTTSU-	15	22	30	.640	.800	.379	5.0	TEL-6	300	—	—	—	202-9532	
	LSTTSU-	20	22	40	.640	.870	.461	5.5	TEL-6	300	—	—	—	202-9533	
	LSTTSU-	30	22	60	.640	1.080	.697	6.0	TEL-6	300	—	—	—	202-9534	
	LSTTSU-	40	22	80	.640	1.200	.874	7.0	TEL-6	300	—	—	—	202-9535	

See footnotes at end of table.

**TABLE VI (a)(3). MIL-C-24643 cable ratings and characteristics, watertight
(with circuit integrity), non-flexing service
(electronic, communication, and instrumentation). - Continued**

MIL-C-	Cable type designation	Conductor size: AWG or MCM	Number of conductors in cable	Area of each conductor (MCM)	Cable overall diameter max. (inches)	Cable weight per ft approx (lbs)	Radius of bend min. (inches)	CDR ID	Rated voltage, max. (RMS)	Ampacity, each conductor (amps, max)				NSN 6145-01	
										dc or 60 Hz		400 Hz			
										40°C Ambient	50°C Ambient	40°C Ambient	50°C Ambient		
24643/23	LSTTSU- LSTTSU-	50 60	22 22	100 120	0.640 .540	1.400 1.450	1.148 1.267	7.5 8.0	TEL-6 TEL-6	300 300	— —	— —	— —	202-9536 204-4164	

See footnotes at end of table.

MIL-HDBK-299(SH)
3 April 1989

TABLE VI (b)(1). MIL-C-24643 cable ratings and characteristics, watertight, non-flexing service (power and lighting). - Continued

MIL-C	Cable type designation	Conductor size: AWG or MCM	Number of conductors in cable	Area of each conductor (MCM)	Cable overall diameter max. (inches)	Cable weight per ft approx (lbs)	Radius of bend min. (inches)	CDR ID	Rated voltage, max (RMS)	Ampacity, each conductor (amps. max)				NSN 6145-01	
										dc or 60 Hz		400 Hz			
										40°C Ambient	50°C Ambient	40°C Ambient	50°C Ambient		
24643/53	LSDRW	14	2	4.110	.670	.298	3.0	STD-1	3000	26	24	—	—	201-9057	
24643/53	LSDRWA	14	2	4.110	.720	.336	6.0	STD-1	3000	26	24	—	—	201-9058	
24643/5	LSMDU-6	12	19	6.530	1.000	1.143	8.0	STD-1	600	—	—	—	—	202-2780	
	LSMDU-14	9	19	13.090	1.395	1.783	9.5	STD-1	600	—	—	—	—	202-2781	
	LSMDU-23	7	19	20.820	1.765	2.566	10.5	STD-1	600	—	—	—	—	202-2782	
	LSMDU-40	4	19	41.740	2.040	4.191	12.5	STD-1	600	—	—	—	—	203-0366	
	LSMDU-60	2	19	66.360	2.330	5.843	14.0	STD-1	600	—	—	—	—	202-2783	
24643/6	LSMDY-6	12	19	6.530	1.190	1.360	7.0	STD-1	600	—	—	—	—	202-2784	
	LSMDY-14	9	19	13.090	1.570	2.041	9.5	STD-1	600	—	—	—	—	203-5387	
	LSMDY-23	7	19	20.820	1.960	2.978	12.0	STD-1	600	—	—	—	—	202-2785	
	LSMDY-40	4	19	41.740	2.240	4.480	13.5	STD-1	600	—	—	—	—	202-2786	
	LSMDY-60	2	19	66.360	2.525	6.471	15.0	STD-1	600	—	—	—	—	202-2787	
24643/53	LSTRW	14	3	4.110	.710	.323	4.5	STD-1	3000	24	22	—	—	201-9523	
24643/53	LSTRWA	14	3	4.110	.760	.353	4.5	STD-1	3000	24	22	—	—	201-9524	
24643/53	LSSRW	14	1	4.110	.400	.106	3.0	STD-1	3000	32	30	—	—	202-2054	
24643/53	LSSRWA	14	1	4.110	.450	.134	3.0	STD-1	3000	32	30	—	—	201-9056	

See footnotes at end of table.

TABLE VI (b)(2). MIL-C-24643 cable ratings and characteristics, watertight, non-flexing service, (electronic communication and instrumentation).
- Continued

MIL-C-	Cable type designation	Conductor size: AWG or MCM	Number of conductors in cable	Area of each conductor (MCM)	Cable overall diameter max. (inches)	Cable weight per ft approx (lbs)	Radius of bend min. (inches)	CDR ID	Rated voltage, max (RMS)	Ampacity, each conductor (amps, max)				NSN 6145-01
										dc or 60 Hz		400 Hz		
										40°C Ambient	50°C Ambient	40°C Ambient	50°C Ambient	
24643/47	LS1SMWA- 70	22	70	.700	1.605	2.052	10.0	STD-1	600	-	-	-	-	202-3333
24643/47	LS1SMWU- 70	22	70	.700	1.555	1.365	10.0	STD-1	600	-	-	-	-	202-3334
24643/30	LS1SWA- 2	22	2	.700	0.505	0.120	3.5	STD-2	600	-	-	-	-	205-3661
24643/30	LS1SWA- 14	22	14	.700	.920	.506	5.5	STD-2	600	-	-	-	-	205-3662
	LS1SWA- 20	22	20	.700	1.080	.658	6.5	STD-2	600	-	-	-	-	205-3663
	LS1SWA- 30	22	30	.700	1.250	.942	7.5	STD-2	600	-	-	-	-	203-0381
24643/30	LS1SWU- 2	22	2	.700	0.455	.103	3.5	STD-2	600	-	-	-	-	203-5406
	LS1SWU- 14	22	14	.700	.870	.461	5.5	STD-2	600	-	-	-	-	203-5407
	LS1SWU- 20	22	20	.700	1.030	.618	6.5	STD-2	600	-	-	-	-	203-5408
	LS1SWU- 30	22	30	.700	1.200	.885	7.5	STD-2	600	-	-	-	-	205-3660
24643/32	LS2SWA- 3	22	6	.700	0.370	.205	4.5	STD-2	600	-	-	-	-	202-9354
	LS2SWA- 7	22	14	.700	.710	.298	4.5	STD-2	600	-	-	-	-	202-9553
	LS2SWA- 10	22	20	.700	.880	.422	5.0	STD-2	600	-	-	-	-	202-7767
	LS2SWA- 14	22	28	.700	.980	.618	6.0	STD-2	600	-	-	-	-	205-3181
	LS2SWA- 19	22	38	.700	1.090	.793	6.5	STD-2	600	-	-	-	-	202-7768
	LS2SWA- 24	22	48	.700	1.260	1.030	7.5	STD-2	600	-	-	-	-	204-4873
	LS2SWA- 30	22	60	.700	1.330	1.256	8.0	STD-2	600	-	-	-	-	203-7624
	LS2SWA- 37	22	74	.700	1.430	1.345	8.5	STD-2	600	-	-	-	-	202-3529
	LS2SWA- 44	22	88	.700	1.600	1.905	9.0	STD-2	600	-	-	-	-	202-3330
	LS2SWA- 61	22	122	.700	1.790	2.317	10.0	STD-2	600	-	-	-	-	203-4068
24643/33	LS2SWAU- 3	22	6	.700	0.330	0.173	3.5	STD-2	600	-	-	-	-	204-5540
	LS2SWAU- 7	22	14	.700	.660	.357	4.5	STD-2	600	-	-	-	-	202-9552
	LS2SWAU- 10	22	20	.700	.830	.370	5.0	STD-2	600	-	-	-	-	204-4872
	LS2SWAU- 14	22	28	.700	.930	.556	6.0	STD-2	600	-	-	-	-	202-3337
	LS2SWAU- 19	22	38	.700	1.040	.731	6.5	STD-2	600	-	-	-	-	202-9553
	LS2SWAU- 24	22	48	.700	1.210	.957	7.5	STD-2	600	-	-	-	-	202-3338
	LS2SWAU- 30	22	60	.700	1.280	1.174	8.0	STD-2	600	-	-	-	-	202-3339
	LS2SWAU- 37	22	74	.700	1.380	1.462	8.5	STD-2	600	-	-	-	-	203-0391
	LS2SWAU- 44	22	88	.700	1.550	1.812	9.0	STD-2	600	-	-	-	-	202-7766
24643/56	LS2SWL- 7	16	14	2.580	0.910	0.427	7.3	STD-2	600	-	-	-	-	209-7450
	LS2SWLA- 7	16	14	2.580	0.960	0.467	7.3	STD-2	600	-	-	-	-	205-3645
24643/33	LS2SWU- 1	18	2	1.620	253	.103	2.0	STD-2	600	-	-	-	-	205-3632

See footnotes at end of table.

TABLE VI (b)(2).

MIL-C-24643 cable ratings and characteristics, watertight,
non-flexing service, (electronic, communication, and instrumentation).

- Continued

MIL-C-	Cable type designation	Conductor size: AWG or MCM	Number of conductors in cable	Area of each conductor (MCM)	Cable overall diameter max. approx (inches)	Cable weight per ft approx (lbs)	Radius of bend min. (inches)	CDR ID	Rated voltage, max (RMS)	Ampacity, each conductor (amps. max)				NSN 6145-01	
										dc or 60 Hz		400 Hz			
										40°C Ambient	50°C Ambient	40°C Ambient	50°C Ambient		
24643/33	LS2SWU- 3	18	6	1.620	0.710	0.207	4.0	STD-2	600	-	-	-	-	203-0371	
	LS2SWU- 7	18	14	1.620	.910	.358	5.0	STD-2	600	-	-	-	-	204-0543	
	LS2SWU- 12	18	24	1.620	1.200	.700	6.5	STD-2	600	-	-	-	-	204-6993	
	LS2SWU- 19	18	38	1.620	1.380	.810	8.0	STD-2	600	-	-	-	-	204-0544	
	LS2SWU- 24	18	48	1.620	1.590	1.042	9.0	STD-2	600	-	-	-	-	210-9472	
	LS2SWU- 30	18	60	1.620	1.760	1.256	9.5	STD-2	600	-	-	-	-	205-3633	
	LS2SWU- 37	18	74	1.620	1.870	1.512	10.5	STD-2	600	-	-	-	-	205-3634	
	LS2SWU- 61	18	122	1.620	2.300	2.321	13.5	STD-2	600	-	-	-	-	204-6994	
24643/33	LS2SWUA- 1	18	2	1.620	0.303	0.130	2.0	STD-2	600	-	-	-	-	202-9507	
	LS2SWUA- 3	18	6	1.620	.760	.228	4.0	STD-2	600	-	-	-	-	203-5393	
	LS2SWUA- 7	18	14	1.620	.960	.392	5.0	STD-2	600	-	-	-	-	204-8927	
	LS2SWUA- 12	18	24	1.620	1.250	.745	6.5	STD-2	600	-	-	-	-	204-8928	
	LS2SWUA- 19	18	38	1.620	1.420	.842	8.0	STD-2	600	-	-	-	-	205-9307	
	LS2SWUA- 24	18	48	1.620	1.640	1.070	9.0	STD-2	600	-	-	-	-	204-0543	
	LS2SWUA- 30	18	60	1.620	1.810	1.289	9.5	STD-2	600	-	-	-	-	205-5935	
	LS2SWUA- 37	18	74	1.620	1.920	1.552	10.5	STD-2	600	-	-	-	-	205-9308	
24643/57	LS2UW- 42	26	84	0.278	0.790	0.493	6.5	TEL-3	--	-	-	-	-	202-7000	
	LS2UWA- 42	26	84	.278	.840	.559	6.5	TEL-3	--	-	-	-	-	202-7001	
24643/57	LS2UWS- 42	26	84	.278	.840	.665	10.0	TEL-3	--	-	-	-	-	202-7002	
24643/46	LS2WA- 40	22	80	.700	1.420	1.030	4.0	TEL-3	600	-	--	-	-	202-3533	
24643/46	LS2WAU- 40	22	80	.700	1.370	0.741	5.0	TEL-3	600	-	-	-	-	202-3532	
24643/36	LS3SWA- 3	18	9	1.620	0.703	.309	4.5	STD-2	600	-	-	-	-	203-0373	
	LS3SWA- 7	18	21	1.620	.990	.587	6.0	STD-2	600	-	-	-	-	202-9018	
	LS3SWA- 10	18	30	1.620	1.230	.865	7.5	STD-2	600	-	-	-	-	204-4260	
	LS3SWA- 14	18	42	1.620	1.330	1.133	8.5	STD-2	600	-	-	-	-	203-7602	
	LS3SWA- 19	18	57	1.620	1.500	1.442	9.0	STD-2	600	-	-	-	-	203-7603	
	LS3SWA- 24	18	72	1.620	1.790	1.905	10.5	STD-2	600	-	-	-	-	203-7604	
	LS3SWA- 30	18	90	1.620	1.910	2.266	11.0	STD-2	600	-	-	-	-	203-7605	
	LS3SWA- 37	18	111	1.620	2.010	2.781	12.0	STD-2	600	-	-	-	-	203-7606	
24643/36	LS3SWU- 3	18	9	1.620	0.655	0.298	4.5	STD-2	600	-	-	-	-	203-6567	
	LS3SWU- 7	18	21	1.620	.940	.528	6.0	STD-2	600	-	-	-	-	202-9011	

See footnotes at end of table.

TABLE VI (b)(2). MIL-C-24643 cable ratings and characteristics,
waterlight, non-flexing service.
(electronic, communication, and instrumentation). - Continued

MIL-C-	Cable type designation	Conductor size: AWG or MCM	Number of conductors in cable	Area of each conductor (MCM)	Cable overall diameter max. (inches)	Cable weight per ft approx (lbs)	Radius of bend min. (inches)	CDR ID	Rated voltage, max. (RMS)	Ampacity, each conductor (amps. max)				NSN 6145-01	
										dc or 60 Hz		400 Hz			
										40°C Ambient	50°C Ambient	40°C Ambient	50°C Ambient		
24643/36	LS3SWU-10	18	30	1.620	1.180	0.791	7.5	STD-2	600	-	-	-	-	202-9012	
	LS3SWU-14	18	42	1.620	1.280	1.052	8.5	STD-2	600	-	-	-	-	202-9013	
	LS3SWU-19	18	57	1.620	1.450	1.333	9.0	STD-2	600	-	-	-	-	202-9014	
	LS3SWU-24	18	72	1.620	1.760	1.799	10.5	STD-2	600	-	-	-	-	202-9015	
	LS3SWU-30	18	90	1.620	1.860	2.156	11.0	STD-2	600	-	-	-	-	203-5175	
	LS3SWU-37	18	111	1.620	1.990	2.664	12.0	STD-2	600	-	-	-	-	202-9016	
	LS3SWU-44	18	132	1.620	2.340	3.278	13.0	STD-3	600	-	-	-	-	202-9017	
24643/36	LS3SWUS-3	18	9	1.620	0.715	0.429	8.5	STD-2	600	-	-	-	-	204-4863	
	LS3SWUS-7	18	21	1.620	1.000	.712	12.0	STD-2	600	-	-	-	-	203-6568	
	LS3SWUS-10	18	30	1.620	1.240	.988	15.0	STD-2	600	-	-	-	-	204-4261	
	LS3SWUS-14	18	42	1.620	1.340	1.315	16.0	STD-2	600	-	-	-	-	203-6569	
	LS3SWUS-19	18	57	1.620	1.510	1.691	18.0	STD-2	600	-	-	-	-	203-6570	
	LS3SWUS-24	18	72	1.620	1.800	2.068	21.5	STD-2	600	-	-	-	-	203-2371	
	LS3SWUS-30	18	90	1.620	1.920	2.479	23.0	STD-2	600	-	-	-	-	203-4031	
	LS3SWUS-37	18	111	1.620	2.050	3.063	25.0	STD-2	600	-	-	-	-	203-5395	
	LS3SWUS-44	18	132	1.620	2.300	3.605	28.0	STD-3	600	-	-	-	-	203-8501	
24643/38	LSECM	20	16	1.111	1.370	1.545	11.0	STD-2	600	-	-	-	-	202-3527	
		18	56	1.620	-	-	-	-	-	-	-	-	-	-	
24643/38	LSECMA	20	16	1.111	1.420	1.600	11.5	STD-2	600	-	-	-	-	202-3528	
		18	56	1.620	-	-	-	-	-	-	-	-	-	-	
24643/10	LSPBTM-5	22	10	0.640	0.590	0.167	3.5	TEL-3	600	-	-	-	-	203-3654	
	LSPBTM-15	22	30	.640	.800	.331	5.0	TEL-3	600	-	-	-	-	203-3655	
	LSPBTM-30	22	60	.640	1.000	.544	6.5	TEL-3	600	-	-	-	-	203-6581	
24643/10	LSPBTMU-5	22	18	.640	0.540	.131	3.5	TEL-3	600	-	-	-	-	202-7765	
	LSPBTMU-15	22	30	.640	.750	.283	5.0	TEL-3	600	-	-	-	-	203-6580	
	LSPBTMU-30	22	60	.640	.980	.484	6.5	TEL-3	600	-	-	-	-	202-2830	

See footnotes at end of table.

TABLE VI (c)(1). MIL-C-24643 cable ratings and characteristics,
non-watertight (with circuit integrity), non-flexing service,
(electronic, communication, and instrumentation). - Continued

MIL-C-	Cable type designation	Conductor size: AWG or MCM	Number of conductors in cable	Area of each conductor (MCM)	Cable overall diameter max. (inches)	Cable weight per ft approx (lbs)	Radius of bend min. (inches)	CDR ID	Rated voltage, max (RMS)	Ampacity, each conductor (amps, max)				NSN 6145-01	
										dc or 60 Hz		400 Hz			
										40°C Ambient	50°C Ambient	40°C Ambient	50°C Ambient		
24643/25	LSPI- 3 LSPI- 7 LSPI- 12	18 18 18	6 14 24	1.620 1.620 1.620	0.683 .900 1.153	0.285 .505 1.372	4.5 5.5 7.0	STD-4 STD-4 STD-4	— — —	— — —	— — —	— — —	#161-1520 #495-3384 #163-7375		

See footnotes at end of table.

MIL-HDBK-299 (SH)
3 April 1989

TABLE VI (d)(1). MIL-C-24643 cable ratings and characteristics,
non-watertight, non-flexing service,
(power and lighting). - Continued

MIL-C-	Cable type designation	Conductor size: AWG or MCM	Number of conductors in cable	Area of each conductor (MCM)	Cable overall diameter max. (inches)	Cable weight per ft approx (lbs)	Radius of bend min. (inches)	CDR ID	Rated voltage, max. (RMS)	Ampacity, each conductor (amps, max.)				NSN 6145-01	
										dc or 60 Hz		400 Hz			
										40°C Ambient	50°C Ambient	40°C Ambient	50°C Ambient		
24643/48	LSDNW- 3	16	2	2.580	0.390	0.071	2.0	STD-1	1000	13	12	13	12	202-3513	
	LSDNW- 4	14	2	4.110	.430	.092	2.0	STD-1	1000	22	20	22	20	203-0376	
	LSDNW- 9	10	2	10.380	.545	.179	2.5	STD-1	1000	44	41	44	41	202-3514	
	LSDNW- 14	9	2	13.090	.610	.204	3.0	STD-1	1000	60	55	60	55	203-4032	
	LSDNW- 23	7	2	20.820	.690	.292	3.5	STD-1	1000	78	72	78	72	202-3515	
	LSDNW- 50	3	2	52.620	.910	.603	4.5	STD-1	1000	126	116	126	116	202-3516	
	LSDNW- 75	1	2	83.690	1.060	.882	5.0	STD-1	1000	168	155	168	155	202-3517	
	LSDNW- 100	0	2	105.600	1.170	1.058	5.5	STD-1	1000	199	183	199	183	202-3492	
24643/48	LSDNWA- 3	16	2	2.580	0.440	0.090	2.0	STD-1	1000	13	12	13	12	202-3493	
	LSDNWA- 4	14	2	4.110	.480	.112	2.0	STD-1	1000	22	20	22	20	202-3494	
	LSDNWA- 9	10	2	10.380	.595	.209	2.5	STD-1	1000	44	41	44	41	202-3495	
	LSDNWA- 14	9	2	13.090	.660	.230	3.0	STD-1	1000	60	55	60	55	202-3496	
	LSDNWA- 23	7	2	20.820	.740	.329	3.5	STD-1	1000	78	72	78	72	202-3497	
	LSDNWA- 50	3	2	52.620	.960	.660	4.0	STD-1	1000	126	116	126	116	202-3498	
	LSDNWA- 75	1	2	83.690	1.130	.939	5.0	STD-1	1000	168	155	168	155	202-3499	
	LSDNWA- 100	0	2	105.600	1.220	1.126	5.5	STD-1	1000	199	183	199	183	202-3500	
24643/50	LSPNW- 3	16	4	2.580	0.447	0.104	2.0	STD-1	1000	11	10	11	10	203-6571	
	LSPNW- 4	14	4	4.110	.513	.141	2.0	STD-1	1000	18	17	18	17	203-6572	
	LSPNW- 9	10	4	10.380	.630	.268	2.5	STD-1	1000	39	36	39	36	203-6573	
	LSPNW- 23	7	4	20.820	.830	.482	4.0	STD-1	1000	69	64	69	64	203-6574	
24643/50	LSPNWA- 3	16	4	2.580	0.497	.126	2.0	STD-1	1000	11	10	11	10	203-6575	
	LSPNWA- 4	14	4	4.110	.563	.164	2.0	STD-1	1000	18	17	18	17	203-6482	
	LSPNWA- 9	10	4	10.380	.680	.302	2.5	STD-1	1000	39	36	39	36	206-7007	
	LSPNWA- 23	7	4	20.820	.880	.527	4.0	STD-1	1000	69	64	69	64	203-6483	
24643/49	LSTNW- 3	16	3	2.580	.411	.085	1.5	STD-1	1000	11	10	11	10	202-3501	
	LSTNW- 4	14	3	4.110	.449	.107	2.0	STD-1	1000	18	17	18	17	203-4033	
	LSTNW- 9	10	3	10.380	.625	.240	2.5	STD-1	1000	39	36	39	36	202-3502	
	LSTNW- 14	9	3	13.090	.670	.271	2.5	STD-1	1000	51	47	51	47	202-3503	
	LSTNW- 23	7	3	20.820	.760	.390	3.5	STD-1	1000	69	64	69	64	202-3504	
	LSTNW- 50	3	3	52.620	.969	.793	4.5	STD-1	1000	110	101	110	101	202-3505	
	LSTNW- 75	1	3	83.690	1.134	1.200	5.0	STD-1	1000	148	136	148	136	202-3506	
	LSTNW- 100	0	3	105.600	1.266	1.452	6.0	STD-1	1000	174	160	174	160	202-3507	
	LSTNW- 150	000	3	167.800	1.515	2.218	7.0	STD-1	1000	235	216	235	216	202-3508	

See footnotes at end of table.

TABLE VI (d)(1). MIL-C-24643 cable ratings and characteristics,
non-watertight, non-flexing service,
(power and lighting). - Continued

MIL-C-	Cable type designation	Conductor size: AWG or MCM	Number of conductors in cable	Area of each conductor (MCM)	Cable overall diameter max. (inches)	Cable weight per ft approx (lbs)	Radius of bend min. (inches)	CDR ID	Rated voltage, max. (RMS)	Ampacity, each conductor (amps. max)				NSN 6145-01	
										dc or 60 Hz		400 Hz			
										40°C Ambient	50°C Ambient	40°C Ambient	50°C Ambient		
24643/49	LSTNW A-3	16	3	2.580	.461	0.107	1.5	STD-1	1000	11	10	11	10	203-4034	
	LSTNW A-4	14	3	4.110	.499	.130	2.0	STD-1	1000	18	17	18	17	203-3518	
	LSTNW A-9	10	3	10.380	.675	.271	2.5	STD-1	1000	39	36	39	36	202-3319	
	LSTNW A-14	9	3	13.090	.720	.306	2.5	STD-1	1000	51	47	51	47	202-3520	
	LSTNW A-23	7	3	20.820	.810	.427	3.5	STD-1	1000	69	64	69	64	202-3521	
	LSTNW A-50	3	3	52.620	1.019	.868	4.5	STD-1	1000	110	101	110	101	202-3522	
	LSTNW A-75	1	3	83.690	1.184	1.276	5.0	STD-1	1000	148	136	148	136	202-3523	
	LSTNW A-100	0	3	105.600	1.316	1.510	6.0	STD-1	1000	174	160	174	160	202-3524	
	LSTNW A-150	000	3	167.800	1.565	2.277	7.0	STD-1	1000	235	216	235	216	202-3525	
24643/43	LS2SJ-7	7	2	20.820	0.615	0.288	2.5	STD-3	1000	56	49	56	49	205-3636	
	LS2SJ-9	9	2	13.090	.545	.232	2.5	STD-3	1000	42	35	42	35	202-7749	
	LS2SJ-11	10	2	10.380	.460	.164	2.5	STD-3	1000	31	25	31	25	202-6974	
	LS2SJ-12	12	2	6.530	.430	.134	2.0	STD-3	1000	23	17	16	14	202-7748	
	LS2SJ-14	14	2	3.831	.350	.083	2.0	STD-3	1000	16	14	16	14	202-7747	
	LS2SJ-16	16	2	2.426	.325	.074	2.0	STD-3	1000	13	11	11	11	202-7746	
	LS2SJ-18	18	2	1.900	.310	.060	1.5	STD-3	1000	10	8	—	—	202-6973	
	LS2SJ-20	20	2	1.216	.290	.056	1.5	STD-3	1000	6	5	—	—	202-7769	
	LS2SJ-22	22	2	0.754	.275	.050	1.0	STD-3	1000	3	2	—	—	205-3665	
24643/43	LS2SJA-7	7	2	20.820	.665	.325	2.5	STD-3	600	56	49	56	49	205-3640	
	LS2SJA-9	9	2	13.090	.595	.271	2.5	STD-3	600	42	35	42	35	205-3176	
	LS2SJA-11	10	2	10.380	.510	.200	2.5	STD-3	600	31	25	31	25	205-3639	
	LS2SJA-12	12	2	6.530	.480	.163	2.0	STD-3	600	23	17	16	14	208-6876	
	LS2SJA-14	14	2	3.831	.400	.108	2.0	STD-3	600	16	14	16	14	203-0375	
	LS2SJA-16	16	2	2.426	.375	.093	2.0	STD-3	600	13	11	11	11	205-3638	
	LS2SJA-18	18	2	1.900	.360	.076	1.5	STD-3	600	10	8	—	—	203-0374	
	LS2SJA-20	20	2	1.216	.340	.071	1.5	STD-3	600	6	5	—	—	205-3667	
	LS2SJA-22	22	2	0.754	.325	.063	1.5	STD-3	600	3	2	—	—	205-3666	
24643/43	LS3SJ-9	9	3	13.090	.620	.310	3.5	STD-3	600	33	27	33	27	202-7753	
	LS3SJ-12	12	3	6.530	.455	.170	2.5	STD-3	600	21	15	21	15	202-7752	
	LS3SJ-14	14	3	3.831	.370	.101	2.0	STD-3	600	14	12	14	12	202-7751	
	LS3SJ-16	16	3	2.426	.340	.085	2.0	STD-3	600	11	10	11	10	205-3637	
	LS3SJ-18	18	3	1.900	.325	.076	2.0	STD-3	600	9	7	9	7	202-7750	
	LS3SJ-20	20	3	1.216	.300	.064	1.5	STD-3	600	6	5	6	5	202-7771	

See footnotes at end of table.

MIL-HDBK-299 (SH)
3 April 1989

TABLE VI(d)(1).

MIL-C-24643 cable ratings and characteristics,
non-watertight, non-flexing service,
(power and lighting) - Continued

MIL-C-	Cable type designation	Conductor size: AWG or MCM	Number of conductors in cable	Area of each conductor (MCM)	Cable overall diameter max. (inches)	Cable weight per ft approx (lbs)	Radius of bend min. (inches)	CDR ID	Rated voltage, max. (RMS)	Ampacity, each conductor (amps. max)				NSN 6145-01	
										dc or 60 Hz		400 Hz			
										40°C Ambient	50°C Ambient	40°C Ambient	50°C Ambient		
	LS3SJ-	22	22	3	0.754	0.285	0.054	1.5	STD-3	600	3	2	3	2	202-7770
24643/43	LS3SJ-A-	9	9	3	13.090	.670	.350	3.5	STD-3	600	33	27	33	27	202-7754
	LS3SJ-A-	12	12	3	6.530	.505	.207	2.5	STD-3	600	21	15	21	15	202-6976
	LS3SJ-A-	14	14	3	3.831	.420	.128	2.0	STD-3	600	14	12	14	12	205-9745
	LS3SJ-A-	16	16	3	2.426	.390	.107	2.0	STD-3	600	11	10	11	10	205-3642
	LS3SJ-A-	18	18	3	1.900	.375	.096	2.0	STD-3	600	9	7	9	7	205-3641
	LS3SJ-A-	20	20	3	1.216	.350	.081	1.5	STD-3	600	6	5	6	5	205-3669
	LS3SJ-A-	22	22	3	0.754	.335	.068	1.5	STD-3	600	3	2	3	2	205-3668
24643/43	LS4SJ-	14	14	4	3.831	.395	.128	2.5	STD-3	600	11	9	—	—	202-6975
	LS4SJ-	16	16	4	2.426	.360	.079	2.5	STD-3	600	9	7	—	—	204-4867
	LS4SJ-	20	20	4	1.216	.320	.048	2.0	STD-3	600	6	5	—	—	202-7771
24643/43	LS4SJ-A-	14	14	4	3.831	.445	.158	2.5	STD-3	600	11	9	—	—	205-3643
	LS4SJ-A-	16	16	4	2.426	.410	.133	2.5	STD-3	600	9	7	—	—	202-6977
	LS4SJ-A-	20	20	4	1.216	.370	.091	2.0	STD-3	600	6	5	—	—	202-6999

See footnotes at end of table.

TABLE VI (d)(2). MIL-C-24643 cable ratings and characteristics,
non-watertight, non-flexing service.
(control) - Continued

MIL-C-	Cable type designation	Conductor size: AWG or MCM	Number of conductors in cable	Area of each conductor (MCM)	Cable overall diameter max. (inches)	Cable weight per ft approx (lbs)	Radius of bend min. (inches)	CDR ID	Rated voltage, max. (RMS)	Ampacity, each conductor (amps. max.)				NSN 6145-01	
										dc or 60 Hz		400 Hz			
										40°C Ambient	50°C Ambient	40°C Ambient	50°C Ambient		
24643/33	LS4NW8- 8	8	4	16.510	.740	.612	6.0	STD-1	--	--	--	--	--	210-2345	
24643/55	LS4NWAB- 8	8	4	16.510	.790	.691	6.0	STD-1	--	--	--	--	--	205-9306	
24643/54	LS8NW6- 6	12	8	6.530	.670	.366	5.5	STD-1	--	--	--	--	--	201-9059	
24643/54	LS8NWA6- 6	12	8	6.530	.720	.413	5.5	STD-1	--	--	--	--	--	201-9060	
24643/51	LSMNW- 7	18	7	1.620	.400	.088	1.5	STD-1	1000	12/8 1/2	9/6 1/2	12/8 1/2	9/6 1/2	202-9019	
	LSMNW- 10	18	10	1.620	.495	.127	1.5	STD-1	1000	12/8	9/6	12/8	9/6	204-6997	
	LSMNW- 14	18	14	1.620	.535	.155	2.0	STD-1	1000	12/8	9/6	12/8	9/6	205-3644	
	LSMNW- 19	18	19	1.620	.590	.198	2.0	STD-1	1000	12/8	9/6	12/8	9/6	203-8503	
	LSMNW- 24	18	24	1.620	.685	.259	2.5	STD-1	1000	12/6	9/5	12/6	9/5	202-9020	
	LSMNW- 30	18	30	1.620	.725	.300	2.5	STD-1	1000	12/6	9/5	12/6	9/5	202-9021	
	LSMNW- 37	18	37	1.620	.785	.361	3.0	STD-1	1000	12/6	9/5	12/6	9/5	202-9022	
	LSMNW- 44	18	44	1.620	.890	.447	3.5	STD-1	1000	12/5	9/4	12/5	9/4	202-9023	
24643/51	LSMNWA- 7	18	7	1.620	.450	.111	1.5	STD-1	1000	12/8	9/6	12/8	9/6	202-9024	
	LSMNWA- 10	18	10	1.620	.545	.154	1.5	STD-1	1000	12/8	9/6	12/8	9/6	202-9025	
	LSMNWA- 14	18	14	1.620	.585	.181	2.0	STD-1	1000	12/8	9/6	12/8	9/6	202-9026	
	LSMNWA- 19	18	19	1.620	.640	.231	2.0	STD-1	1000	12/8	9/6	12/8	9/6	203-9430	
	LSMNWA- 24	18	24	1.620	.735	.292	2.5	STD-1	1000	12/6	9/5	12/6	9/5	203-9431	
	LSMNWA- 30	18	30	1.620	.775	.339	2.5	STD-1	1000	12/6	9/5	12/6	9/5	202-9027	
	LSMNWA- 37	18	37	1.620	.835	.395	3.0	STD-1	1000	12/6	9/5	12/6	9/5	203-9432	
	LSMNWA- 44	18	44	1.620	.940	.489	3.5	STD-1	1000	12/5	9/4	12/5	9/4	202-6978	
24643/34	LSMS- 37	16	37	2.580	.800	.618	5.0	STD-1	300	11/5	9/3	11/5	9/3	201-9522	
24643/34	LSMSA- 37	16	37	2.580	.850	.676	5.0	STD-1	300	11/5	9/3	11/5	9/3	202-6967	
24643/29	LSMU- 14	20	14	1.111	.400	.132	3.0	STD-1	300	---	---	---	---	205-9320	
24643/29	LSMUS- 14	20	14	1.111	.460	.217	5.5	STD-1	300	---	---	---	---	204-0570	
24643/29	LSMA- 14	20	14	1.111	.450	.160	3.0	STD-1	300	---	---	---	---	204-0569	

See footnotes at end of table.

TABLE VI (d)(3). MIL-C-24643 cable ratings and characteristics,
non-watertight, non-flexing service, (electronic communication,
and instrumentation). - Continued

MIL-C-	Cable type designation	Conductor size: AWO or MCM	Number of conductors in cable	Area of each conductor (MCM)	Cable overall diameter max. (inches)	Cable weight per ft approx (lbs)	Radius of bend min. (inches)	CDR ID	Rated voltage, max. (RMS)	Ampacity, each conductor (ampere max)				NSN 6145-01	
										dc or 60 Hz		400 Hz			
										40°C Ambient	50°C Ambient	40°C Ambient	50°C Ambient		
24643/28	LSISSOMA- 16 LSISSOMA- 20 LSISSOMA- 40 LSISSOMA- 70	22 22 22 22	16 20 40 70	.700 .700 .700 .700	0.875 .955 1.235 1.603	0.360 .417 .756 1.798	5.5 6.0 7.5 10.0	STD-1 STD-1 STD-1 STD-1	300 300 300 300	- - - -	- - - -	- - - -	205-3656 205-3657 205-3658 205-3659		
24643/28	LSSIOMU- 16 LSSIOMU- 20 LSSIOMU- 40 LSSIOMU- 70	22 22 22 22	16 20 40 70	.700 .700 .700 .700	0.825 .905 1.185 1.555	0.329 .381 .710 1.731	5.5 6.0 7.5 10.5	STD-1 STD-1 STD-1 STD-1	300 300 300 300	- - - -	- - - -	- - - -	202-3539 208-5465 203-5582 203-3308		
24643/28	LSISSOMUS- 16 LSISSOMUS- 20 LSISSOMUS- 40 LSISSOMUS- 70	22 22 22 22	16 20 40 70	.700 .700 .700 .700	0.885 .965 1.245 1.615	0.444 .514 .887 2.188	10.5 11.5 15.0 19.5	STD-1 STD-1 STD-1 STD-1	300 300 300 300	- - - -	- - - -	- - - -	201-9540 202-9541 202-9542 203-6583		
24643/39	LS1S1SMA- 8	22	8	.700	1.080	0.612	6.5	STD-2	300	-	-	-	-	202-3531	
24643/39	LS1S1SMU- 8	22	8	.700	1.090	.552	6.5	STD-2	300	-	-	-	-	202-8476	
24643/41	LSISA- 44	22	44	1.111	1.040	.698	6.5	STD-2	600	-	-	-	-	203-4069	
24643/41	LSISAU- 44	22	44	1.111	0.990	.638	6.5	STD-2	600	-	-	-	-	203-5183	
24643/40	LS1SMA- 5	22	5	.700	.550	.155	4.5	STD-2	600	-	-	-	-	202-0693	
24643/40	LS1SMU- 5	22	5	.700	.500	.128	3.0	STD-2	600	-	-	-	-	202-0694	
24643/42	LS1SU- 36 LS1SU- 18 LS1SU- 60	20 18 20	32 4 60	1.111 1.620 1.111	0.985 — 1.310	.642 — 1.060	6.0 — 10.0	STD-2	600 — 600	- - -	- - -	- - -	- - -	203-4063 — 202-9047	
24643/42	LS1SUA- 36 LS1SUA- 18 LS1SUA- 60	20 18 20	32 4 60	1.111 1.620 1.111	1.035 — 1.360	0.702 — 1.102	6.0 — 10.0	STD-2	600 — 600	- - -	- - -	- - -	- - -	203-4066 — 203-3664	
24643/21	LS2A- 40	22	80	.700	1.420	0.741	4.0	TEL-3	600	-	-	-	-	202-8474	
24643/21	LS2AU- 40	22	80	.700	1.370	.721	4.0	TEL-3	600	-	-	-	-	202-8473	
24643/27	LS2AUS- 40	22	80	.700	1.430	.901	17.0	TEL-3	600	-	-	-	-	202-8475	
24643/58	LS2CS- 6 LS2CS- 18 LS2CS- 42 LS2CS- 60 LS2CS- 77	26 26 26 26 26	12 36 84 120 154	.278 .278 .278 .278 .278	0.430 .590 .800 .930 1.070	.126 .235 .419 .562 .651	5.5 7.0 9.5 11.5 13.0	STD-6 STD-6 STD-6 STD-6 STD-6	300 300 300 300 300	- - - - -	- - - - -	- - - - -	- - - - -	203-9466 202-9058 203-9467 202-9059 203-9468	
24643/31	LS2SA- 3	22	6	.700	0.570	.206	3.5	STD-2	600	-	-	-	-	202-9546	

See footnotes at end of table.

TABLE VI (d)(3). MIL-C-24643 cable ratings and characteristics,
non-watertight, non-flexing service.
(electronic, communication, and instrumentation). - Continued

MIL-C-	Cable type designation	Conductor size: AWG or MCM	Number of conductors in cable	Area of each conductor (MCM)	Cable overall diameter max. (inches)	Cable weight per ft approx (lbs)	Radius of bend min. (inches)	CDR ID	Rated voltage, max. (RMS)	Ampacity, each conductor (amps. max)				NSN 6145-01	
										dc or 60 Hz		400 Hz			
										40°C Ambient	50°C Ambient	40°C Ambient	50°C Ambient		
24643/31	LS2SA-7	22	14	.700	0.710	0.298	4.5	STD-2	600	-	-	-	-	203-7621	
	LS2SA-10	22	20	.700	.880	.422	5.0	STD-2	600	-	-	-	-	203-7622	
	LS2SA-14	22	28	.700	.980	.618	6.0	STD-2	600	-	-	-	-	204-7020	
	LS2SA-19	22	38	.700	1.090	.793	6.5	STD-2	600	-	-	-	-	203-7623	
	LS2SA-24	22	48	.700	1.260	1.030	7.5	STD-2	600	-	-	-	-	203-0383	
	LS2SA-30	22	60	.700	1.330	1.256	7.5	STD-2	600	-	-	-	-	203-0384	
	LS2SA-37	22	74	.700	1.430	1.545	11.5	STD-2	600	-	-	-	-	203-0385	
	LS2SA-44	22	88	.700	1.600	1.905	13.0	STD-2	600	-	-	-	-	203-0386	
	LS2SA-61	22	122	.700	1.790	2.317	14.5	STD-3	600	-	-	-	-	203-4067	
24643/31	LS2SU-3	22	6	.700	0.520	0.170	3.5	STD-2	600	-	-	-	-	203-0382	
	LS2SU-7	22	14	.700	.660	.253	4.5	STD-2	600	-	-	-	-	202-9543	
	LS2SU-10	22	20	.700	.830	.368	5.0	STD-2	600	-	-	-	-	202-9544	
	LS2SU-14	22	28	.700	.930	.558	6.0	STD-2	600	-	-	-	-	204-8939	
	LS2SU-19	22	38	.700	1.040	.732	6.5	STD-2	600	-	-	-	-	203-7618	
	LS2SU-24	22	48	.700	1.210	.953	7.5	STD-2	600	-	-	-	-	204-2281	
	LS2SU-30	22	60	.700	1.280	1.176	8.0	STD-2	600	-	-	-	-	203-7619	
	LS2SU-37	22	74	.700	1.380	1.459	8.5	STD-2	600	-	-	-	-	202-9545	
	LS2SU-44	22	88	.700	1.550	1.809	9.0	STD-2	600	-	-	-	-	204-4871	
24643/31	LS2SUS-3	22	6	.700	0.580	0.261	7.0	STD-2	600	-	-	-	-	203-0387	
	LS2SUS-7	22	14	.700	.720	.367	8.5	STD-2	600	-	-	-	-	204-4265	
	LS2SUS-10	22	20	.700	.890	.496	11.0	STD-2	600	-	-	-	-	203-0388	
	LS2SUS-14	22	28	.700	.990	.753	12.0	STD-2	600	-	-	-	-	202-9547	
	LS2SUS-19	22	38	.700	1.100	.915	13.5	STD-2	600	-	-	-	-	203-0399	
	LS2SUS-24	22	48	.700	1.270	1.191	15.5	STD-2	600	-	-	-	-	202-9548	
	LS2SUS-30	22	60	.700	1.340	1.470	16.0	STD-2	600	-	-	-	-	202-9549	
	LS2SUS-37	22	74	.700	1.440	1.823	17.5	STD-2	600	-	-	-	-	202-9550	
	LS2SUS-44	22	88	.700	1.610	2.060	19.5	STD-2	600	-	-	-	-	202-9551	
	LS2SUS-61	22	122	.700	1.800	2.540	22.0	STD-2	600	-	-	-	-	203-0390	

See footnotes at end of table.

TABLE VI (d)(3). MIL-C-24643 cable ratings and characteristics,
non-watertight, non-flexing service,
(electronic, communication, and instrumentation). - Continued

MIL-C-	Cable type designation	Conductor size: AWG or MCM	Number of conductors in cable	Area of each conductor (MCM)	Cable overall diameter max. (inches)	Cable weight per ft approx (lbs)	Radius of bend min. (inches)	CDR ID	Rated voltage, max. (RMS)	Ampacity, each conductor (amps, max)				NSN 6145-01	
										dc or 60 Hz		400 Hz			
										40°C Ambient	50°C Ambient	40°C Ambient	50°C Ambient		
2464345	LS2U- 18	26	20	0.278	0.480	.118	4.0	TEL-3	300	-	-	-	-	202-8477	
	LS2U- 15	26	30	.378	.560	.164	5.0	TEL-3	300	-	-	-	-	202-8478	
	LS2U- 19	26	38	.378	.580	.185	6.0	TEL-3	300	-	-	-	-	202-9048	
	LS2U- 30	26	60	.378	.700	.257	7.0	TEL-3	300	-	-	-	-	202-9049	
	LS2U- 45	26	90	.378	.870	.360	8.5	TEL-3	300	-	-	-	-	202-9050	
	LS2U- 60	26	120	.378	.960	.443	10.0	TEL-3	300	-	-	-	-	202-9051	
2464346	LS2UA- 10	26	20	.378	.530	.143	4.0	TEL-3	300	-	-	-	-	202-9052	
	LS2UA- 15	26	30	.378	.610	.191	5.0	TEL-3	300	-	-	-	-	202-9053	
	LS2UA- 19	26	38	.378	.630	.216	6.0	TEL-3	300	-	-	-	-	202-9054	
	LS2UA- 30	26	60	.378	.750	.290	7.0	TEL-3	300	-	-	-	-	202-9055	
	LS2UA- 45	26	90	.378	.920	.394	8.5	TEL-3	300	-	-	-	-	202-9056	
	LS2UA- 60	26	120	.378	1.010	.483	10.0	TEL-3	300	-	-	-	-	202-9057	
2464335	LS3SA- 3	18	9	1.620	0.750	.309	4.5	STD-2	600	-	-	-	-	202-9509	
	LS3SA- 7	18	21	1.620	.960	.587	6.0	STD-2	600	-	-	-	-	202-5394	
	LS3SA- 10	18	30	1.620	1.240	.863	7.5	STD-2	600	-	-	-	-	202-3489	
	LS3SA- 14	18	42	1.620	1.340	1.133	8.5	STD-2	600	-	-	-	-	202-3512	
	LS3SA- 19	18	57	1.620	1.480	1.442	9.0	STD-2	600	-	-	-	-	202-0689	
	LS3SA- 24	18	72	1.620	1.720	1.905	10.5	STD-2	600	-	-	-	-	202-6968	
	LS3SA- 30	18	90	1.620	1.820	2.266	11.0	STD-2	600	-	-	-	-	202-6969	

See footnotes at end of table.

TABLE VI (d)(3). MIL-C-24643 cable ratings and characteristics,
non-watertight, non-flexing service,
(electronic, communication, and instrumentation). - Continued

MIL-C-	Cable type designation	Conductor size: AWG or MCM	Number of conductors in cable	Area of each conductor (MCM)	Cable overall diameter max. (inches)	Cable weight per ft approx (lbs)	Radius of bend min. (inches)	CDR ID	Rated voltage, max. (RMS)	Ampacity, each conductor (amps, max)				NSN 6145-01	
										dc or 60 Hz		400 Hz			
										40°C Ambient	50°C Ambient	40°C Ambient	50°C Ambient		
24643/35	LS3SA- LS3SA-	37 44	18 18	111 132	1.620 1.620	1.980 2.200	2.781 3.399	12.0 13.0	STD-2 STD-2	600 600	--	--	--	205-3174 202-9510	
24643/35	LS3SU-	3	18	9	1.620	0.700	0.262	4.5	STD-2	600	--	--	--	202-3487	
	LS3SU-	7	18	21	1.620	.910	.528	6.5	STD-2	600	--	--	--	203-3300	
	LS3SU-	10	18	30	1.620	1.190	.791	7.5	STD-2	600	--	--	--	202-8467	
	LS3SU-	14	18	42	1.620	1.290	1.054	9.5	STD-2	600	--	--	--	202-8468	
	LS3SU-	19	18	57	1.620	1.430	1.353	9.0	STD-2	600	--	--	--	202-3488	
	LS3SU-	24	18	72	1.620	1.670	1.799	10.5	STD-2	600	--	--	--	202-8469	
	LS3SU-	30	18	90	1.620	1.770	2.266	11.0	STD-2	600	--	--	--	202-9506	
	LS3SU-	37	18	111	1.620	1.930	2.664	12.0	STD-2	600	--	--	--	202-8470	
	LS3SU-	44	18	132	1.620	2.150	3.273	13.0	STD-2	600	--	--	--	203-0372	
24643/35	LS3SUS-	3	18	9	1.620	0.760	0.444	9.5	STD-2	600	--	--	--	202-6970	
	LS3SUS-	7	18	21	1.620	.970	.772	12.0	STD-2	600	--	--	--	202-0690	
	LS3SUS-	10	18	30	1.620	1.250	1.081	15.0	STD-2	600	--	--	--	202-0691	
	LS3SUS-	14	18	42	1.620	1.350	1.416	16.5	STD-2	600	--	--	--	202-3490	
	LS3SUS-	19	18	57	1.620	1.490	1.802	18.0	STD-2	600	--	--	--	202-6971	
	LS3SUS-	24	18	72	1.620	1.730	2.190	21.0	STD-2	600	--	--	--	204-4859	
	LS3SUS-	30	18	90	1.620	1.830	2.605	22.0	STD-2	600	--	--	--	204-4860	
	LS3SUS-	37	18	111	1.620	1.990	3.301	24.0	STD-2	600	--	--	--	202-6972	

See footnotes at end of table.

TABLE VI (d)(3). MIL-C-24643 cable ratings and characteristics,
non-watertight, non-flexing service,
(electronic, communication, and instrumentation). - Continued

MIL-C-	Cable type designation	Conductor size: AWG or MCM	Number of conductors in cable	Area of each conductor (MCM)	Cable overall diameter max. (inches)	Cable weight per ft approx (lbs)	Radius of bend min. (inches)	CDR ID	Rated voltage, max. (RMS)	Ampacity, each conductor (amps. max.)				NSN 6145-01	
										dc or 60 Hz		400 Hz			
										40°C Ambient	50°C Ambient	40°C Ambient	50°C Ambient		
24643/35	LS3SUS-44	18	132	1.620	.2210	3.908	26.5	STD-2	600	—	—	—	—	204-4861	
24643/37	LS3U-3 LS3U-7 LS3U-12	18 18 18	9 21 36	1.620 1.620 1.620	.620 .810 1.090	0.123 .288 .491	4.5 5.5 7.5	STD-4 STD-4 STD-4	300 300 300	— — —	— — —	— — —	— — —	203-9429 205-3635 204-4864	
24643/37	LS3UA-3 LS3UA-7 LS3UA-12	18 18 18	9 21 36	1.620 1.620 1.620	.670 .860 1.140	.138 .315 .522	5.5 5.5 7.5	STD-4 STD-4 STD-4	300 300 600	— — —	— — —	— — —	— — —	204-4865 204-4866 204-6996	
24643/9	LSMRI-D15 LSMRI-D25 LSMRI-T25	20 16 16	2 2 3	1.020 2.580 2.580	.075 .102 .102	.010 .022 .033	— — —	STD-3 STD-3 STD-3	— — —	3 8 7	3 6 6	— — —	— — —	202-7764 208-5455 205-3627	
24643/52	LSTPNW-15 LSTPNW-3 LSTPNW-5 LSTPNW-10 LSTPNW-15 LSTPNW-20 LSTPNW-30 LSTPNW-40	22 22 22 22 22 22 22 22	3 6 10 20 30 40 60 80	.640 .640 .640 .640 .640 .640 .640 .640	.235 .310 .365 .470 .530 .575 .680 .765	.024 .039 .059 .104 .138 .172 .255 .328	1.0 1.0 1.5 1.5 2.0 2.0 2.5 3.0	TEL-3 TEL-3 TEL-3 TEL-3 TEL-3 TEL-3 TEL-3 TEL-3	300 300 300 300 300 300 300 300	— — — — — — — —	— — — — — — — —	— — — — — — — —	— — — — — — — —	205-3670 205-3671 205-3672 206-7518 205-3673 205-3674 201-8819 201-8820	
24643/52	LSTPNWA-15 LSTPNWA-3 LSTPNWA-5 LSTPNWA-10 LSTPNWA-15 LSTPNWA-20 LSTPNWA-30 LSTPNWA-40	22 22 22 22 22 22 22 22	3 6 10 20 30 40 60 80	.640 .640 .640 .640 .640 .640 .640 .640	.285 .360 .415 .520 .580 .625 .730 .815	.032 .062 .074 .126 .161 .201 .288 .370	1.0 1.0 1.5 1.5 2.0 2.0 2.5 3.0	TEL-3 TEL-3 TEL-3 TEL-3 TEL-3 TEL-3 TEL-3 TEL-3	300 300 300 300 300 300 300 300	— — — — — — — —	— — — — — — — —	— — — — — — — —	— — — — — — — —	201-8821 201-9546 201-8822 201-9547 201-9548 201-9549 201-9550 205-9321	

See footnotes at end of table.

TABLE VI (c)(1). MIL-C-24643 cable ratings and characteristics
non-watertight, flexing service
(power and lighting). - Continued

MIL-C-	Cable type designation	Conductor size: AWG or MCM	Number of conductors in cable	Area of each conductor (MCM)	Cable overall diameter max. (inches)	Cable weight per ft approx (lbs)	Radius of bend min. (inches)	CDR ID	Rated voltage, max. (RMS)	Ampacity, each conductor (amps. max)				NSN 6145-01	
										dc or 60 Hz		400 Hz			
										40°C Ambient	50°C Ambient	40°C Ambient	50°C Ambient		
24643/1	LSCVSP- 4	3 3	3 1	52.620 33.090	1.450 ---	1.328 ---	9.0 --	STD-3	600	100 --	75 --	100 --	75 --	202-9490 --	
24643/3	LSDHOP- 3	16	2	2.580	0.425	0.101	3.0	STD-3 1/2	600	23	21	23	21	201-9494	
	LSDHOP- 4	14	2	4.110	.460	.117	3.5	STD-3 1/2	600	30	28	30	28	202-7745	
	LSDHOP- 6	12	2	6.530	.510	.150	4.0	STD-3 1/2	600	41	37	41	37	202-2036	
	LSDHOP- 9	9	2	9.045	.570	.172	4.5	STD-3 1/2	600	50	43	50	45	202-2037	
	LSDHOP- 14	14	2	14.070	.705	.293	5.0	STD-3 1/2	600	60	54	60	54	203-0365	
	LSDHOP- 23	7	2	22.910	.860	.395	6.5	STD-3 1/2	600	80	72	80	72	202-2038	
	LSDHOP- 30	5	2	33.090	.960	.690	7.5	STD-3 1/2	600	90	83	90	83	202-2039	
	LSDHOP- 83	83	2	84.230	1.450	1.359	11.0	STD-3 1/2	600	169	152	169	152	202-0661	
	LSDHOP- 250	250	2	252.700	2.100	2.811	17.0	STD-3 1/2	600	322	287	285	254	202-0662	
	LSDHOP- 400	400	1	413.500	2.500	4.532	20.0	STD-3 1/2	600	422	382	290	262	202-0663	
24643/3	LSPHOP- 3	16	4	2.580	0.480	0.130	4.0	STD-3 1/2	600	17	16	17	16	201-9495	
	LSPHOP- 4	14	4	4.110	.550	.165	4.5	STD-3 1/2	600	23	21	23	21	202-0672	
	LSPHOP- 9	9	4	9.045	.660	.281	5.5	STD-3 1/2	600	36	34	36	34	202-0673	
	LSPHOP- 42	42	4	42.110	1.380	1.210	11.0	STD-3 1/2	600	79	73	79	73	202-0674	
	LSPHOP- 60	60	4	61.260	1.510	1.550	12.0	STD-3 1/2	600	93	80	95	80	202-9491	
	LSPHOP- 133	133	4	137.800	2.000	2.863	16.0	STD-3 1/2	600	163	148	155	140	202-0675	
24643/3	LSSHOP- 3	16	1	2.580	0.210	0.027	1.5	STD-3 1/2	600	20	18	20	18	201-9530	
	LSSHOP- 23	7	1	20.820	.460	.143	3.5	STD-3 1/2	600	88	80	88	80	201-9531	
	LSSHOP- 60	60	1	61.260	.600	.341	5.0	STD-3 1/2	600	162	153	162	153	201-9532	
	LSSHOP- 150	150	1	153.100	.870	.769	7.0	STD-3 1/2	600	285	263	285	263	210-4000	
	LSSHOP- 200	200	1	199.100	.980	.966	8.0	STD-3 1/2	600	323	306	—	—	201-9533	
	LSSHOP- 250	250	1	252.700	1.085	1.318	8.5	STD-3 1/2	600	397	362	—	—	202-2031	
	LSSHOP- 500	500	1	500.000	1.450	2.585	11.5	STD-3 1/2	600	602	578	—	—	201-2052	
	LSSHOP- 650	650	1	650.000	1.610	3.090	13.0	STD-3 1/2	600	698	658	—	—	202-2053	
24643/11	LSSSP- 300	300	1	300.000	1.100	1.287	6.6	—	600	—	—	—	—	204-5529	
24643/3	LSTHOP- 3	16	3	2.580	0.450	0.094	3.5	STD-3 1/2	600	19	17	19	17	202-0664	
	LSTHOP- 4	14	3	4.110	.480	.136	4.0	STD-3 1/2	600	25	23	25	23	205-3626	
	LSTHOP- 6	12	3	6.530	.550	.179	4.5	STD-3 1/2	600	33	31	33	31	202-0665	
	LSTHOP- 9	9	3	9.045	.600	.201	5.0	STD-3 1/2	600	38	34	38	34	202-0666	
	LSTHOP- 14	14	3	14.070	.750	.346	6.0	STD-3 1/2	600	50	46	50	46	202-0667	

See footnotes at end of table.

TABLE VI (e)(1). MIL-C-24643 cable ratings and characteristics,
non-watertight, flexing service,
(power and lighting). - Continued

MIL-C-	Cable type designation	Conductor size: AWO or MCM	Number of conductors in cable	Area of each conductor (MCM)	Cable overall diameter max. (inches)	Cable weight per ft approx (lbs)	Radius of bend min. (inches)	CDR ID	Rated voltage, max. (RMS)	Ampacity, each conductor (amps, max)				NSN 6145-01	
										dc or 60 Hz		400 Hz			
										40°C Ambient	50°C Ambient	40°C Ambient	50°C Ambient		
24643/3	LSTHOP- 23	7	3	22.910	0.900	0.506	7.0	STD-3 3/4	600	70	64	70	64	202-0668	
	LSTHOP- 42	42	3	42.110	1.250	.986	10.0	STD-3 3/4	600	93	86	93	86	202-0669	
	LSTHOP- 150	150	3	153.100	1.820	2.470	13.5	STD-3 3/4	600	197	180	197	180	203-5384	
	LSTHOP- 250	250	3	252.700	2.240	3.872	18.0	STD-3 3/4	600	237	224	—	—	202-0670	
	LSTHOP- 400	400	3	413.500	2.800	6.128	22.0	STD-3 3/4	600	400	365	315	265	202-0671	
	LSTHOP- 500	500	3	500.000	3.100	7.313	25.0	STD-3 3/4	600	500	450	350	275	202-2040	
	LSTHOP- 600	600	3	600.000	3.150	7.983	25.0	STD-3 3/4	600	600	550	—	—	203-5385	

See footnotes at end of table.

MIL-HDBK-299 (SH)
 3 April 1989

TABLE VI (e)(2). MIL-C-24643 cable ratings and characteristics,
non-watertight, flexing service,
(control). - Continued

MIL-C-	Cable type designation	Conductor size: AWG or MCM	Number of conductors in cable	Area of each conductor (MCM)	Cable overall diameter max. (inches)	Cable weight per ft approx (lbs)	Radius of bend min. (inches)	CDR ID	Rated voltage, max. (RMS)	Ampacity, each conductor (amps, max)				NSN 6145-01	
										dc or 60 Hz		400 Hz			
										40°C Ambient	50°C Ambient	40°C Ambient	50°C Ambient		
24643/1	LSMHOP- 7	16	7	2.580	.500	0.164	4.0	STD-1	600	11/7 1/2	9/6 1/2	11/7 1/2	9/6 1/2	202-2788	
	LSMHOP- 10	16	10	2.580	.583	.224	4.5	STD-1	600	11/7	9/6	11/7	9/6	202-5388	
	LSMHOP- 14	16	14	2.580	.635	.290	5.0	STD-1	600	11/7	9/6	11/7	9/6	202-2789	
	LSMPOR- 19	16	19	2.580	.703	.360	5.5	STD-1	600	11/7	9/6	11/7	9/6	202-2790	
	LSMHOP- 24	16	24	2.580	.793	.457	6.5	STD-1	600	11/7	9/6	11/7	9/6	202-2791	
	LSMHOP- 30	16	30	2.580	.833	.541	6.5	STD-1	600	11/7	9/6	11/7	9/6	202-2792	
	LSMHOP- 37	16	37	2.580	.923	.674	7.5	STD-1	600	11/8	9/4	11/8	9/4	202-2793	
	LSMHOP- 44	16	44	2.580	1.000	.771	8.0	STD-1	600	11/4	9/3	11/4	9/3	202-5389	
	LSMHOP- 61	16	61	2.580	1.173	1.125	9.5	STD-1	600	11/3	9/2	11/3	9/2	202-2794	

53 See footnotes at end of table.

**TABLE VI (e)(3). MIL-C-24643 cable ratings and characteristics,
non-watertight, non-flexing service,
(electronic, communication, and instrumentation). - Continued**

MIL-C-	Cable type designation	Conductor size: AWG or MCN	Number of conductors in cable	Area of each conductor (MCN)	Cable overall diameter max. (inches)	Cable weight per ft approx (lbs)	Radius of bend min. (inches)	CDR ID	Rated voltage, max (RMS)	Ampacity, each conductor (amps max)				NSN 6145-01	
										dc or 60 Hz		400 Hz			
										40°C Ambient	50°C Ambient	40°C Ambient	50°C Ambient		
24643/44	LS3SF-	7	18	21	1.620	1.040	0.618	2.0	STD-2	600	--	--	--	202-3491	
24643/2	LSDCOP-	1	20	2	1.020	0.250	.031	--	STD-3	300	--	--	--	202-9527	
	LSDCOP-	15	18	2	1.620	.315	.050	--	STD-3	300	--	--	--	202-2776	
	LSDCOP-	1	18	2	1.620	.330	.052	--	STD-3	300	--	--	--	202-2777	
24643/4	LSMCOS-	2	18	3	1.620	.460	.130	--	SPL-3	600	5 1/2 ¹	4 1/4 ¹	5 1/2 ¹	4 1/4 ¹	203-5386
	LSMCOS-	4	18	4	1.620	.510	.167	--	SPL-3	600	5/3	4/2	5/3	4/2	202-2778
	LSMCOS-	5	20	5	1.020	.390	.091	--	SPL-3	600	2 5/1	2/1	2 5/1	2/1	203-5400
	LSMCOS-	6	20	6	1.020	.480	.102	--	SPL-3	600	2 5/1	2/1	2 5/1	2/1	202-2828
	LSMCOS-	7	18	7	1.620	.595	.137	--	SPL-3	600	5 1/2 ³	4 1/2 ³	5 1/2 ³	4 1/2 ³	202-2779
24643/8	LSMMOP-	5	24	5	0.404	.305	.059	--	STD-3	300	3/1	2/1	--	--	202-2829
24643/2	LSTCOP-	2	18	3	1.620	.345	.067	--	STD-3	300	6	5	--	--	203-5383
24643/12	LSTTOP-	3	20	6	1.020	.480	.113	4.0	TEL-3	300	5/4	4/3	5/4	4/3	201-9538
	LSTTOP-	5	20	10	1.020	.590	.154	5.0	TEL-3	300	5/3	4/2	5/3	4/2	202-6998
	LSTTOP-	10	20	20	1.020	.700	.259	5.5	TEL-3	300	5/2	4/1	5/2	4/1	201-9539
	LSTTOP-	13	20	30	1.020	.830	.383	6.5	TEL-3	300	5/1	4 1/3	5/1	4 1/3	202-3536
24643/13	LSTTRS-	2	20	4	1.020	.680	.233	1.0	STD-2	300	--	--	--	--	201-2831
	LSTTRS-	4	20	8	1.020	.140	.281	1.1	STD-2	300	--	--	--	--	203-5401
	LSTTRS-	6	20	12	1.020	.880	.388	1.5	STD-2	300	--	--	--	--	202-2832
	LSTTRS-	8	20	16	1.020	.990	.474	1.7	STD-2	300	--	--	--	--	202-2833
	LSTTRS-	10	20	20	1.020	1.080	.561	2.0	STD-2	300	--	--	--	--	202-2834
	LSTTRS-	12	20	24	1.020	1.100	.611	2.0	STD-2	300	--	--	--	--	202-2835
	LSTTRS-	16	20	32	1.020	1.190	.723	2.2	STD-2	300	--	--	--	--	203-5402
24643/13	LSTTRSA-	2	20	4	1.020	.0730	.297	4.5	STD-2	300	--	--	--	--	202-2836
	LSTTRSA-	4	20	8	1.020	.790	.394	5.0	STD-2	300	--	--	--	--	203-5403
	LSTTRSA-	6	20	12	1.020	.930	.470	5.5	STD-2	300	--	--	--	--	202-2837
	LSTTRSA-	8	20	16	1.020	1.040	.521	6.5	STD-2	300	--	--	--	--	203-5404
	LSTTRSA-	10	20	20	1.020	1.130	.557	7.0	STD-2	300	--	--	--	--	203-5405
	LSTTRSA-	12	20	24	1.020	1.150	.608	7.0	STD-2	300	--	--	--	--	210-2346
	LSTTRSA-	16	20	32	1.020	1.240	.764	7.5	STD-2	300	--	--	--	--	202-8472

¹ Ind/Avg indicates the maximum current for each conductor (Ind), and the maximum current (Avg) for each conductor when all conductors in the cable are used.

² May be STD-1 or LTR-3, manufacturer's option.

³ May be STD-3 or STD-4, manufacturer's option.

⁴ 6145-00

MIL-HDBK-299(SH)
3 April 1989

5.7 Cable classification (MIL-C-24640). Cables specified in MIL-C-24640 are listed in table VII under the following general classifications:

- (a) Watertight (with circuit integrity), non-flexing service:
 - (1) power.
 - (2) control.
 - (3) electronic, communication, and instrumentation.
- (b) Watertight, non-flexing service:
 - (1) electronic, communication, and instrumentation.
- (c) Non-watertight, non-flexing service:
 - (1) power.
 - (2) electronic, communication and instrumentation.

TABLE VII (a)(1). MIL-C-24640 cable ratings and characteristics,
watertight (with circuit integrity), non-flexing service,
(power).

MIL-C-	Cable type designation	Conductor size: AWG or MCM	Number of conductors in cable	Area of each conductor (MCM)	Cable overall diameter max. (inches)	Cable weight per ft maximum (lbs)	Radius of bend min. (inches)	CDR ID	Rated voltage, max. (RMS)	Ampacity, each conductor (amps. max.)				NSN 6145-01	
										dc or 60 Hz		400 Hz			
										40°C Ambient	50°C Ambient	40°C Ambient	50°C Ambient		
24640/22	TXW- TXW-	3 4	16 14	7 7	2.580 4.110	.039 .404	.105 .153	3.0 3.5	STD-1 STD-1	600 600	15/11 1/2 26/14	14/10 1/2 24/13	15/11 1/2 26/14	14/10 1/2 24/13	224-8321 224-8322
24640/22	TXWA- TXWA-	3 4	16 14	7 7	2.580 4.110	.389 .454	.138 .203	3.0 3.5	STD-1 STD-1	600 600	15/11 26/14	14/10 24/13	15/11 26/14	14/10 24/13	225-1379 225-1380
24640/19	DXOW- DXOW-	3 4	16 14	2 2	2.580 4.110	.316 .354	.088 .112	4.0 4.5	STD-1 STD-1	600 600	13 22	12 20	13 22	12 20	225-2664 225-6382
24640/19	DXW- DXW-	3 4	16 14	2 2	2.580 4.110	.257 .303	.048 .068	2.0 2.5	STD-1 STD-1	600 600	13 22	12 20	13 22	12 20	224-9185 224-8317
24640/19	DXWA- DXWA-	3 4	16 14	2 2	2.580 4.110	.307 .353	.067 .089	2.0 2.5	STD-1 STD-1	600 600	13 22	12 20	13 22	12 20	224-8318 226-5011
24640/21	PXOW- PXOW-	3 4	16 14	4 4	2.580 4.110	.350 .394	.116 .146	4.2 5.0	STD-1 STD-1	600 600	11 11	10 10	11 11	10 10	— —
24640/21	PXW- PXW-	3 4	16 14	4 4	2.580 4.110	.286 .339	.069 .102	3.0 3.0	STD-1 STD-1	600 600	11 18	10 17	11 18	10 17	225-2153 225-2154
24640/21	PXWA- PXWA-	3 4	16 14	4 4	2.580 4.110	.336 .389	.095 .128	3.0 3.0	STD-1 STD-1	600 600	11 18	10 17	11 18	10 17	224-8319 224-8320
24640/20	TXOW- TXOW-	3 4	16 14	3 3	2.980 4.110	.329 .369	.100 .130	4.0 4.5	STD-1 STD-1	600 600	11 18	10 17	11 18	10 17	— —
24640/20	TXW- TXW-	3 4	16 14	3 3	2.580 4.110	.266 .314	.057 .087	3.0 3.0	STD-1 STD-1	600 600	11 18	10 17	11 18	10 17	225-2665 225-2151
24640/20	TXWA- TXWA-	3 4	16 14	3 3	2.580 4.110	.316 .364	.084 .125	3.0 3.0	STD-1 STD-1	600 600	11 18	10 17	11 18	10 17	225-2152 231-3926

See footnote at end of table.

TABLE VII (a)(2). MIL-C-24640 cable ratings and characteristics,
watertight (with circuit integrity), non-flexing service,
(control). - Continued

MIL-C-	Cable type designation	Conductor size: AWG or MCM	Number of conductors in cable	Area of each conductor (MCM)	Cable overall diameter max. (inches)	Cable weight per ft maximum (lbs)	Radius of bend min. (inches)	CDR ID	Rated voltage, max. (RMS)	Ampacity, each conductor (amps. max)				NSN 6143-01	
										dc or 60 Hz		400 Hz			
										40°C Ambient	50°C Ambient	40°C Ambient	50°C Ambient		
24640/23	MXCOW- 7	18	7	1.620	.366	.034	4.5	STD-1	600	12/8 1/2	9/6 1/2	-	-	227-9946	
	MXCOW- 10	18	10	1.620	.447	.184	5.5	STD-1	600	12/8	9/6	-	-	229-0031	
	MXCOW- 14	18	14	1.620	.474	.219	6.0	STD-1	600	12/8	9/6	-	-	225-3450	
	MXCOW- 19	18	19	1.620	.513	.267	6.5	STD-1	600	12/8	9/6	-	-	225-3451	
	MXCOW- 24	18	24	1.620	.601	.350	7.3	STD-1	600	12/6	9/5	-	-	225-2161	
	MXCOW- 30	18	30	1.620	.630	.399	7.5	STD-1	600	12/6	9/5	-	-	225-2162	
	MXCOW- 37	18	37	1.620	.670	.466	8.0	STD-1	600	12/6	9/5	-	-	225-2163	
	MXCOW- 44	18	44	1.620	.751	.553	9.0	STD-1	600	12/5	9/4	-	-	225-2164	
	MXCOW- 61	18	61	1.620	.817	.694	10.0	STD-1	600	12/4.5	9/3.5	-	-	225-2165	
	MXCW- 7	18	7	1.620	.319	.087	2.5	STD-1	600	12/8	9/6	-	-	225-3448	
24640/23	MXCW- 10	18	10	1.620	.405	.136	3.5	STD-1	600	12/8	9/6	-	-	224-8233	
	MXCW- 14	18	14	1.620	.434	.166	3.5	STD-1	600	12/8	9/6	-	-	225-1381	
	MXCW- 19	18	19	1.620	.474	.208	4.0	STD-1	600	12/8	9/6	-	-	226-3691	
	MXCW- 24	18	24	1.620	.560	.281	4.5	STD-1	600	12/6	9/5	-	-	224-8323	
	MXCW- 30	18	30	1.620	.589	.325	4.5	STD-1	600	12/6	9/5	-	-	225-2155	
	MXCW- 37	18	37	1.620	.630	.394	5.0	STD-1	600	12/6	9/5	-	-	225-2156	
	MXCW- 44	18	44	1.620	.708	.472	5.5	STD-1	600	12/5	9/4	-	-	225-2157	
	MXCW- 61	18	61	1.620	.785	.612	6.5	STD-1	600	12/4.5	9/3.5	-	-	225-2158	
	MXCWA- 7	18	7	1.620	.369	.110	2.5	STD-1	600	12/8	9/6	-	-	226-2052	
	MXCWA- 10	18	10	1.620	.433	.177	3.5	STD-1	600	12/8	9/6	-	-	225-2666	
24640/23	MXCWA- 14	18	14	1.620	.485	.216	3.5	STD-1	600	12/6	9/5	-	-	225-2667	
	MXCWA- 19	18	19	1.620	.524	.264	4.0	STD-1	600	12/6	9/5	-	-	225-2668	
	MXCWA- 24	18	24	1.620	.610	.337	4.5	STD-1	600	12/6	9/5	-	-	225-2669	
	MXCWA- 30	18	30	1.620	.639	.385	4.5	STD-1	600	12/6	9/5	-	-	225-2159	
	MXCWA- 37	18	37	1.620	.680	.453	5.0	STD-1	600	12/6	9/5	-	-	225-0961	
	MXCWA- 44	18	44	1.620	.758	.548	5.5	STD-1	600	12/5	9/4	-	-	225-2160	
	MXCWA- 61	18	61	1.620	.835	.664	6.5	STD-1	600	12/4.5	9/3.5	-	-	225-3449	

See footnote at end of table.

TABLE VII (a)(3). MIL-C-24640 cable ratings and characteristics.
watertight (with circuit integrity), non-flexing service,
(electronic, communication, and instrumentation). - Continued

MIL-C-	Cable type designation	Conductor size: AWG or MCM	Number of conductors in cable	Area of each conductor (MCM)	Cable overall diameter max. (inches)	Cable weight per ft maximum (lbs)	Radius of bend min. (inches)	CDR ID	Rated voltage, max. (RMS)	Ampacity, each conductor (amps, max.)				NSN 6145-01	
										dc or 60 Hz		400 Hz			
										40°C Ambient	50°C Ambient	40°C Ambient	50°C Ambient		
24640/24	TTXOW- 15	22	3	.640	.273	.068	3.5	TEL-6	600	-	-	-	-	226-8808	
	TTXOW- 3	22	6	.640	.359	.108	4.5	TEL-6	600	-	-	-	-	228-4262	
	TTXOW- 5	22	10	.640	.406	.134	5.0	TEL-6	600	-	-	-	-	237-1290	
	TTXOW- 15	22	30	.640	.600	.299	7.5	TEL-6	600	-	-	-	-	231-3926	
	TTXOW- 20	22	40	.640	.662	.361	8.0	TEL-6	600	-	-	-	-	226-8809	
	TTXOW- 30	22	60	.640	.772	.480	9.5	TEL-6	600	-	-	-	-	229-0032	
	TTXOW- 40	22	80	.640	.887	.631	11.0	TEL-6	600	-	-	-	-	226-4565	
24640/24	TTXW- 15	22	3	.640	.195	.026	1.5	TEL-6	600	-	-	-	-	225-2205	
	TTXW- 3	22	6	.640	.307	.062	2.5	TEL-6	600	-	-	-	-	225-2206	
	TTXW- 5	22	10	.640	.357	.091	3.0	TEL-6	600	-	-	-	-	225-2207	
	TTXW- 10	22	20	.640	.492	.168	4.0	TEL-6	600	-	-	-	-	225-2208	
	TTXW- 15	22	30	.640	.569	.231	4.5	TEL-6	600	-	-	-	-	225-2209	
	TTXW- 20	22	40	.640	.621	.283	5.0	TEL-6	600	-	-	-	-	225-9664	
	TTXW- 30	22	60	.640	.738	.407	6.0	TEL-6	600	-	-	-	-	237-1289	
	TTXW- 40	22	80	.640	.852	.526	7.0	TEL-6	600	-	-	-	-	226-6028	
24640/24	TTXWA- 15	22	3	.640	.245	.041	1.5	TEL-6	600	-	-	-	-	226-6029	
	TTXWA- 3	22	6	.640	.357	.084	2.5	TEL-6	600	-	-	-	-	225-3453	
	TTXWA- 5	22	10	.640	.407	.119	3.5	TEL-6	600	-	-	-	-	226-6030	
	TTXWA- 10	22	20	.640	.542	.209	4.5	TEL-6	600	-	-	-	-	226-6031	
	TTXWA- 15	22	30	.640	.619	.270	5.0	TEL-6	600	-	-	-	-	226-6032	
	TTXWA- 20	22	40	.640	.671	.328	5.5	TEL-6	600	-	-	-	-	226-7410	
	TTXWA- 30	22	60	.640	.788	.463	6.0	TEL-6	600	-	-	-	-	226-6033	
	TTXWA- 40	22	80	.640	.902	.593	7.0	TEL-6	600	-	-	-	-	228-0701	

See footnote at end of table.

MIL-HDBK-299 (SH)
 3 April 1989

TABLE VII (b)(1). MIL-C-24640 cable ratings and characteristics, watertight, non-flexing service, (electronic, communication, and instrumentation).

MIL-C-	Cable type designation	Conductor size: AWG or MCM	Number of conductors in cable	Area of each conductor (MCM)	Cable overall diameter max. (inches)	Cable weight per ft maximum (lbs.)	Radius of bend min. (inches)	CDR ID	Rated voltage, max (RMS)	Ampacity, each conductor (amps. max.)				NSN 6145-01	
										dc or 60 Hz		400 Hz			
										40°C Ambient	50°C Ambient	40°C Ambient	50°C Ambient		
24640/14	1XSOW- 2	22	2	.640	.314	.083	4.0	—	600	—	—	—	—	223-2199	
	1XSOW- 14	22	14	.640	.506	.233	6.0	—	600	—	—	—	—	225-2200	
	1XSOW- 20	22	20	.640	.584	.307	7.0	—	600	—	—	—	—	231-4589	
	1XSOW- 30	22	30	.640	.662	.429	8.0	—	600	—	—	—	—	225-2201	
24640/17	2XOW- 6	26	12	.278	.363	.107	4.5	—	600	—	—	—	—	224-8341	
	2XOW- 18	26	36	.278	.504	.201	6.0	—	600	—	—	—	—	224-9205	
	2XOW- 24	26	48	.278	.588	.266	7.0	—	600	—	—	—	—	225-8952	
	2XOW- 42	26	84	.278	.686	.365	8.5	—	600	—	—	—	—	225-8953	
	2XOW- 60	26	120	.278	.802	.485	10.5	—	600	—	—	—	—	225-8954	
	2XOW- 77	26	154	.278	.906	.615	11.0	—	600	—	—	—	—	225-8955	
24640/15	2XSAOW- 3	22	6	.640	.437	.153	5.5	—	600	—	—	—	—	225-1396	
	2XSAOW- 7	22	14	.640	.550	.253	7.5	—	600	—	—	—	—	225-1397	
	2XSAOW- 10	22	20	.640	.681	.362	8.5	—	600	—	—	—	—	224-9204	
	2XSAOW- 14	22	28	.640	.743	.442	9.0	—	600	—	—	—	—	225-1398	
	2XSAOW- 19	22	38	.640	.817	.545	10.0	—	600	—	—	—	—	225-1399	
	2XSAOW- 24	22	48	.640	.952	.720	11.5	—	600	—	—	—	—	225-2204	
	2XSAOW- 30	22	60	.640	1.020	.833	12.5	—	600	—	—	—	—	229-8306	
	2XSAOW- 37	22	74	.640	1.090	.971	13.0	—	600	—	—	—	—	224-8340	
24640/15	2XSAW- 3	22	6	.640	.396	.112	3.5	STD-2	600	—	—	—	—	225-2202	
	2XSAW- 7	22	14	.640	.497	.195	4.0	STD-2	600	—	—	—	—	225-2203	
	2XSAW- 14	22	28	.640	.691	.384	5.5	STD-2	600	—	—	—	—	225-1394	
24640/15	2XSAWA- 3	22	6	.640	.446	.148	3.5	STD-2	600	—	—	—	—	224-9202	
	2XSAWA- 7	22	14	.640	.547	.244	4.0	STD-2	600	—	—	—	—	224-9203	
	2XSAWA- 14	22	28	.640	.741	.445	5.0	STD-2	600	—	—	—	—	225-1395	
24640/16	2XSOW- 3	18	6	1.620	.525	.227	6.5	STD-2	600	—	—	—	—	224-8311	
	2XSOW- 7	18	14	1.620	.656	.401	8.0	STD-2	600	—	—	—	—	224-8312	
	2XSOW- 12	18	24	1.620	.864	.626	10.5	STD-2	600	—	—	—	—	224-8313	
	2XSOW- 19	18	38	1.620	1.010	.884	12.5	STD-2	600	—	—	—	—	224-9181	
	2XSOW- 30	18	60	1.620	1.270	1.378	15.5	STD-2	600	—	—	—	—	225-1376	
24640/16	2XSW- 1	18	2	1.620	0.258	0.053	2.0	STD-2	600	—	—	—	—	224-8308	
	2XSW- 3	18	6	1.620	.470	.167	4.0	STD-2	600	—	—	—	—	224-8309	
	2XSW- 7	18	14	1.620	.617	.318	5.0	STD-2	600	—	—	—	—	225-8947	
24640/16	2XSWA- 1	18	2	1.620	.308	.069	2.0	STD-2	600	—	—	—	—	229-8294	

See footnote at end of table.

TABLE VII (b)(I). MIL-C-24640 cable ratings and characteristics, watertight, non-flexing service, (electronic, communication, and instrumentation). - Continued

MIL-C-	Cable type designation	Conductor size: AWG or MCM	Number of conductors in cable	Area of each conductor (MCM)	Cable overall diameter, max. (inches)	Cable weight per ft maximum (lbs)	Radius of bend min. (inches)	CDR ID	Rated voltage, max. (RMS)	Ampacity, each conductor (amps. max.)				NSN 6145-01	
										dc or 60 Hz		400 Hz			
										40°C Ambient	50°C Ambient	40°C Ambient	50°C Ambient		
24640/16	2XSWA- 3 2XSWA- 7	18 18	6 14	1.620 1.620	.520 .667	0.210 375	4.0 5.0	STD-2 STD-2	600 600	-1 -1	-1 -1	-1 -1	-1 -1	225-8948 224-8310	
24640/18	3XSOW- 3 3XSOW- 7 3XSOW- 10 3XSOW- 14 3XSOW- 19 3XSOW- 24	18 18 18 18 18 18	9 21 30 42 57 72	1.620 1.620 1.620 1.620 1.620 1.620	.559 .711 .901 .968 1.090 1.300	.271 .472 .702 .860 1.127 1.489	7.0 8.5 11.0 12.0 13.0 16.0	STD-2 STD-2 STD-2 STD-2 STD-2 STD-2	600 600 600 600 600 600	-1 -1 -1 -1 -1 -1	-1 -1 -1 -1 -1 -1	-1 -1 -1 -1 -1 -1	-1 -1 -1 -1 -1 -1	224-9182 224-9183 224-8314 224-8315 224-8316 224-9184	
24640/18	3XSW- 3 3XSW- 7 3XSW- 10 3XSW- 14	18 18 18 18	9 21 30 42	1.620 1.620 1.620 1.620	0.508 .668 .865 .941	0.202 .387 .613 .770	4.0 5.5 7.0 7.5	STD-2 STD-2 STD-2 STD-2	600 600 600 600	-1 -1 -1 -1	-1 -1 -1 -1	-1 -1 -1 -1	-1 -1 -1 -1	225-8949 225-8950 225-4894 225-2660	
24640/18	3XSWA- 3 3XSWA- 7 3XSWA- 10 3XSWA- 14	18 18 18 18	9 21 30 42	1.620 1.620 1.620 1.620	.558 .718 .915 .991	.255 .458 .701 .873	4.0 5.5 7.0 7.5	STD-2 STD-2 STD-2 STD-2	600 600 600 600	-1 -1 -1 -1	-1 -1 -1 -1	-1 -1 -1 -1	-1 -1 -1 -1	225-2661 225-4261 225-2662 225-2663	

See footnote at end of table.

TABLE VII (c)(1). MIL-C-24640 cable ratings and characteristics
non-watertight, non-flexing service, (power).
- Continued

MIL-C-	Cable type designation	Conductor size: AWG or MCM	Number of conductors in cable	Area of each conductor (MCM)	Cable overall diameter max. (inches)	Cable weight per ft maximum (lbs)	Radius of bend min. (inches)	CDR ID	Rated voltage, max. (RMS)	Ampacity, each conductor (amps. max.)				NSN 6145-01	
										dc or 60 Hz		400 Hz			
										40°C Ambient	50°C Ambient	40°C Ambient	50°C Ambient		
24640/1	DX- DX-	3 4	16 14	2 2	2.580 4.110	.041 .286	.039 .057	2.0 2.5	STD-1 STD-1	600 600	13 22	12 20	13 22	12 20	224-6905 224-6906
24640/1	DXA- DXA-	3 4	16 14	2 2	2.580 4.110	.291 .336	.054 .074	2.0 2.5	STD-1 STD-1	600 600	13 22	12 20	13 22	12 20	224-9180 224-6907
24640/3	FX- FX-	3 4	16 14	4 4	2.580 4.110	.282 .335	.063 .093	2.5 3.0	STD-1 STD-1	600 600	11 18	10 17	11 18	10 17	224-6912 224-6913
24640/3	FXA- FXA-	3 4	16 14	4 4	2.580 4.110	.332 .383	.080 .113	2.5 3.0	STD-1 STD-1	600 600	13 22	12 20	13 22	12 20	224-6914 225-2147
24640/2	TX- TX-	3 4	16 14	3 3	2.580 4.110	.261 .310	.052 .076	2.0 2.5	STD-1 STD-1	600 600	11 18	10 17	11 18	10 17	224-6908 224-6909
24640/2	TXA- TXA-	3 4	16 14	3 3	2.580 4.110	.311 .360	.068 .095	2.0 2.5	STD-1 STD-1	600 600	11 18	10 17	11 18	10 17	224-6910 224-6911

See footnote at end of table.

TABLE VII (c)(2). MIL-C-24640 cable ratings and characteristics
non-watertight, non-flexing service, (electronic, communication,
and instrumentation) - Continued

MIL-C-	Cable type designation	Conductor size: AWG or MCM	Number of conductors in cable	Area of each conductor (MCM)	Cable overall diameter max. (inches)	Cable weight per ft maximum (lbs)	Radius of bend min. (inches)	CDR ID	Rated voltage, max. (RMS)	Ampacity, each conductor (amps. max.)				NSN 6145-01	
										dc or 60 Hz		400 Hz			
										40°C Ambient	50°C Ambient	40°C Ambient	50°C Ambient		
24640/7	1XMSO- 1XMSO- 1XMSO-	7 16 70	22 22 22	7 16 70	.640 .640 .640	.370 .507 .925	.0113 .208 .661	4.5 6.0 11.0	STD-1 STD-1 STD-1	600 600 600	— — —	— — —	— — —	226-2650 226-2651 226-7409	
24640/6	2XAO- 2XAO- 2XAO- 2XAO- 2XAO-	2 7 10 18 40	22 22 22 22 22	2 7 10 18 40	.640 .640 .640 .640 .640	.331 .422 .511 .611 .858	.079 .125 .170 .245 .449	4.0 5.0 6.0 7.5 10.5	— — — — —	600 600 600 600 600	— — — — —	— — — — —	— — — — —	225-0964 225-0965 224-8337 224-8338 225-0966	
24640/12	2XO- 2XO- 2XO- 2XO- 2XO- 2XO-	6 18 24 42 60 77	26 26 26 26 26 26	12 36 48 84 120 154	.278 .278 .278 .278 .278 .278	.329 .449 .509 .609 .691 .785	.062 .140 .171 .245 .312 .395	4.0 5.5 6.0 7.5 8.5 9.5	— — — — — —	600 600 600 600 600 600	— — — — — —	— — — — — —	— — — — — —	225-2196 225-4904 224-9199 224-9200 223-2197 225-2198	
24640/9	2XS- 2XS- 2XS- 2XS- 2XS- 2XS- 2XS- 2XS-	2 3 7 10 14 19 24 30	22 22 22 22 22 22 22 22	4 5 14 20 28 38 48 60	.640 .640 .640 .640 .640 .640 .640 .640	.332 .350 .455 .579 .627 .694 .818 .866	.061 .074 .132 .193 .240 .308 .390 .468	3.0 3.0 4.0 5.0 5.0 5.5 6.5 7.0	STD-2 STD-2 STD-2 STD-2 STD-2 STD-2 STD-2 STD-2	600 600 600 600 600 600 600 600	— — — — — — — —	— — — — — — — —	— — — — — — — —	225-0967 225-2193 225-0968 225-0969 225-1387 225-3452 224-9191 224-9192	
24640/9	2XSA- 2XSA- 2XSA- 2XSA- 2XSA- 2XSA- 2XSA- 2XSA-	2 3 7 10 14 19 24 30	22 22 22 22 22 22 22 22	4 6 14 20 28 38 48 60	.640 .640 .640 .640 .640 .640 .640 .640	.382 .400 .505 .629 .677 .744 .868 .916	.081 .102 .176 .229 .280 .360 .443 .531	3.0 3.0 4.0 5.0 5.0 5.5 6.5 7.0	STD-2 STD-2 STD-2 STD-2 STD-2 STD-2 STD-2 STD-2	600 600 600 600 600 600 600 600	— — — — — — — —	— — — — — — — —	— — — — — — — —	225-1388 225-1389 225-1390 225-1391 225-1392 225-6388 225-2194 224-9193	
24640/9	2XSO- 2XSO- 2XSO-	3 7 10	22 22 22	6 14 20	.640 .640 .640	.410 .510 .640	.117 .184 .262	5.0 6.0 8.0	STD-2 STD-2 STD-2	600 600 600	— — —	— — —	— — —	224-9194 224-9195 224-9196	

MIL-HDBK-299(SH)
3 April 1989

26

See footnote at end of table.

TABLE VII (c)(2). MIL-C-24640 cable ratings and characteristics,
non-watertight, non-flexing service, (electronic,
communication, and instrumentation). - Continued

MIL-C-	Cable type designation	Conductor size: AWG or MCM	Number of conductors in cable	Area of each conductor (MCM)	Cable overall diameter max. (inches)	Cable weight per ft maximum (lbs)	Radius of bend min. (inches)	CDR ID	Rated voltage, max. (RMS)	Ampacity, each conductor (amps. max)				NSN 6145-01	
										dc or 60 Hz		400 Hz			
										40°C Ambient	50°C Ambient	40°C Ambient	50°C Ambient		
24640/9	2XSO- 2XSO- 2XSO-	14 19 30	22 22 22	28 38 60	0.640 .640 .640	0.686 .765 .937	0.301 .383 .554	8.5 9.5 11.5	STD-2 STD-2 STD-2	600 600 600	- - -	- - -	- - -	224-9197 224-9198 225-2195	
24640/13	2XSXO-	4	26	4 PAIR	.278	.359	.101	4.5	STD-2	600	- - -	- - -	- - -	224-9201	
24640/11	3XS-	7	18	7 TRIADS	1.620	.647	.289	8.0	STD-2	600	- - -	- - -	- - -	225-2150	
24640/11	3XSA-	7	18	7 TRIADS	1.620	.697	.342	8.5	STD-2	600	- - -	- - -	- - -	225-8946	
24640/8	MXO- MXO-	10 14	20 20	10 14	1.020 1.020	.377 .410	.118 .147	4.5 5.0	STD-2 STD-2	600 600	- - -	- - -	- - -	227-5743 224-8339	
24640/10	MXSO- MXSO- MXSO- MXSO-	2 9 21 37	16 16 16 16	2 9 21 37	2.580 2.580 2.580 2.580	.304 .458 .596 .694	.076 .176 .329 .473	4.0 5.5 7.5 8.5	STD-1 STD-1 STD-1 STD-1	600 600 600 600	- - - -	- - - -	- - - -	225-2148 225-2149 225-1377 225-1378	
24640/4	TTX- TTX-	3 15	20 20	3 PAIR 15 PAIR	1.020 1.020	.320 .591	.062 .221	2.5 5.0	TEL-3 TEL-3	600 600	5/4.0 1/ 5/0.6	4/3.0 1/ 4/0.3	5/4.0 1/ 5/0.6	4/3.0 1/ 4/0.3	225-2190 225-1393
24640/4	TTXA- TTXA-	3 15	20 20	3 PAIR 15 PAIR	1.020 1.020	.370 .641	.082 .275	2.5 5.0	TEL-3 TEL-3	600 600	5/4.0 5/0.6	4/3.0 4/0.3	5/4.0 5/0.6	4/3.0 4/0.3	225-2191 224-6916
24640/5	TTXS- TTXS-	2 4	20 20	2 PAIR 4 PAIR	1.020 1.020	.361 .424	.074 .115	3.0 3.5	STD-2 STD-2	600 600	- - -	- - -	- - -	224-6917 226-5038	
24640/5	TTXSA- TTXSA-	2 4	20 20	2 PAIR 4 PAIR	1.020 1.020	.411 .474	.100 .150	3.5 4.0	STD-2 STD-2	600 600	- - -	- - -	- - -	224-8334 224-8335	
24640/5	TTXSO- TTXSO- TTXSO- TTXSO-	2 6 8 10	20 20 20 20	2 PAIR 6 PAIR 8 PAIR 10 PAIR	1.020 1.020 1.020 1.020	.416 .546 .633 .675	.126 .216 .284 .311	5.0 6.5 8.0 8.0	STD-2 STD-2 STD-2 STD-2	600 600 600 600	- - - -	- - - -	- - - -	224-8336 225-2192 225-0563 226-7408	

^{1/} Ind/Avg indicates the maximum current for each conductor (Ind), and the maximum current (Avg) for each conductor when all conductors in the cable are used.

5.8 Cable classification (MIL-C-915). Cables specified in MIL-C-915 are listed in table VIII under the following general classifications:

- (a) Watertight, flexing service:
 - (1) power.
 - (2) control.
 - (3) electronic, communication and instrumentation.
- (b) Non-watertight, flexing service:
 - (1) power and lighting.
 - (2) electronic, communication, and instrumentation.
- (c) Non-watertight, non-flexing service:
 - (1) electronic, communication, and instrumentation.
- (d) Watertight, non-flexing service:
 - (1) electronic, communication, and instrumentation.

TABLE VIII (a)(1). MIL-C-915 cable ratings and characteristics
watertight, flexing service, (power).

MIL-C-	Cable type designation	Conductor size: AWG or MCM	Number of conductors in cable	Area of each conductor (MCM)	Cable overall diameter max. (inches)	Cable weight per ft maximum (lbs)	Radius of bend min. (inches)	CDR ID	Rated voltage, max. (RMS)	Ampacity, each conductor (amps, max)				NSN 6145-01	
										dc or 60 Hz		400 Hz			
										40°C Ambient	50°C Ambient	40°C Ambient	50°C Ambient		
915/7	DSWS- 4	14	2	4.110	0.800	0.030	3.0	STD-1	HIGH VOLTAGE	—	—	—	—	#776-8513 —	
915/10	MCSF- 4	6 1	2 2	26.240 83.690	1.500	1.625	12.0	STD-3	600	—	—	—	—	#802-2059 —	

MIL-HDBK-299 (SH)
3 April 1989

TABLE VIII (a)(2). MIL-C-915 cable ratings and characteristics,
watertight, flexing service (control).

MIL-C-	Cable type designation	Conductor size: AWG or MCM	Number of conductors in cable	Area of each conductor (MCM)	Cable overall diameter max. (inches)	Cable weight per ft maximum (lbs)	Radius of bend min. (inches)	CDR ID	Rated voltage, max. (RMS)	Ampacity, each conductor (amps. max)				NSN 6145-01	
										dc or 60 Hz		400 Hz			
										40°C Ambient	50°C Ambient	40°C Ambient	50°C Ambient		
915/38	MWP-7	18	7	1.620	0.500	0.145	15	STD-1	600	15	15	15	15	#995-2543	
	MWP-10	18	10	1.620	.433	.230	20	STD-1	600	2.0	2.0	2.0	2.0	162-4794	
	MWP-14	18	14	1.620	.433	.250	25	STD-1	600	2.0	2.0	2.0	2.0	#985-8320	
	MWP-19	18	19	1.620	.743	.350	25	STD-1	600	2.5	2.5	2.5	2.5	#980-8339	
	MWP-24	18	24	1.620	.836	.430	25	STD-1	600	2.5	2.5	2.5	2.5	#985-8318	
	MWP-30	18	30	1.620	.943	.550	30	STD-1	600	3.0	3.0	3.0	3.0	#084-1342	
	MWP-37	18	37	1.620	1.043	.680	35	STD-1	600	3.5	3.5	3.5	3.5	154-4373	

MIL-HDBK-299 (SH)
 3 April 1989

TABLE VIII (a)(3). MIL-C-915 cable ratings and characteristics
watertight, flexing service (electronic, communication,
and instrumentation). - Continued

MIL-C-	Cable type designation	Conductor size: AWG or MCM	Number of conductors in cable	Area of each conductor (MCM)	Cable overall diameter max. (inches)	Cable weight per ft maximum (lbs)	Radius of bend min. (inches)	CDR ID	Rated voltage, max. (RMS)	Ampacity, each conductor (amps. max.)				NSN 6145-01	
										dc or 60 Hz		400 Hz			
										40°C Ambient	50°C Ambient	40°C Ambient	50°C Ambient		
915/47	1SWP-	2	22	2	.700	.625	.168	2.0	STD-2	300	-	-	-	#051-4815	
915/48	2SWP-	3	22	6	.700	.625	.200	2.0	STD-2	300	-	-	-	158-6329	
	2SWP-	4	22	8	.700	.625	.211	2.0	STD-2	300	-	-	-	#985-7926	
	2SWP-	7	22	14	.700	.815	.366	2.5	STD-2	300	-	-	-	#984-4662	
	2SWP-	24	22	48	.700	1.250	.620	7.5	STD-2	300	-	-	-		
915/8	7SS-	2	18	7	1.620	0.625	.185	1.5	SPL-3	600	-	-	-	#905-6797	
915/8	DSS-	2	18	2	1.620	.390	.120	1.0	SPL-3	600	6	5	-	#914-9973	
	DSS-	3	16	2	2.580	.500	.160	1.5	SPL-3	600	9	8	-	#912-2616	
	DSS-	4	14	2	4.110	.500	.180	1.5	SPL-3	600	13	11	-	#913-2401	
915/8	PSS-	2	18	4	1.620	.500	.180	1.5	SPL-3	600	5	4	-	#913-2402	
	PSS-	3	16	4	2.580	.500	.210	1.5	SPL-3	600	8	7	-	159-6655	
	PSS-	4	14	4	4.110	.625	.240	2.0	SPL-3	600	13	11	-	#985-7843	
915/61	S2S		18	1	1.620	.500	1.000	3.0	SPL-3	600	-	-	-	155-3526	
915/79	TPUM-	6	16	12	1.700	.925	.125	7.5	TEL-1	600	-	-	-	156-7864	
915/8	TSS-	2	18	3	1.620	.400	.140	1.0	SPL-3	600	6	5	-	162-2600	
	TSS-	3	16	3	2.580	.500	.180	1.5	SPL-3	600	9	8	-	159-8619	
	TSS-	4	14	3	4.110	.500	.200	1.5	SPL-3	600	13	11	-	#905-6795	

**TABLE VIII (b)(1). MIL-C-915 cable ratings and characteristics,
non-watertight, flexing service, (power and lighting).**
- Continued

MIL-C-	Cable type designation	Conductor size AWG or MCM	Number of conductors in cable	Area of each conductor (MCM)	Cable overall diameter max. (inches)	Cable weight per ft maximum (lbs)	Radius of bend min. (inches)	CDR ID	Rated voltage, max. (RMS)	Ampacity, each conductor (amps. max.)		NSN 6145-01	
										dc or 60 Hz			
										40°C Ambient	50°C Ambient		
915/1	CVSP- 4	5 3	1 3	33.090 32.620	1.450 —	1300 —	9.0 —	STD-3 ^{1/2}	600	100 —	75 —	#191-2037	
915/9 ³	JAS- 250	12 250	2 2	6.530 250.000	1.260 1.480	0.917 —	10.0 20.0	STD-4 STD-3	600 600	— —	— —	#753-2264	
915/6	THOP- 42 THOP- 400 THOP- 500	42 400 500	3 3 3	42.100 413.500 300.000	1.250 2.800 3.100	.958 3.950 7.100	10.0 22.0 25.0	STD-3 ^{1/2} STD-3 ^{1/2} STD-3 ^{1/2}	600 600 600	93 400 500	86 365 450	93 315 350	86 265 275
915/20	TRF- 105 TRF- 133 TRF- 168	0 00 000	1 1 1	105.600 133.100 167.800	0.760 .810 .860	0.510 618 704	6.0 6.5 7.0	— — —	600 600 600	143 167 201	121 141 170	— — —	#943-7407 #956-3431 #928-9103
915/21	TRXF- 84 TRXF- 105 TRXF- 133	1 1 1	1 1 1	83.700 105.600 133.100	.600 .680 .750	.360 460 567	5.0 5.5 6.0	— — —	125 125 125	130 143 167	110 121 141	— — —	#914-9010 #913-2065 #914-0517
915/5	DLT	18	4	1.620	.710	.050	6.0	STD-3	300	— —	— —	—	#574-2040

See footnotes at end of table.

TABLE VIII (b)(2). MIL-C-915 cable ratings and characteristics,
non-watertight, flexing service (electronic, communication
and instrumentation). - Continued

MIL-C-	Cable type designation	Conductor size: AWG or MCM	Number of conductors in cable	Area of each conductor (MCM)	Cable overall diameter max. (inches)	Cable weight per ft maximum (lbs)	Radius of bend min. (inches)	CDR ID	Rated voltage, max (RMS)	Ampacity, each conductor (amps, max)				NSN 6143-01	
										dc or 60 Hz		400 Hz			
										40°C Ambient	50°C Ambient	40°C Ambient	50°C Ambient		
915/74	SSS	18	5	1.620	0.560	0.240	2.0	STD-3	600	--	--	--	--	153-4488	

See footnotes at end of table.

TABLE VIII (c)(1). MIL-C-915 cable ratings and characteristics, non-watertight, non-flexing service (electronic communication and instrumentation). - Continued

MIL-C-	Cable type designation	Conductor size; AWG or MCM	Number of conductors in cable	Area of each conductor (MCM)	Cable overall diameter max. (inches)	Cable weight per ft maximum (lbs)	Radius of bend min. (inches)	CDR ID	Rated voltage, max. (RMS)	Ampacity, each conductor (amps. max.)		NSN 6145-01	
										dc or 60 Hz	400 Hz		
9LS/67	MSP	22 20 16	16 18 23	0.700 1.111 2.580	1.635 1. 1.	1.300 1. 1.	10.5 1. 1.	1-1-1	— — —	— — —	— — —	#791-3234	

See footnotes at end of table.

MIL-HDBK-299(SH)
3 April 1989

TABLE VIII (d)(1). MIL-C-915 cable ratings and characteristics,
watertight, non-flexing service (electronic,
communication, and instrumentation). - Continued

MIL-C-	Cable type designation	Conductor size: awg or MCM	Number of conductors in cable	Area of each conductor (MCM)	Cable overall diameter max. (inches)	Cable weight per ft maximum (lbs)	Radius of bend min. (inches)	CDR ID	Rated voltage, max. (RMS)	Ampacity, each conductor (amps, max)		NSN 6145-01	
										dc or 60 Hz			
										40°C Ambient	50°C Ambient		
915/66	MSPW	22 20 16	16 18 23	0.700 1.111 2.580	1.635	1.500	10.5	STD-3	—	—	—	#791-3233	
915/22	TSP-TSP-	11 31	22 23	0.640 .640	0.730	0.275 .611	4.5 .65	—	300	4/1 ^{2/}	30.5 ^{3/}	#916-7217 #940-8711	
915/22	TSPA-TSPA-	11 31	22 23	.640 .640	0.780	.310 1.112	4.0 .65	—	300	4/1	30.5	156-9581 155-8741	

1/ Identification may be STD-3 or STD-4, manufacturer's option.

2/ Ind/Avg indicates the maximum current for each conductor (Ind), and the maximum current (Avg) for each conductor when all conductors in the cable are used.

3/ Oval shape, minor and major diameter.

5.9 Ampacity rating. To obtain the ampacity rating for an ambient temperature of either 60 or 70°C, first determine the ampacity rating for 40°C ambient from tables VI, VII, or VIII. Then multiply that value by the applicable derating factor shown in table IX. Cables listed in this table should not be used in ambient temperatures above 70°C. Cables not listed in this table should not be used in ambient temperatures above 60°C. The ampacity derating factor does not change for those cables listed with armored variants.

TABLE IX. Ampacity derating factors for ambient temperatures above 50°C.

Cable type	Ambient temperature (°C)	
	60	70
LSDHOF	0.78	0.67
LSDNW	.78	.67
DX		
LSDSGU	.80	.69
DWX		
DSS	.63	--
FRW	.78	.67
LSFSGU	.80	.69
FXW		
FSS	.63	--
LSMDU	.72	--
LSMHOF	.80	.69
LSMNW	.78	.67
LSMSCU	.80	.69
MXCW		
LSSHOF	.78	.67
LSTHOF	.78	.67
LSTNW	.78	.67
TRF	.63	--
TRXF	.63	--
LSTSGU	.80	.69
TXW		
TSS	.63	--
LS5KVTSGU	.80	.69
LS6SGU	.80	.69
LS7SGU	.80	.69
7XW		
7SS	.63	--

MIL-HDBK-299(SH)
3 April 1989

TABLE X. Ampacities of degaussing cables.

(Maximum amperes for each conductor, at 40 and 50°C ambient temperatures)										
Cable type and size	1 cable in air		2 cables in air		3 or 4 cables in air		5 to 7 cables in air		1 cable in conduit of 8 or more cables in air	
	40°	50°	40°	50°	40°	50°	40°	50°	40°	50°
LSDSGU/A-14	66	61	60	56	55	51	49	46	46	43
23	86	79	79	73	72	67	64	60	61	56
50	139	128	128	119	117	109	104	97	98	90
75	185	171	170	159	156	146	139	130	132	122
100	219	201	202	187	184	171	164	153	155	143
200	339	312	312	290	285	265	254	237	241	222
LSTSGU/A-9	43	40	39	36	34	30	29	27	27	26
14	56	52	51	48	47	44	42	39	40	37
23	76	70	70	65	64	59	57	53	54	50
50	121	111	111	103	102	94	91	84	86	79
75	163	150	150	140	137	128	122	114	116	106
100	191	176	176	164	160	150	143	134	136	125
150	259	238	238	221	218	202	194	181	184	169
200	298	275	274	256	250	234	224	209	212	195
300	383	352	352	324	322	296	287	264	276	253
400	478	440	440	405	401	370	358	330	344	317
LSFSGU/A-9	43	40	41	38	38	36	36	34	34	32
23	76	70	72	67	68	63	64	60	61	56
50	121	112	115	107	109	101	103	95	97	90
75	163	151	154	144	146	136	138	129	130	121
100	191	178	182	169	172	160	162	151	153	142
150	258	240	245	228	232	216	220	204	207	192
200	298	277	283	263	268	249	253	235	238	221
LS6SGU/A-100	163	153	150	140	136	127	122	114	116	108
125	192	173	175	163	160	147	144	133	136	125
150	225	204	207	190	188	173	169	156	160	147
200	250	243	235	222	219	202	188	182	177	172
LSMDU-6	15	14	14	13	14	12	13	12	12	11
14	25	22	24	21	22	20	21	19	20	18
23	34	30	32	28	30	27	29	25	27	24
40	49	43	46	41	44	39	41	37	39	36
60	65	59	62	57	58	54	55	52	51	50

TABLE X. Ampacities of degaussing cables. - Continued

Cable type and size	(Maximum amperes for each conductor, at 40 and 50°C ambient temperatures)									
	1 cable in air		2 cables in air		3 or 4 cables in air		5 to 7 cables in air		1 cable in conduit of 8 or more cables in air	
	40°	50°	40°	50°	40°	50°	40°	50°	40°	50°
LSMDY-6	15	14	14	13	14	12	13	12	12	11
	14	25	22	24	21	22	20	19	20	18
	23	34	30	32	28	30	27	25	27	24
	40	49	43	46	41	44	39	37	39	36
	60	65	59	62	57	58	54	52	51	50
LSMSCU/A/S-7	9	8	8.5	7.5	8	7	7.5	7	7	6.5
	10	9	8	8.5	7.5	8	7	7.5	7	6.5
	14	9	8	8.5	7.5	8	7	7.5	7	6.6
	19	9	8	8.5	7.5	8	7	7.5	7	6.6
	24	9	8	8.5	7.5	8	7	7.5	7	6.5
	30	9	8	8.5	7.5	8	7	7	7	6.5
	37	9	8	8.5	7.5	8	7	7.5	7	6.5
	44	5.5	5	5.0	4.5	5	4.5	4.5	4.5	4.0

6. NOTES

6.1 Subject term (key word) listing.

Ampacity
 Cable, degaussing
 Cable, flexing service
 Cable, non-flexing service
 Codes, identification
 Conductor, multiple
 Insulation
 Jacket, armored
 Jacket, unarmored
 Non-watertight
 Shield, braided
 Watertight

Preparing activity:
 Navy - SH
 (Project 6145-N328)

MIL-HDBK-299(SH)
NOTICE 1
APPENDIX
15 OCTOBER 1991

ELECTRICAL CABLE VOLTAGE DROP CALCULATIONS

10. SCOPE

10.1 Scope. This appendix is intended for use as a guide to determining cable voltage drops for alternating current (ac) and direct current (dc) power, lighting, electronic, interior communication, and weapon control systems.

20. REFERENCED DOCUMENTS

20.1 Government documents.

This paragraph is not applicable to this appendix.

20.2 Nongovernment publications. The following documents form a part of this handbook to the extent specified herein. Unless otherwise specified, the issues of the documents which are DoD adopted are those listed in the issue of the DoDISS cited in the solicitation. Unless otherwise specified, the issues of documents not listed in the DoDISS are the issues of the documents cited in the solicitation.

American Society For Testing And Materials (ASTM)

ASTM B 8 - Standard Specification for Concentric-Lay-Stranded Copper Conductors, Hard, Medium-Hard, or Soft. (DoD adopted)

ASTM B 258 - Standard Specification for Standard Nominal Diameters and Cross-Sectional Areas of AWG Sizes of Solid Round Wire Used as Electrical Conductors.

(Application for copies should be addressed to the American Society for Testing and Materials, 1916 Race Street, Philadelphia PA 19103)

(Nongovernment standards and other publications are normally available from the organizations that prepare or distribute the documents. These documents may be available in or through libraries or other informational services).

MIL-HDBK-299(SH)
 NOTICE 1
 APPENDIX
 15 OCTOBER 1991

30. DEFINITIONS

30.1 Symbols and Abbreviations. The symbols and abbreviations used in this appendix are as follows:

<u>Symbols</u>	<u>Parameter</u>	<u>Units</u>
A	- Cross-sectional area of a conductor.	Cmil
D%	- Cable voltage drop expressed in percent with respect to system or source voltage.	--
DF	- Cable drop factor for equation using current.	(Amp.ft) ⁻¹
DF'	- Cable drop factor for equation using power.	(Watt.ft) ⁻¹
d	- Conductor diameter.	Mils
E	- Line-to-neutral rated voltage at the switchboard of a three-phase system or rated voltage of a single single-phase or dc system.	Volt
E _x	- Line-to-line rate voltage of a three-phase system (E_{AB} , E_{BC} , E_{CA}).	Volt
I	- Line current (I_A , I_B or I_C).	Ampere
I _{LO}	- Resultant load currents for each phase (leg) of a three-phase, delta circuit (I_{AB} , I_{BC} or I_{CA}).	Ampere
I _x	- Difference in two line currents of a three-phase system ($I_A - I_B$, $I_B - I_C$, $I_C - I_A$).	Ampere
L	- Cable length.	Feet
P	- Real power for each phase (leg) load of a three-phase delta circuit (P_{AB} , P_{BC} or P_{CA}).	Watt
P _x	- Net real power in two lines of a three-phase, delta system ($P_A - P_B$, $P_B - P_C$, $P_C - P_A$).	Watt
pf	- Load power factor.	--
Q	- Reactive power for each phase (leg) load of a three-phase, delta circuit (Q_{AB} , Q_{BC} or Q_{CA}).	Var

MIL-HDBK-299(SH)
 NOTICE 1
 APPENDIX
 15 OCTOBER 1991

Q_x	- Net reactive power in two lines of a three-phase, delta system ($Q_A - Q_B$, $Q_B - Q_C$, $Q_C - Q_A$).	Var
R	- Total cable resistance per phase.	Ohm
R_{dc}	- Conductor dc resistance.	Ohm
S	- Apparent power for each phase (leg) load of a three-phase, delta circuit (S_{AB} , S_{BC} or S_{CA}).	Volt-amp
V	- Terminal voltage or load voltage.	Volt
V_{AN}	- Line-to-neutral terminal load voltage for phase A of a three-phase four-wire system.	Volt
X	- Total cable reactance per phase.	Ohm
Z	- Total cable impedance per phase.	Ohm
z	- Cable impedance per phase per foot.	Ohm/ft
Z_{LO}	- Load impedance in each phase (leg) of a three-phase delta circuit (Z_{AB} , Z_{BC} , Z_{CA}).	Ohm
Z_{AN}	- Load impedance in phase A of a three-phase, four-wire (wye) circuit.	Ohm
α	- Angle between terminal load voltage and cable voltage drop (IZ).	Degree
α_x	- Angle between terminal load voltage and cable voltage drop ($I_x Z$).	Degree
β	- Cable impedance angle.	Degree
σ	- Mass density of a selected material.	g/cm^3
θ	- Load power factor angle or angle between load voltage and line current.	Degree
θ_x	- Angle between terminal load voltage and current I_x .	Degree
ρ	- Resistivity of a selected material at desired operating temperature.	Ohm.ft
ρ_0	- Resistivity of a selected material at 20°C.	Ohm.ft

MIL-HDBK-299 (SH)
NOTICE 1
APPENDIX
15 OCTOBER 1991

40. GENERAL EQUATIONS FOR CABLE VOLTAGE DROP CALCULATIONS

40.1 Voltage drop calculations for dc systems. The voltage drop for dc circuits is calculated from the following equations as derived in section 80.

40.1.1 Two-wire circuits.

- For all systems except power.

$$D\% = 22.78 \left(\frac{IL}{AE} \right) * 100 \quad (80-5)$$

- For power systems only.

$$D\% = 24.42 \left(\frac{IL}{AE} \right) * 100 \quad (80-6)$$

40.2 Voltage drop calculations for ac systems. The voltage drops for ac circuits are calculated from the following equations as derived in appropriate sections 90, 100, 110, and 120:

40.2.1 Single-phase circuits.

- For all systems.

$$D\% = 2IL \left(\frac{Z\cos(\alpha)}{E} \right) * 100 \quad (90-9)$$

40.2.2 Three-phase circuits.

- Voltage drop in each line for balanced systems such as electronic, interior communication, weapon control systems.

$$D\% = \sqrt{3}I_{LO}L \left(\frac{Z\cos(\alpha)}{E} \right) * 100 \quad (90-10)$$

- Voltage drop in each line for all systems.

MIL-HDBK-299(SH)
 NOTICE 1
 APPENDIX
 15 OCTOBER 1991

$$D\% = IL \left(\frac{z \cos(\alpha)}{E} \right) * 100 \quad (100-10)$$

- Voltage drop in each phase for all systems.

$$D\% = I_x L \left(\frac{z \cos(\alpha_x)}{E_x} \right) * 100 \quad (100-17)$$

40.3 Voltage drop calculations using drop factors. The following simplified equations are used for percent drop calculations in lighting and power systems in conjunction with the cable drop factors listed in tables XIII through XVII.

40.3.1 Lighting systems.

40.3.1.1 Single-phase circuit.

$$D\% = 2IL(DF) \quad \text{Table XVI.}$$

$$D\% = 2PL(DF') \quad \text{Table XVII.}$$

40.3.1.2 Three-phase circuit.

$$D\% = I_x L(DF) \quad \text{Table XVI.}$$

$$D\% = P_x L(DF') \quad \text{Table XVII.}$$

40.3.2 Power Systems.

40.3.2.1 Three-phase circuit. The drop in each line is:

$$D\% = IL(DF) \quad \text{Tables XIII, XIV, and XV.}$$

Where:

- I , I_{LO} , I_x , θ , α , θ_x , and α_x are calculated in section 50.
- P and P_x are calculated in 110.
- DF and DF' are calculated and tabulated in 70.1.

50. CURRENT CALCULATIONS FOR AC SYSTEMS

50.1 Single-phase circuits. The line current (I) used in the voltage drop equations is the scalar magnitude of current (I_{LO}) obtained by adding vectorially all load currents in the branch:

$$I = I_{LO}$$

The angles θ , α , and β are calculated from the following equations as derived in section 90.:

$$\theta = \cos^{-1}(\text{pf}), \quad \beta = \tan^{-1}(X/R)$$

$$\alpha = -\theta + \beta$$

(90-2)

θ is positive if the load power factor (pf) is lagging.
 θ is negative if the load power factor (pf) is leading.

50.2 Three-phase-delta circuits.

50.2.1 Balanced systems. If the system is balanced, the magnitude of the line current is equal to:

$$I = \sqrt{3}I_{LO} = \sqrt{3}I_{AB} = \sqrt{3}I_{BC} = \sqrt{3}I_{CA}$$

The total load currents \bar{I}_{AB} , \bar{I}_{BC} , and \bar{I}_{CA} are the vectorial sum of all the currents in their respective phase (leg) loads. If the load power factor angles in legs AB, BC, and CA are θ_{AB} , θ_{BC} , and θ_{CA} respectively, the phase load currents can be written as:

$$\bar{I}_{AB} = I_{AB}/(0^\circ - \theta_{AB}), \quad \bar{I}_{BC} = I_{BC}/(-120^\circ - \theta_{BC}), \quad \bar{I}_{CA} = I_{CA}/(120^\circ - \theta_{CA})$$

Similarly, the phase voltages \bar{V}_{AB} , \bar{V}_{BC} , and \bar{V}_{CA} are defined as:

$$\bar{V}_{AB} = V_{AB}/0^\circ, \quad \bar{V}_{BC} = V_{BC}/-120^\circ, \quad \text{and} \quad \bar{V}_{CA} = V_{CA}/120^\circ$$

MIL-HDBK-299(SH)
 NOTICE 1
 APPENDIX
 15 OCTOBER 1991

50.2.2 Balanced/unbalanced systems. If the system is unbalanced or balanced, the magnitude of line currents I and the associated angles Θ and α are calculated from the following equations as derived in section 100:

$$\bar{I}_A = \bar{I}_{AB} - \bar{I}_{CA}, \quad (100-7)$$

$$\Theta_A = 0^\circ - /I_A-$$

$$\alpha_A = -\Theta_A + \beta$$

$$\bar{I}_B = \bar{I}_{BC} - \bar{I}_{AB}, \quad (100-8)$$

$$\Theta_B = -120^\circ - /I_B-$$

$$\alpha_B = -\Theta_B + \beta$$

$$\bar{I}_C = \bar{I}_{CA} - \bar{I}_{BC}, \quad (100-9)$$

$$\Theta_C = 120^\circ - /I_C-$$

$$\alpha_C = -\Theta_C + \beta$$

The currents I_x and the associated angles Θ_x and α_x are calculated as follows:

$$\bar{I}_{x(AB)} = \bar{I}_A - \bar{I}_B, \quad (100-12)$$

$$\Theta_{x(AB)} = 0^\circ - /I_{x(AB)}-$$

$$\alpha_{x(AB)} = -\Theta_{x(AB)} + \beta$$

$$\bar{I}_{x(BC)} = \bar{I}_B - \bar{I}_C \quad (100-13)$$

$$\Theta_{x(BC)} = -120^\circ - /I_{x(BC)}-$$

$$\alpha_{x(BC)} = -\Theta_{x(BC)} + \beta$$

MIL-HDBK-299(SH)
NOTICE 1
APPENDIX
15 OCTOBER 1991

$$\bar{I}_{x(CA)} = \bar{I}_C - \bar{I}_{A'} \quad (100-14)$$

$$\theta_{x(CA)} = 120^\circ - \angle I_{x(CA)}$$

$$\alpha_{x(CA)} = -\theta_{x(CA)} + \beta$$

50.3 Three-phase four-wire circuits. The individual line currents (I) are calculated from the following equation as derived in section 120.:

$$I = I_{LO} = \frac{V_{AN}}{Z_{AN}} \quad (120-3)$$

50.4 Example of voltage drop calculations. The following example is a sample calculation of percent voltage drop for a three-phase lighting system (See figures 3 and 4 in section 100).

Step 1.

Determine the load current (I_{LO}) in each phase by adding vectorially all the connected load currents in that phase. Let assume the total load current for each phase as follows:

$$I_{AB} = 6.16A$$

$$I_{BC} \approx 5.7A$$

$$I_{CA} = 9.5A$$

Also the following parameters are given in Table XVI:

Cable type : LSTSGU-9

Length: $L = 45ft$

Impedance: $z = 1.120(10^{-3}) \Omega/ft$

Angle: $\beta = 1.82^\circ$

MIL-HDBK-299(SH)
 NOTICE 1
 APPENDIX
 15 OCTOBER 1991

Step 2.

Calculate phase load currents. Let the terminal load voltages be:

$$\bar{V}_{AB} = V_{AB}/0^\circ$$

$$\bar{V}_{BC} = V_{BC}/-120^\circ$$

$$\bar{V}_{CA} = V_{CA}/120^\circ$$

Assume load power factor for each phase of 0.80 lagging, the phase currents with respect to their respective terminal voltages can be written as follows:

$$\bar{I}_{AB} = I_{AB}/0^\circ - \theta_{AB} = 6.16/-37^\circ$$

$$\bar{I}_{BC} = I_{BC}/-120^\circ - \theta_{BC} = 5.7/-157^\circ$$

$$\bar{I}_{CA} = I_{CA}/120^\circ - \theta_{CA} = 9.5/83^\circ$$

Where $\theta_{AB} = \theta_{BC} = \theta_{CA} = \cos^{-1}(0.80) = 37^\circ$.

Step 3.

Determine line current I , angles θ and angle α from equations (100-7), (100-8), and (100-9) respectively after converting the phase currents from their polar forms to rectangular forms.

$$\bar{I}_{AB} = 6.16/-37^\circ = 4.92 - j3.71$$

$$\bar{I}_{BC} = 5.7/-157^\circ = -5.25 - j2.23$$

$$\bar{I}_{CA} = 9.5/83^\circ = 1.16 + j9.43$$

The line currents are calculated as follows:

$$\begin{aligned} \bar{I}_A &= \bar{I}_{AB} - \bar{I}_{CA}, & (100-7) \\ &= (4.92 - j3.71) - (-1.16 + j9.43) \end{aligned}$$

MIL-HDBK-299(SH)
 NOTICE 1
 APPENDIX
 15 OCTOBER 1991

$$\bar{I}_A = 3.76 - j13.14 \\ = 13.67/285.97^\circ$$

and,

$$\Theta_A = 360^\circ - 285.97^\circ \\ = 74.03^\circ$$

$$\alpha_A = -74.03^\circ + 1.82^\circ, \\ = -72.21^\circ$$

$$\begin{aligned} \bar{I}_B &= \bar{I}_{BC} - \bar{I}_{AB}, & (100-8) \\ &= (-5.25 - j2.23) - (4.92 - j3.71) \\ &= -10.17 + j1.48 \\ &= 10.28/171.72^\circ \end{aligned}$$

and,

$$\Theta_B = -120^\circ - 171.72^\circ \\ = -291.72^\circ$$

$$\alpha_B = -(-291.72^\circ) + 1.82^\circ, \\ = 293.54^\circ,$$

$$\begin{aligned} \bar{I}_C &= \bar{I}_{CA} - \bar{I}_{BC}, & (100-9) \\ &= (1.16 + j9.43) - (-5.25 - j2.23) \\ &= 6.41 + j11.66 \\ &= 13.31/61.20^\circ \end{aligned}$$

and,

$$\Theta_C = 120^\circ - 61.20^\circ \\ = 58.8^\circ$$

$$\alpha_C = -58.80^\circ + 1.82^\circ, \\ = -56.98^\circ,$$

Step 4.

The drop in each line from the switchboard to the load is calculated as follows:

$$D_A \% = I_A L \left(\frac{z \cos(\alpha_A)}{E} \right) * 100, \quad (100-10)$$

MIL-HDBK-299(SH)
 NOTICE 1
 APPENDIX
 15 OCTOBER 1991

$$D_A \% = (13.67) (45) \left(\frac{(1.120 * 10^{-3}) \cos(-72.21^\circ)}{(120/\sqrt{3})} \right) * 100 \\ = 0.30\%$$

$$D_B \% = I_B L \left(\frac{z \cos(\alpha_B)}{E} \right) * 100, \quad (100-10) \\ = (10.28) (45) \left(\frac{(1.120 * 10^{-3}) \cos(293.54^\circ)}{(120/\sqrt{3})} \right) * 100 \\ = 0.30\%$$

$$D_C \% = I_C L \left(\frac{z \cos(\alpha_C)}{E} \right) * 100, \quad (100-10) \\ = (13.30) (45) \left(\frac{(1.120 * 10^{-3}) \cos(-57.98^\circ)}{(120/\sqrt{3})} \right) * 100 \\ = 0.53\%$$

The total drop ($D_T \%$) in this portion of cable is the combination of the drops in the lines:

$$D_T \% = D_A \% + D_B \% + D_C \% \\ = 0.30\% + 0.30\% + 0.53\% \\ = 1.13\%$$

Step 5.

If the voltage drop in each phase is desired, the currents I_x must be determined from the following equations:

The current in loop E_{AB} is:

$$\bar{I}_x(AB) = \bar{I}_A - \bar{I}_B, \quad (100-12) \\ = (3.76 - j13.14) - (-10.17 + j1.48) \\ = 13.93 - j14.62 \\ = 20.19 \angle 313.62^\circ$$

MIL-HDBK-299(SH)
 NOTICE 1
 APPENDIX
 15 OCTOBER 1991

$$\bar{I}_{x(AB)} = 13.93 - j14.62 \\ 20.19/313.62^\circ$$

and,

$$\Theta_{x(AB)} = 360^\circ - 313.62^\circ \\ = 46.38^\circ$$

$$\alpha_{x(AB)} = -46.38^\circ + 1.82^\circ \\ = -44.54^\circ$$

The current in loop E_{BC} is:

$$\begin{aligned} \bar{I}_{x(BC)} &= \bar{I}_B - \bar{I}_C' \\ &= (-10.17 + j1.48) - (6.41 + j11.66) \\ &= -16.58 - j10.18 \\ &= 19.46/238.45^\circ \end{aligned} \quad (100-13)$$

and,

$$\Theta_{x(BC)} = -120^\circ - 238.45^\circ \\ = -358.45^\circ$$

$$\alpha_{x(BC)} = -(-358.45^\circ) + 1.82^\circ \\ = 360.27^\circ$$

The current in loop E_{CA} is:

$$\begin{aligned} \bar{I}_{x(CA)} &= \bar{I}_C - \bar{I}_A' \\ &= (6.41 + j11.66) - (3.76 - j13.14) \\ &= 2.65 + j24.80 \\ &= 24.94/83.9^\circ \end{aligned} \quad (100-14)$$

and,

$$\Theta_{x(CA)} = 120^\circ - 83.90^\circ \\ = 36.1^\circ$$

$$\alpha_{x(CA)} = -36.1^\circ + 1.82^\circ \\ = -34.28^\circ$$

Step 6.

The percent drop in each phase is calculated as follows:

MIL-HDBK-299(SH)

NOTICE 1

APPENDIX

15 OCTOBER 1991

$$D_{AB}\% = (20.19)(45) \left(\frac{(1.120)(10^{-3}) \cos(-44.54^\circ)}{120} \right) * 100 \\ = 0.60\%$$

$$D_{BC}\% = I_x(BC) L \left(\frac{z \cos(\alpha_x(BC))}{E_{BC}} \right) * 100, \quad (100-17) \\ = (19.46)(45) \left(\frac{(1.120)(10^{-3}) \cos(360.27^\circ)}{120} \right) * 100 \\ = 0.82\%$$

$$D_{CA}\% = I_x(CA) L \left(\frac{z \cos(\alpha_x(CA))}{E_{CA}} \right) * 100, \quad (100-17) \\ = (24.94)(45) \left(\frac{(1.120)(10^{-3}) \cos(-34.28^\circ)}{120} \right) * 100 \\ = 0.87\%$$

The drop in this portion of the cable is the combination of the results in step 6 as follows:

$$D_T(\%) = 1/2(D_{AB}\% + D_{BC}\% + D_{CA}\%) \\ = 1/2(0.60\% + 0.82\% + 0.87\%) \\ = 1.14\%$$

60. VOLTAGE DROP CALCULATIONS FOR UNBALANCED SYSTEMS BY SYMMETRICAL COMPONENT METHOD

To calculate cable voltage drop for unbalanced system, the line currents supplying the loads must be calculated. Assume all three phase loads are unbalanced. Therefore, the phase load currents are different and must be calculated individually. From the phase load currents, the

MIL-HDBK-299(SH)
NOTICE 1
APPENDIX
15 OCTOBER 1991

individual line currents will be calculated. From the line currents, the voltage drop in each line will be determined. All necessary equations are derived in section 130.

60.1 Calculation Procedure. The step by step procedure for the percent drop determination is as follows:

Step 1.

Locate or determine the following necessary parameters:

- Vectorial sum of all load currents for each phase.
- Real power for each phase load.
- Load power factor for each phase.
- Load impedance for each phase.
- Rated load voltage for each phase.

Step 2.

Calculate the load current for each phase. Two methods will be used. If real power, power factor, and rated voltage of the loads are given, use the following equations:

$$\bar{I}_{AB} = [P_{AB}/V_{AB}\cos(\theta_{AB})]/(0 - \theta_{AB})^\circ, \quad (130-31)$$

$$\bar{I}_{BC} = [P_{BC}/V_{BC}\cos(\theta_{BC})]/(-120 - \theta_{BC})^\circ, \quad (130-32)$$

$$\bar{I}_{CA} = [P_{CA}/V_{CA}\cos(\theta_{CA})]/(120 - \theta_{CA})^\circ, \quad (130-33)$$

If the impedances and rated voltages of the loads are given, use the following equations:

$$\bar{I}_{AB} = \bar{V}_{AB} / \bar{Z}_{AB}, \quad (130-34)$$

$$\bar{I}_{BC} = \bar{V}_{BC} / \bar{Z}_{BC}, \quad (130-35)$$

$$\bar{I}_{CA} = \bar{V}_{CA} / \bar{Z}_{CA}, \quad (130-36)$$

MIL-HDBK-299(SH)
NOTICE 1
APPENDIX
15 OCTOBER 1991

Step 3.

Calculate the positive and negative sequence currents. Take phase AB as reference, the positive and negative sequence currents are calculated as follows:

$$\bar{I}_{AB1} = (1/3) (\bar{I}_{AB} + a\bar{I}_{BC} + a^2\bar{I}_{CA}), \quad (130-29)$$

$$\bar{I}_{AB2} = (1/3) (\bar{I}_{AB} + a^2\bar{I}_{BC} + a\bar{I}_{CA}), \quad (130-30)$$

Where:

$$a = 1/120^\circ, \quad a^2 = 1/240^\circ$$

Note: In a three-phase and three-wire system, the zero sequence currents are zero as shown in section 130.

Step 4.

Calculate the sequence components of line currents from the following equations:

$$\bar{I}_{A1} = \bar{I}_{AB1} (\sqrt{3}/-30^\circ), \quad (130-8)$$

$$\bar{I}_{A2} = \bar{I}_{AB2} (\sqrt{3}/30^\circ), \quad (130-11)$$

$$\bar{I}_{B1} = \bar{I}_{AB1} (\sqrt{3}/-150^\circ), \quad (130-14)$$

$$\bar{I}_{B2} = \bar{I}_{AB2} (\sqrt{3}/150^\circ), \quad (130-17)$$

$$\bar{I}_{C1} = \bar{I}_{AB1} (\sqrt{3}/90^\circ), \quad (130-21)$$

$$\bar{I}_{C2} = \bar{I}_{AB2} (\sqrt{3}/-90^\circ), \quad (130-25)$$

Step 5.

The line currents flowing into each node of the delta connected loads as shown in figure 7 are calculated as follows:

$$\bar{I}_A = \bar{I}_{AB1} (\sqrt{3}/-30^\circ) + \bar{I}_{AB2} (\sqrt{3}/30^\circ), \quad (130-26)$$

MIL-HDBK-299(SH)
 NOTICE 1
 APPENDIX
 15 OCTOBER 1991

$$\bar{I}_B = \bar{I}_{AB1} (\sqrt{3}/-150^\circ) + \bar{I}_{AB2} (\sqrt{3}/150^\circ), \quad (130-27)$$

$$\bar{I}_C = \bar{I}_{AB1} (\sqrt{3}/90^\circ) + \bar{I}_{AB2} (\sqrt{3}/-90^\circ), \quad (130-28)$$

The corresponding angles Θ and α are calculated from equations derived in section 100.:

$$\Theta_A = 0^\circ - /I_{A-}, \quad \alpha_A = -\Theta_A + \beta, \quad (100-7)$$

$$\Theta_B = -120^\circ - /I_{B-}, \quad \alpha_B = -\Theta_B + \beta, \quad (100-8)$$

$$\Theta_C = 120^\circ - /I_{C-}, \quad \alpha_C = -\Theta_C + \beta, \quad (100-9)$$

Step 6.

If the cable length and cable impedance are known, the voltage drop in each line is:

$$D\% = IL \left(\frac{z \cos(\alpha)}{E} \right) * 100, \quad (100-10)$$

60.2 Example of Voltage Drop Calculations.

Step 1.

The following parameters are given:

$$\bar{V}_{AB} = 118/0^\circ, \quad \bar{V}_{BC} = 118/-120^\circ, \quad \bar{V}_{CA} = 118/120^\circ$$

$$P_{AB} = 3400W, \quad P_{BC} = 2500W, \quad P_{CA} = 2900W.$$

$$E_{AB} = E_{BC} = E_{CA} = 120V$$

All load power factors (pf) = 0.80 lagging. From Table XVI, use LSTSGU-50 cable with $z = 0.223(10^{-3})\Omega/\text{ft}$, $\beta = 7.8^\circ$

MIL-HDBK-299(SH)
 NOTICE 1
 APPENDIX
 15 OCTOBER 1991

Step 2.

Calculate the phase currents from the following equations:

$$\begin{aligned}\bar{I}_{AB} &= [P_{AB}/V_{AB}\cos(\theta_{AB})]/(0 - \underline{\theta_{AB}})^\circ, \\ &= [3400/(118)(0.8)]/(0^\circ - 37^\circ) \\ &= 36/-37^\circ\end{aligned}\quad (130-31)$$

$$\begin{aligned}\bar{I}_{BC} &= [P_{BC}/V_{BC}\cos(\theta_{BC})]/(-120 - \underline{\theta_{BC}})^\circ, \\ &= [2500/(118)(0.8)]/-120^\circ - 37^\circ \\ &= 26.5/-157^\circ\end{aligned}\quad (130-32)$$

$$\begin{aligned}\bar{I}_{CA} &= [P_{CA}/V_{CA}\cos(\theta_{CA})]/(120 - \underline{\theta_{CA}})^\circ, \\ &= [2900/(118)(0.8)]/120^\circ - 37^\circ \\ &= 30.7/83^\circ\end{aligned}\quad (130-33)$$

Step 3.

Calculate the positive and negative sequences of \bar{I}_{AB} from the following equations:

$$\begin{aligned}\bar{I}_{AB1} &= (1/3) (\bar{I}_{AB} + a\bar{I}_{BC} + a^2\bar{I}_{CA}), \\ &= (1/3) [36.0/-37^\circ + (1/120^\circ)(26.5/-157^\circ) \\ &\quad + (1/240^\circ)(30.7/83^\circ)] \\ &= 31.0/-37^\circ\end{aligned}\quad (130-29)$$

$$\begin{aligned}\bar{I}_{AB2} &= (1/3) (\bar{I}_{AB} + a^2\bar{I}_{BC} + a\bar{I}_{CA}), \\ &= (1/3) [36.0/-37^\circ + (1/240^\circ)(26.5/-157^\circ) \\ &\quad + (1/120^\circ)(30.7/83^\circ)] \\ &= 2.6/-62.5^\circ\end{aligned}\quad (130-30)$$

MIL-HDBK-299(SH)

NOTICE 1

APPENDIX

15 OCTOBER 1991

Step 4.

Calculate the sequence components of line currents from the following equations:

$$\begin{aligned}\bar{I}_{A1} &= \bar{I}_{AB1} (\sqrt{3}/-30^\circ), \\ &= (31.0/-37^\circ) (\sqrt{3}/-30^\circ) \\ &= 53.7/-67^\circ\end{aligned}\tag{130-8}$$

$$\begin{aligned}\bar{I}_{A2} &= \bar{I}_{AB2} (\sqrt{3}/30^\circ), \\ &= (2.6/-62.5^\circ) (\sqrt{3}/30^\circ) \\ &= 4.5/-32.5^\circ\end{aligned}\tag{130-11}$$

$$\begin{aligned}\bar{I}_{B1} &= \bar{I}_{AB1} (\sqrt{3}/-150^\circ), \\ &= (31.0/-37^\circ) (\sqrt{3}/-150^\circ) \\ &= 53.7/-187^\circ\end{aligned}\tag{130-14}$$

$$\begin{aligned}\bar{I}_{B2} &= \bar{I}_{AB2} (\sqrt{3}/150^\circ), \\ &= (2.6/-62.5^\circ) (\sqrt{3}/150^\circ) \\ &= 4.5/87.5^\circ\end{aligned}\tag{130-17}$$

$$\begin{aligned}\bar{I}_{C1} &= \bar{I}_{AB1} (\sqrt{3}/90^\circ), \\ &= (31.0/-37^\circ) (\sqrt{3}/90^\circ) \\ &= 53.7/53^\circ\end{aligned}\tag{130-21}$$

$$\begin{aligned}\bar{I}_{C2} &= \bar{I}_{AB2} (\sqrt{3}/-90^\circ), \\ &= (2.6/-62.5^\circ) (\sqrt{3}/-90^\circ) \\ &= 4.5/-152.5^\circ\end{aligned}\tag{130-25}$$

MIL-HDBK-299(SH)
 NOTICE 1
 APPENDIX
 15 OCTOBER 1991

Step 5.

Calculate the line currents \bar{I}_A , \bar{I}_B , and \bar{I}_C from the sequence currents as follows:

$$\begin{aligned}\bar{I}_A &= \bar{I}_{A0} + \bar{I}_{A1} + \bar{I}_{A2}, \\ &= 0 + 53.7/-67^\circ + 4.5/-32.5^\circ \\ &= 24.78 - j51.85 \\ &= 57.47/-64.46^\circ\end{aligned}\quad (130-26)$$

Then,

$$\begin{aligned}\Theta_A &= 0^\circ - (-64.46^\circ) \\ &= 64.46^\circ\end{aligned}$$

$$\begin{aligned}\alpha_A &= -\Theta_A + \beta \\ &= -64.46^\circ + 7.8^\circ \\ &= -56.66^\circ\end{aligned}$$

$$\begin{aligned}\bar{I}_B &= \bar{I}_{B0} + \bar{I}_{B1} + \bar{I}_{B2}, \\ &= 0 + 53.7/-187^\circ + 4.5/87.5^\circ \\ &= -53.10 + j11.04 \\ &= 54.24/168.26^\circ\end{aligned}\quad (130-27)$$

Then,

$$\begin{aligned}\Theta_B &= -120^\circ - 168.26^\circ \\ &= -288.26^\circ\end{aligned}$$

$$\begin{aligned}\alpha_B &= -\Theta_B + \beta \\ &= 288.26^\circ + 7.8^\circ \\ &= 296.06^\circ\end{aligned}$$

$$\begin{aligned}\bar{I}_C &= \bar{I}_{C0} + \bar{I}_{C1} + \bar{I}_{C2}, \\ &= 0 + 53.7/53^\circ + 4.5/-152.5^\circ \\ &= 28.33 + j40.81 \\ &= 49.68/55.24^\circ\end{aligned}\quad (130-28)$$

Then,

$$\begin{aligned}\Theta_C &= 120^\circ - 55.24^\circ \\ &= 64.76^\circ\end{aligned}$$

$$\begin{aligned}\alpha_C &= -\Theta_C + \beta \\ &= -64.76^\circ + 7.8^\circ \\ &= -56.96^\circ\end{aligned}$$

MIL-HDBK-299(SH)
 NOTICE 1
 APPENDIX
 15 OCTOBER 1991

Step 6.

Determine the percent voltage drops in the lines, and compare the results.

$$D_A \% = I_A L \left(\frac{z \cos(\alpha_A)}{E} \right) * 100, \quad (100-10)$$

$$= (57.47)(65) \left\{ \frac{(0.223)(10^{-3}) \cos(-56.66^\circ)}{120/\sqrt{3}} \right\} * 100$$

$$= 0.66\%$$

$$D_B \% = I_B L \left(\frac{z \cos(\alpha_B)}{E} \right) * 100, \quad (100-10)$$

$$= (54.24)(65) \left\{ \frac{(0.223)(10^{-3}) \cos(296.06^\circ)}{120/\sqrt{3}} \right\} * 100$$

$$= 0.50\%$$

$$D_C \% = I_A L \left(\frac{z \cos(\alpha_C)}{E} \right) * 100, \quad (100-10)$$

$$= (49.68)(65) \left\{ \frac{(0.223)(10^{-3}) \cos(-56.96^\circ)}{120/\sqrt{3}} \right\} * 100$$

$$= 0.57\%$$

The drop in this portion of cable is obtained by combining the drop in the individual lines (phase):

$$D_T \% = D_A \% + D_B \% + D_C %$$

$$= 0.66\% + 0.50\% + 0.57\%$$

$$= 1.73\%$$

70. CABLE IMPEDANCES AND DROP FACTORS

The drop factors and impedances are calculated based on the

MIL-HDBK-299 (SH)
NOTICE 1
APPENDIX
15 OCTOBER 1991

characteristics of LSTSGU and LS6SGU cables in accordance with MIL-C-24643. The tabulated drop factors for these cables may be used for other types of cables with similar impedance characteristics including lightweight cables in accordance with MIL-C-24640.

70.1 Drop factor calculations. The drop factors in tables XIII through XVII for power and lighting systems are calculated from the following equations derived in sections 90, 100, and 110:

70.1.1 Power systems.

$$DF = \left(\frac{z\cos(\alpha)}{E} + \frac{(2) z\tan(\alpha)\sin(\alpha)}{200E} \right) * 100, \quad (90-13)$$

70.1.2 Lighting systems.

70.1.2.1 Single-phase Circuits.

- For equations using Current I.

$$DF = \left(\frac{z\cos(\alpha)}{E} \right) * 100, \quad (100-20)$$

- For equations using Power P.

$$DF' = \left(\frac{1}{V\cos(\Theta)} \right) \left(\frac{z\cos(\alpha)}{E} \right) * 100, \quad (110-26)$$

70.1.2.2 Three-phase Circuits.

- For equations using Current I_x .

$$DF = \left(\frac{z\cos(\alpha_x)}{E_x} \right) * 100, \quad (100-19)$$

15 OCTOBER 1991

TABLE XI. Impedances for LSTSGU cable,
60Hz electronics and communications.

Size	Cable characteristics				
	A 1/ Cmil	R 2/3/ Ohms per 100 feet	X 3/ Ohms per 100 feet	Z	B °C
3	2580	4.503	0.043	4.503	0.55
4	4110	2.825	0.040	2.825	0.81
9	10380	1.119	0.036	1.120	1.82
14	13090	0.887	0.041	0.888	2.63
23	20820	0.558	0.039	0.559	4.02
50	52620	0.221	0.030	0.223	7.81
75	83690	0.138	0.030	0.141	12.07
100	105600	0.110	0.029	0.114	14.92
150	167800	0.069	0.029	0.075	22.58
200	211600	0.055	0.029	0.062	27.80
300	300000	0.040	0.029	0.049	35.75
400	413600	0.029	0.029	0.041	44.80

TABLE XII. Impedances for LSTSGU cable,
400 Hz electronics and communications.

Size	Cable characteristics				
	A 1/ Cmil	R 2/3/ Ohms per 1000 feet	X 3/ Ohms per 1000 feet	Z	B °C
3	2580	4.503	0.288	4.512	3.66
4	4110	2.825	0.267	2.838	5.40
9	10380	1.119	0.237	1.144	11.98
14	13090	0.887	0.271	0.928	17.01
23	20820	0.558	0.262	0.616	25.12
50	52620	0.221	0.202	0.299	42.44
75	83690	0.143	0.197	0.243	53.98
100	105600	0.116	0.195	0.227	59.29
150	167800	0.077	0.191	0.206	68.10
200	211600	0.065	0.194	0.204	71.44
300	300000	0.051	0.192	0.199	75.14
400	413600	0.042	0.192	0.196	77.65

1/ Conductor cross-sectional areas are based on MIL-C-24643.

2/ Resistances are derived at a temperature of 65°C.

3/ Resistances and reactances per phase are calculated in section 140.

TABLE XIII. Drop factors for LSTSGU cable, 450V, three-phase, 60Hz power systems. 1/

Size	Cable characteristics				Drop factors at cos (θ) 2/ below (multiply by 10 ⁻⁵)																		
	A 3/	R 4/	X 4/	Z	B	1.0	0.95	0.90	0.85	0.80	0.75	0.70	0.65	0.60	0.55	0.50	0.45	0.40	0.35	0.30			
	Cmil	Ohms per 1000 feet		°C																			
3	2580	4.827	0.043	4.827	0.51	185.8	177.2	168.4	159.4	150.4	141.5	132.5	123.5	114.8	106.0	97.1	88.2	79.7	71.1	62.0			
4	4110	3.028	0.040	3.028	0.76	116.5	111.3	105.8	100.2	94.6	89.1	83.5	77.9	72.4	66.9	61.3	55.7	50.4	45.1	39.9			
9	10380	1.199	0.036	1.200	1.70	46.1	44.3	42.2	40.1	37.9	35.8	33.6	31.4	29.3	27.1	24.9	22.7	20.6	18.5	16.4			
14	13090	0.951	0.041	0.952	2.45	36.6	35.3	33.7	32.0	30.4	28.7	27.0	25.3	23.6	21.9	20.1	18.4	16.8	15.1	13.4			
23	20820	0.598	0.039	0.599	3.75	23.0	22.4	21.4	20.4	19.4	18.4	17.3	16.3	15.2	14.2	13.1	12.0	11.0	9.9	8.9			
50	52620	0.237	0.030	0.239																			
75	83690	0.148	0.030	0.151	11.27	5.7	5.8	5.6	5.4	5.2	5.0	4.8	4.6	4.4	4.1	3.9	3.6	3.4	3.1	2.9			
100	105600	0.118	0.029	0.122	13.94	4.5	4.7	4.6	4.5	4.3	4.2	4.0	3.8	3.7	3.5	3.3	3.1	2.9	2.7	2.9			
150	167800	0.074	0.029	0.079	21.20	2.9	3.1	3.0	3.0	2.9	2.9	2.8	2.7	2.6	2.5	2.4	2.3	2.2	2.1	1.9			
200	211600	0.059	0.029	0.066	26.18	2.3	2.5	2.5	2.5	2.5	2.4	2.4	2.3	2.3	2.2	2.1	2.0	1.9	1.9	1.8			
300	300000	0.042	0.029	0.051	34.44	1.6	1.9	1.9	2.0	2.0	1.9	1.9	1.9	1.9	1.8	1.8	1.7	1.7	1.6	1.6			
400	413600	0.031	0.029	0.042	42.89	1.2	1.5	1.6	1.6	1.6	1.6	1.6	1.6	1.6	1.6	1.6	1.5	1.5	1.5	1.5	1.4		

1/ Drop factor equations are derived in section 90.

2/ θ is the load power factor angle or angle between load terminal voltage and line current.

3/ Conductor cross-sectional areas are based on MIL-C-24643.

4/ Resistances and reactances per phase are calculated in section 140.

5/ Resistances are derived at a temperature of 65°C.

TABLE XIV. Drop factors for LSISGU cable, 450V, three-phase, 400Hz power systems. 1/

Size	Cable characteristics				B °C	Drop factors at cos (θ) 2/ below (multiply by 10^{-5})														
	A 3/ Cmil	R 4/ 5/ Ohms per 1000 feet	X 6/	Z		1.0	0.95	0.90	0.85	0.80	0.75	0.70	0.65	0.60	0.55	0.50	0.45	0.40	0.35	0.30
3	2580	4.827	0.288	4.836	3.42	185.8	180.1	172.4	164.2	155.9	147.6	139.1	130.5	122.1	113.5	104.9	96.2	87.8	79.3	71.0
4	4110	3.028	0.267	3.040	5.04	116.6	114.0	109.6	104.7	99.8	94.7	89.5	84.3	79.2	73.9	68.5	63.2	58.0	52.7	47.0
9	10380	1.199	0.237	1.222	11.20	46.2	46.7	45.6	44.1	42.5	40.8	39.0	37.2	35.3	33.4	31.4	29.4	27.4	25.4	23.0
14	13090	0.951	0.271	0.989	15.92	36.6	38.0	37.5	36.6	35.6	34.4	33.2	31.9	30.5	29.1	27.6	26.1	24.6	23.0	21.0
23	20820	0.598	0.262	0.653	23.63	23.1	25.0	25.1	24.9	24.5	23.9	23.3	22.7	21.9	21.2	20.3	19.5	18.6	17.7	16.7
50	52620	0.237	0.202	0.311	40.46	9.2	11.1	11.6	11.9	12.0	12.0	11.9	11.8	11.7	11.5	11.3	11.1	10.8	10.5	10.2
75	83690	0.153	0.197	0.249	52.12	6.0	8.0	8.6	9.0	9.3	9.4	9.5	9.6	9.6	9.5	9.4	9.3	9.2	9.0	8.6
100	105600	0.124	0.195	0.231	57.59	6.9	6.9	7.6	8.0	8.3	8.6	8.7	8.8	8.9	8.9	8.9	8.8	8.7	8.6	8.0
150	167800	0.082	0.191	0.208	66.82	3.3	5.4	6.1	6.6	7.0	7.3	7.5	7.7	7.8	7.9	8.0	8.0	8.0	8.0	8.0
200	211600	0.069	0.194	0.206	70.38	2.9	4.9	5.7	6.2	6.6	6.9	7.2	7.4	7.6	7.7	7.8	7.9	7.9	7.9	7.9
300	300000	0.054	0.192	0.200	74.31	2.3	4.4	5.2	5.7	6.1	6.5	6.8	7.0	7.2	7.3	7.5	7.5	7.6	7.7	7.7
400	413600	0.045	0.192	0.197	76.80	2.0	4.1	4.8	5.4	5.9	6.2	6.5	6.8	7.0	7.1	7.3	7.4	7.5	7.5	7.6

1/ Drop factor equations are derived in section 90.

2/ θ is the load power factor angle or angle between load terminal voltage and line current.

3/ Conductor cross-sectional areas are based on MIL-C-24643.

4/ Resistances and reactances per phase are calculated in section 140.

5/ Resistances are derived at a temperature of 65°C.

TABLE XV. Drop factors for LS6SGU cable, 450V, three-phase, 400Hz power systems. 1/

Size	Cable characteristics				Drop factors at cos (θ) 2/ below (multiply by 10 ⁻⁵)															
	A 3/	R 4/	X 5/	Z	B	1.0	0.95	0.90	0.85	0.80	0.75	0.70	0.65	0.60	0.55	0.50	0.45	0.40	0.35	0.30
100	211200	0.062	0.098	0.116	57.60	2.4	3.5	3.8	4.0	4.2	4.3	4.4	4.4	4.4	4.5	4.6	4.4	4.4	4.4	4.3
125	266200	0.049	0.097	0.109	63.29	2.0	3.0	3.3	3.6	3.8	3.9	4.0	4.1	4.1	4.2	4.2	4.2	4.2	4.2	4.1
150	335600	0.041	0.096	0.104	66.83	1.7	2.7	3.0	3.3	3.5	3.6	3.7	3.8	3.9	3.9	4.0	4.0	4.0	4.0	4.0
200	423200	0.035	0.097	0.103	70.12	1.5	2.5	2.9	3.1	3.3	3.5	3.6	3.7	3.8	3.9	3.9	3.9	4.0	4.0	4.0

1/ Drop factor equations are derived in section 90.

2/ θ is the load power factor angle or angle between load terminal voltage and line current.

3/ Conductor cross-sectional areas are based on MIL-C-24643.

4/ Resistances and reactances per phase are calculated in section 140.

5/ Resistances are derived at a temperature of 65°C.

MIL-HDBK-299 (SH)
NOTICE 1
APPENDIX
15 OCTOBER 1991

TABLE XVI. Drop factors for LSTSGU cable, 120V, three-phase/single-phase, 60Hz lighting systems using θ or θ_x .^{1/}

Size	Cable characteristics				B °C	Drop factors at angle θ ^{2/} for single-phase loads or θ_x ^{3/} for three-phase loads (multiply by 10^{-5})														
	A ^{4/} cmil	R5/ ^{5/} Ohms per 1000 feet	X 5/ ^{5/}	Z		-70	-65	-60	-55	-50	-45	-40	-30	-20	-10	0	10	20	30	40
3	2580	4.503	0.043	4.503	0.55	125.0	155.3	184.5	212.3	238.4	262.8	285.1	323.2	351.4	368.9	375.2	370.2	353.9	326.8	289.8
4	4110	2.825	0.040	2.825	0.81	77.4	96.5	114.8	132.3	148.8	164.1	178.2	202.2	220.1	231.3	235.4	232.4	222.4	205.5	182.5
9	10380	1.119	0.036	1.120	1.82	29.1	36.7	44.1	51.1	57.7	63.8	69.5	79.3	86.6	91.3	93.2	92.3	88.6	82.2	73.3
14	13090	0.887	0.041	0.888	2.63	22.1	28.2	34.0	39.6	44.9	49.9	54.4	62.3	68.3	72.2	73.9	73.4	70.6	65.7	58.8
23	20820	0.558	0.039	0.559	4.02	12.8	16.7	20.4	24.0	27.4	30.6	33.5	38.6	42.6	45.2	46.5	46.4	44.8	41.9	37.7
50	52620	0.221	0.030	0.223	7.81	3.9	5.5	7.0	8.5	9.9	11.2	12.5	14.7	16.4	17.7	18.4	18.6	18.2	17.2	15.7
75	83690	0.138	0.030	0.141	12.07	1.6	2.6	3.6	4.6	5.5	6.4	7.2	8.7	10.0	10.9	11.5	11.8	11.6	11.2	10.4
100	105600	0.110	0.029	0.114	14.92	0.8	1.7	2.5	3.3	4.0	4.8	5.5	6.7	7.8	8.6	9.2	9.5	9.4	9.2	8.6
150	167800	0.069	0.029	0.075	22.58	0.3	0.3	0.8	1.3	1.9	2.4	2.9	3.8	4.6	5.2	5.8	6.1	6.2	6.2	5.9
200	211600	0.055	0.029	0.062	27.80	0.7	0.3	0.2	0.6	1.1	1.5	2.0	2.8	3.5	4.1	4.6	4.9	5.1	5.2	5.1
300	300000	0.040	0.029	0.049	35.75	1.1	0.8	0.4	0.1	0.3	0.7	1.0	1.7	2.3	2.9	3.3	3.7	4.0	4.1	4.1
400	413600	0.029	0.029	0.041	44.80	1.4	1.2	0.9	0.6	0.3	0.0	0.3	0.9	1.5	2.0	2.4	2.8	3.1	3.3	3.4

^{1/} Drop factor equations are derived in section 100.^{2/} θ is the load power factor angle or angle between load terminal voltage and line current I .^{3/} θ_x is the angle between load terminal voltage and current I_x .^{4/} Conductor cross-sectional areas are based on MIL-C-24643.^{5/} Resistances and reactances per phase are calculated in section 140.^{6/} Resistances are derived at a temperature of 45°C.

TABLE XVII. Drop factors for LST5GU cable, 120V, three-phase/single-phase, 60Hz lighting systems using P or P_x . 1/

Size	Cable characteristics				Drop factors at angle θ 2/ for single-phase loads or θ_x 3/ for three-phase loads (multiply by 10^{-5})															
	A 4/ cmil	R 5/ 6/ Ohms per 1000 feet	X 5/	Z	B °C	-70	-65	-60	-55	-50	-45	-40	-30	-20	-10	0	10	20	30	40
3	2580	4.503	0.043	4.503	0.55	317.7	319.6	320.9	321.8	322.6	323.2	323.7	324.5	325.2	325.8	326.3	326.9	327.4	328.1	328.9
4	4110	2.825	0.040	2.825	0.81	196.7	198.5	199.7	200.6	201.2	201.8	202.3	203.0	203.7	204.2	204.7	205.2	205.8	206.4	207.1
9	10380	1.119	0.036	1.120	1.82	74.0	75.6	76.6	77.4	78.0	78.5	78.9	79.6	80.1	80.6	81.1	81.5	82.0	82.6	83.3
14	13090	0.887	0.041	0.888	2.63	56.2	58.0	59.2	60.1	60.8	61.3	61.8	62.6	63.2	63.8	64.3	64.8	65.3	66.0	66.8
23	20820	0.558	0.039	0.559	4.02	32.6	34.3	35.5	36.4	37.0	37.6	38.1	38.8	39.4	39.9	40.4	40.9	41.5	42.1	42.8
50	52620	0.221	0.030	0.223	7.81	10.0	11.3	12.2	12.9	13.4	13.8	14.2	14.7	15.2	15.6	16.0	16.4	16.8	17.3	17.9
75	83690	0.138	0.030	0.141	12.07	4.1	5.4	6.3	6.9	7.5	7.9	8.2	8.8	9.2	9.6	10.0	10.4	10.8	11.2	11.8
100	105600	0.110	0.029	0.114	14.92	2.1	3.4	4.3	4.9	5.4	5.8	6.2	6.7	7.2	7.6	8.0	8.3	8.7	9.2	9.8
150	167800	0.069	0.029	0.075	22.58	0.7	0.5	1.4	2.0	2.5	2.9	3.3	3.8	4.2	4.6	5.0	5.4	5.8	6.2	6.7
200	211600	0.055	0.029	0.062	27.80	1.8	0.5	0.3	1.0	1.5	1.9	2.2	2.8	3.2	3.6	4.0	4.4	4.8	5.2	5.7
300	300000	0.040	0.029	0.049	35.75	2.8	1.6	0.7	0.1	0.4	0.8	1.1	1.7	2.1	2.5	2.9	3.3	3.7	4.1	4.6
400	413600	0.029	0.029	0.041	44.80	3.6	2.4	1.5	0.9	0.4	0.0	0.4	0.9	1.3	1.7	2.1	2.5	2.9	3.3	3.9

1/ Drop factor equations are derived in section 110.

2/ θ is the load power factor angle or angle between P and S vectors.3/ θ_x is the angle between P_x and apparent power S_x vectors.

4/ Conductor cross-sectional areas are based on MIL-C-24643.

5/ Resistances and reactances per phase are calculated in section 140.

6/ Resistances are derived at a temperature of 45°C.

MIL-HDBK-299(SH)
 NOTICE 1
 APPENDIX
 15 OCTOBER 1991

- For equation using Power P_x .

$$DF' = \left(\frac{1}{V \cos(\Theta_x)} \right) \left(\frac{z \cos(\alpha_x)}{E_x} \right) * 100, \quad (110-23)$$

The drop factors for other cables not listed in the tables can be also calculated from the above equations if the cable characteristic are given.

80. DERIVATION OF VOLTAGE DROP EQUATIONS FOR DC SYSTEMS

80.1 Single-wire circuits. The R_{dc} resistance for a single wire in dc systems is:

$$R_{dc} = \left(\frac{\rho L}{A} \right) \quad (80-1)$$

Where:

ρ = Conductor resistivity (copper) of a cable at desired operating temperature (t).

L = Cable length.

A = Conductor cross-sectional area in circular mil(cmil).

The standard nominal cross-sectional area of a conductor in circular mils is calculated in accordance with the following equation:

$$A = d^2, \quad (80-2)$$

Where:

d = conductor diameter in mils.

The conductor resistivity (copper) at operating temperature (t) is given by:

$$\rho = \rho_0 [1 + 0.00393(t - t_0)], \quad (80-3)$$

From section 140, the conductor resistivity (copper) at 20°C is:

$$\rho_0 = 10.371 \Omega \cdot \text{cmil}/\text{ft}$$

MIL-HDBK-299(SH)
 NOTICE 1
 APPENDIX
 15 OCTOBER 1991

At $t = 65^{\circ}\text{C}$,

$$\begin{aligned} p &= 10.371[1 + 0.00393(65 - 20)] \\ &= 12.21 \Omega \cdot \text{cmil/ft} \end{aligned}$$

At $t = 45^{\circ}\text{C}$,

$$\begin{aligned} p &= 10.371[1 + 0.00393(45 - 20)] \\ &= 11.39 \Omega \cdot \text{cmil/ft} \end{aligned}$$

With respect to the system voltage, the percent voltage drop in a single line is :

$$D\% = \left(\frac{IR_{dc}}{E} \right) * 100 \quad (80-4)$$

80.2 Two-wire circuits.

In a two-wire circuit, the percent drop in equation (80-4) must be multiplied by 2 to include the drop in the return path:

- For all systems except power.

$$D\% = 2 \left(\frac{IR_{dc}}{E} \right) * 100$$

At 45°C , the resistance R_{dc} is:

$$R_{dc} = 11.39 \left(\frac{L}{A} \right)$$

Then,

$$D\% = 22.78 \left(\frac{IL}{AE} \right) * 100 \quad (80-5)$$

- For power system only.

$$D\% = 2 \left(\frac{IR_{dc}}{E} \right) * 100$$

$$\begin{aligned} D\% &= 2 \left(\frac{12.21 IL}{AE} \right) * 100 \\ &= 24.42 \left(\frac{IL}{AE} \right) * 100 \end{aligned} \quad (80-6)$$

90. DERIVATION OF VOLTAGE DROP EQUATIONS FOR SINGLE-PHASE/POWER SYSTEMS

The derivation of equations is based on Navy shipboard power systems and following assumptions:

- Cable impedance is purely resistive and inductive.
- The terminal load voltage is used as reference at $V/0^\circ$.

Let derive the voltage drop equations based on the following figures:

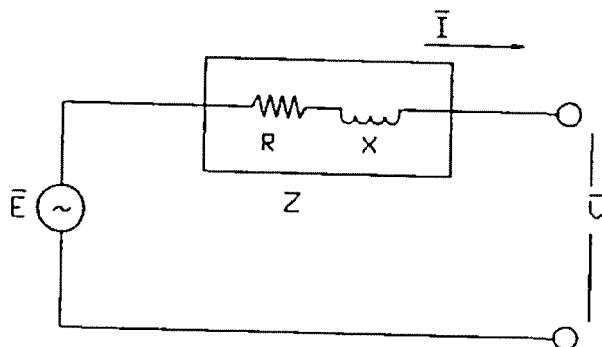


Figure 1. Single-phase circuit representation.

MIL-HDBK-299(SH)

NOTICE 1

APPENDIX

15 OCTOBER 1991

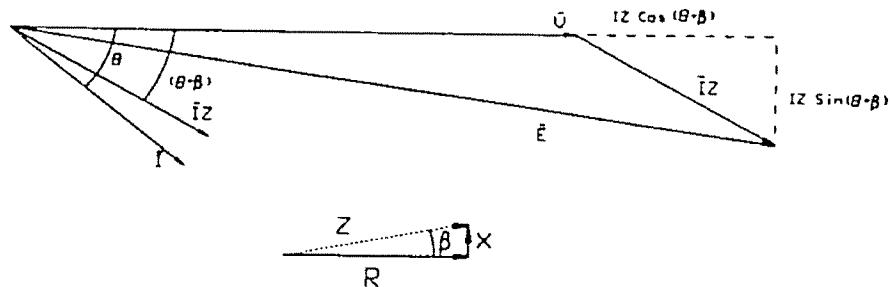


Figure 2. Single-phase Voltage & Current Phasor diagram.

From the above figures, define:

Θ = Load power factor angle or angle between load voltage and line current.

β = Cable impedance angle.

$$= \tan^{-1}(X/R)$$

The relationship between the sending bus and the terminal load voltage is as follows:

$$\bar{E} = \bar{I}\bar{Z} + \bar{V}, \quad (90-1)$$

$$\bar{E} = (I/\underline{-\Theta})(Z/\underline{\beta}) + V/0^\circ$$

$$\bar{E} = IZ/\underline{(-\Theta + \beta)} + V/0^\circ$$

Let $\alpha = -\Theta + \beta$, (90-2)

$$\bar{E} = IZ\cos(\alpha) + jIZ\sin(\alpha) + V$$

$$\bar{E} = (IZ\cos(\alpha) + V) + jIZ\sin(\alpha)$$

$$E = \sqrt{(IZ\cos(\alpha) + V)^2 + I^2 Z^2 \sin^2(\alpha)}, \quad (90-3)$$

MIL-HDBK-299(SH)
 NOTICE 1
 APPENDIX
 15 OCTOBER 1991

The cable voltage drop in percent is calculated as follows:

$$D\% = \left(\frac{E - V}{E} \right) * 100$$

$$= \left(1 - \frac{V}{E} \right) * 100, \quad (90-4)$$

From equation (90-3), the terminal load voltage is:

$$V = \sqrt{E^2 - I^2 Z^2 \sin^2(\alpha)} - IZ \cos(\alpha)$$

Substitute V into equation (90-4) and simplify:

$$D\% = \left[1 - \frac{\sqrt{E^2 - I^2 Z^2 \sin^2(\alpha)}}{E} + \frac{IZ \cos(\alpha)}{E} \right] * 100$$

$$D\% = \left[1 - \frac{\sqrt{E^2 - I^2 Z^2 \sin^2(\alpha)}}{E^2} + \frac{IZ \cos(\alpha)}{E} \right] * 100$$

$$D\% = \left[1 - \sqrt{1 - \frac{I^2 Z^2 \sin^2(\alpha)}{E^2}} + \frac{IZ \cos(\alpha)}{E} \right] * 100, \quad (90-5)$$

Set $Z = zL$, the exact equation for voltage drop is:

$$D\% = \left[1 - \sqrt{1 - \frac{I^2 L^2 z^2 \sin^2(\alpha)}{E^2}} + \frac{ILz \cos(\alpha)}{E} \right] * 100, \quad (90-6)$$

MIL-HDBK-299(SH)
 NOTICE 1
 APPENDIX
 15 OCTOBER 1991

The rule for approximation by binomial expansion can be applied to simplify equation (90-6):

$$(1 \pm x)^n = 1 \pm nx + \frac{n(n-1)x^2}{2!} \pm \frac{n(n-1)(n-2)x^3}{3!} + \dots, (x^2 < 1)$$

In the above expression, let:

$$x^2 = \left(\frac{I^2 L^2 z^2 \sin^2(\alpha)}{E^2} \right)^2 \quad \text{which is approximately equal to zero.}$$

Therefore, the term in equation (90-6) can be written:

$$\sqrt{1 - \frac{I^2 L^2 z^2 \sin^2(\alpha)}{E^2}} = 1 - \frac{1}{2} \left(\frac{I^2 L^2 z^2 \sin^2(\alpha)}{E^2} \right), \quad (90-7)$$

Substitute equation (90-7) into equation (90-6):

$$D\% = \left[1 - \left(1 - \frac{1}{2} \left(\frac{I^2 L^2 z^2 \sin^2(\alpha)}{E^2} \right) \right) + \frac{ILz \cos(\alpha)}{E} \right] * 100$$

The voltage drop equation reduces to:

$$D\% = IL \left(\frac{z \cos(\alpha)}{E} + \frac{IL^2 z^2 \sin^2(\alpha)}{2E^2} \right) * 100, \quad (90-8)$$

Since the quantity $\sin^2(\alpha)/2E^2$ is very small with respect to $\cos(\alpha)/E$, it can be neglected and the acceptable equation for the voltage drop is obtained:

$$D\% = IL \left(\frac{z \cos(\alpha)}{E} \right) * 100, \quad (90-9)$$

MIL-HDBK-299 (SH)
 NOTICE 1
 APPENDIX
 15 OCTOBER 1991

Since it is a single-phase circuit, equation (90-9) must be multiplied by 2 to include the drop in the return path.

Equation (90-9) can also be used to determine the percent drop in the individual lines for three-phase balanced systems such as electronic, internal communication, and weapon control systems with the substitution of line current by $\sqrt{3}I_{LO}$:

$$D\% = \sqrt{3}I_{LO}L \left(\frac{z\cos(\alpha)}{E} \right) * 100, \quad (90-10)$$

Where I_{LO} is the resultant load current in each phase.

In equation (90-8), since $(z/E)\cos(\alpha) \gg (z^2/2E^2)\sin^2(\alpha)$, and by setting D% equal to the assumed drop (AD), an estimate of (IL) may be determined as follows:

$$(AD) = IL[(z/E)\cos(\alpha)] * 100$$

Solve for IL:

$$IL = [(AD)E/100z\cos(\alpha)], \quad (90-11)$$

Substitute equation (90-11) into equation (90-8) for IL in the bracket:

$$D\% = IL \left(\frac{z\cos(\alpha)}{E} + \frac{(AD)Ez^2\sin^2(\alpha)}{200zE^2\cos(\alpha)} \right) * 100$$

Simplification of the above equation gives the voltage drop equation which includes the assumed drop (AD) in the systems:

$$D\% = IL \left(\frac{z\cos(\alpha)}{E} + \frac{(AD)ztan(\alpha)\sin(\alpha)}{200E} \right) * 100, \quad (90-12)$$

The assumed drop (AD) for a 60 Hz or 400 Hz power system at normal operation is 2 percent.

In equation (90-12), let define the drop factor as:

MIL-HDBK-299(SH)
 NOTICE 1
 APPENDIX
 15 OCTOBER 1991

$$DF = \left(\frac{z \cos(\alpha)}{E} + \frac{(AD) z \tan(\alpha) \sin(\alpha)}{200E} \right) * 100, \quad (90-13)$$

Equation (90-12) can be rewritten in the simple form:

$$D\% = IL(DF), \quad (90-14)$$

As before, the percent drop for a single-phase circuit in equation (90-14) must be multiplied by 2 to include the drop in the return path:

$$D\% = 2IL(DF), \quad (90-15)$$

100. DERIVATION OF VOLTAGE DROP EQUATIONS FOR THREE-PHASE/LIGHTING SYSTEMS

In order to determine the best cable selection for three-phase systems, voltage drop calculations for all phases should be performed. The combination of the individual drops will be the drop of the cable. The following equation derivations are for a three-phase lighting system in delta configuration.

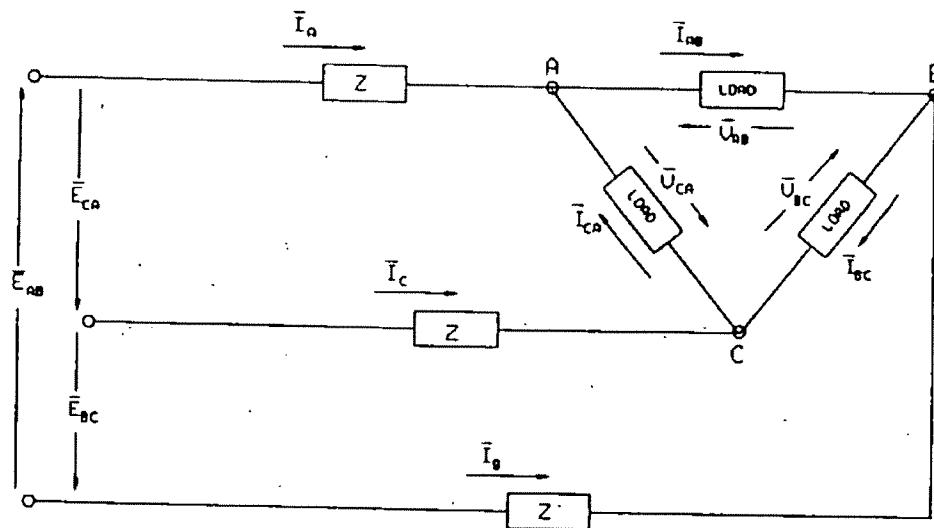


Figure 3. Three-phase circuit representation.

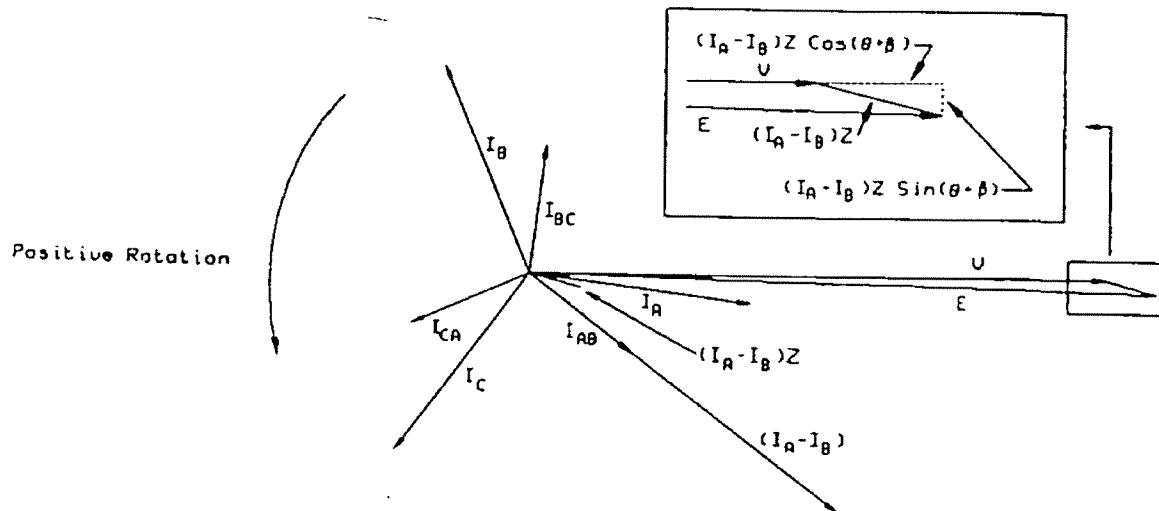


Figure 4. Three-phase voltage and current phasor diagram.

From figure 3., the voltage loop method gives:

$$\bar{E}_{AB} - \bar{I}_A \bar{Z} - \bar{V}_{AB} + \bar{I}_B \bar{Z} = 0, \quad (100-1)$$

$$\bar{E}_{BC} - \bar{I}_B \bar{Z} - \bar{V}_{BC} + \bar{I}_C \bar{Z} = 0, \quad (100-2)$$

$$\bar{E}_{CA} - \bar{I}_C \bar{Z} - \bar{V}_{CA} + \bar{I}_A \bar{Z} = 0, \quad (100-3)$$

Regroup the above equations as follows:

$$\bar{E}_{AB} = \bar{V}_{AB} + \bar{Z}(\bar{I}_A - \bar{I}_B), \quad (100-4)$$

$$\bar{E}_{BC} = \bar{V}_{BC} + \bar{Z}(\bar{I}_B - \bar{I}_C), \quad (100-5)$$

$$\bar{E}_{CA} = \bar{V}_{CA} + \bar{Z}(\bar{I}_C - \bar{I}_A), \quad (100-6)$$

Next, the difference in line current terms in equations (100-4) through (100-6) must be solved. From figures 3 and 4:

MIL-HDBK-299(SH)
 NOTICE 1
 APPENDIX
 15 OCTOBER 1991

$$\bar{I}_A = \bar{I}_{AB} - \bar{I}_{CA}, \quad (100-7)$$

$$\Theta_A = 0^\circ - /I_A -$$

$$\alpha_A = -\Theta_A + \beta$$

$$\bar{I}_B = \bar{I}_{BC} - \bar{I}_{AB}, \quad (100-8)$$

$$\Theta_B = -120^\circ - /I_B -$$

$$\alpha_B = -\Theta_B + \beta$$

$$\bar{I}_C = \bar{I}_{CA} - \bar{I}_{BC}, \quad (100-9)$$

$$\Theta_C = 120^\circ - /I_C -$$

$$\alpha_C = -\Theta_C + \beta$$

Where:

$/I_A$, $/I_B$, $/I_C$: angle of \bar{I}_A , \bar{I}_B , and \bar{I}_C .

Θ_A : angle between \bar{V}_{AB} and \bar{I}_A .

Θ_B : angle between \bar{V}_{BC} and \bar{I}_B

Θ_C : angle between \bar{V}_{CA} and \bar{I}_C .

The phase load currents are expressed as:

$$\bar{I}_{AB} = I_{AB} / (0^\circ - \Theta_{AB})$$

$$\bar{I}_{BC} = I_{BC} / (-120^\circ - \Theta_{BC})$$

$$\bar{I}_{CA} = I_{CA} / (120^\circ - \Theta_{CA})$$

From equations (100-7), (100-8), and (100-9), the percent voltage drop in each line is computed as follows:

$$D\% = IL \left(\frac{z \cos(\alpha)}{E} \right) * 100, \quad (100-10)$$

MIL-HDBK-299(SH)
 NOTICE 1
 APPENDIX
 15 OCTOBER 1991

Let the drop factor as follow:

$$DF = \left(\frac{z \cos(\alpha)}{E} \right) * 100,$$

Equation (100-10) reduces to:

$$D\% = IL(DF), \quad (100-11)$$

The difference in line currents \bar{I}_x are computed as follows:

$$\begin{aligned} \bar{I}_x(AB) &= \bar{I}_A - \bar{I}_B, \\ &= \bar{I}_{AB} - \bar{I}_{BC} - \bar{I}_{CA} + \bar{I}_{AB} \\ &= 2\bar{I}_{AB} - \bar{I}_{BC} - \bar{I}_{CA} \end{aligned} \quad (100-12)$$

and $\Theta_x(AB) = 0^\circ - /I_x(AB) -$
 $\alpha_x(AB) = -\Theta_x(AB) + \beta$

$$\begin{aligned} \bar{I}_x(BC) &= \bar{I}_B - \bar{I}_C \\ &= \bar{I}_{BC} - \bar{I}_{CA} - \bar{I}_{AB} + \bar{I}_{BC} \\ &= 2\bar{I}_{BC} - \bar{I}_{CA} - \bar{I}_{AB} \end{aligned} \quad (100-13)$$

and $\Theta_x(BC) = -120^\circ - /I_x(BC) -$
 $\alpha_x(BC) = -\Theta_x(BC) + \beta$

$$\begin{aligned} \bar{I}_x(CA) &= \bar{I}_C - \bar{I}_A \\ &= \bar{I}_{CA} - \bar{I}_{AB} - \bar{I}_{BC} + \bar{I}_{CA} \\ &= 2\bar{I}_{CA} - \bar{I}_{AB} - \bar{I}_{BC} \end{aligned} \quad (100-14)$$

and $\Theta_x(CA) = 120^\circ - /I_x(CA) -$
 $\alpha_x(CA) = -\Theta_x(CA) + \beta$

Where:

$\Theta_x(AB)$: Angle between \bar{V}_{AB} and $\bar{I}_x(AB)$.

MIL-HDBK-299(SH)
 NOTICE 1
 APPENDIX
 15 OCTOBER 1991

$\Theta_x(BC)$: Angle between \bar{V}_{BC} and $\bar{I}_x(BC)$.

$\Theta_x(CA)$: Angle between \bar{V}_{CA} and $\bar{I}_x(CA)$.

From equations (100-4), (100-5), and (100-6), the general equation for the percent drop in the individual phase is:

$$D\% = \frac{|\bar{E}_x| - |\bar{V}|}{E_x} * 100, \quad (100-15)$$

The magnitude of \bar{V} may be approximated as:

$$V = E_x - I_x Z \cos(\alpha_x)$$

Substitution of V in equation (100-15) gives:

$$D\% = I_x Z \left(\frac{\cos(\alpha_x)}{E_x} \right) * 100 \quad (100-16)$$

Let $Z = zL$, equation (100-16) becomes:

$$D\% = I_x L \left(\frac{z \cos(\alpha_x)}{E_x} \right) * 100 \quad (100-17)$$

For example, the percent drop in phase AB is:

$$D_{AB}\% = I_{x(AB)} L \left(\frac{z \cos(\alpha_{x(AB)})}{E_{AB}} \right) * 100$$

Equation (100-17) can also be written as:

$$D\% = I_x L (DF) \quad (100-18)$$

With,

$$DF = \left(\frac{z \cos(\alpha_x)}{E_x} \right) * 100, \quad (100-19)$$

MIL-HDBK-299(SH)
 NOTICE 1
 APPENDIX
 15 OCTOBER 1991

For a single-phase system, equation (100-19) becomes:

$$DF = \left(\frac{Z \cos(\alpha)}{E} \right) * 100, \quad (100-20)$$

Then, the percent drop equation is as follows:

$$\Delta\% = 2IL(DF) \quad (100-21)$$

110. DERIVATION OF VOLTAGE DROP EQUATIONS FOR THREE-PHASE/LIGHTING SYSTEMS USING WATTS AND VARS

In lighting systems, the use of watts (P) and vars (Q) instead of currents (I) in voltage drop equations avoids necessity for calculating all phase and line currents. This is an advantage when real and reactive power or the apparent power (S) and power factor of connected loads are known.

Consider a balanced three-phase voltage and current vector diagram below:

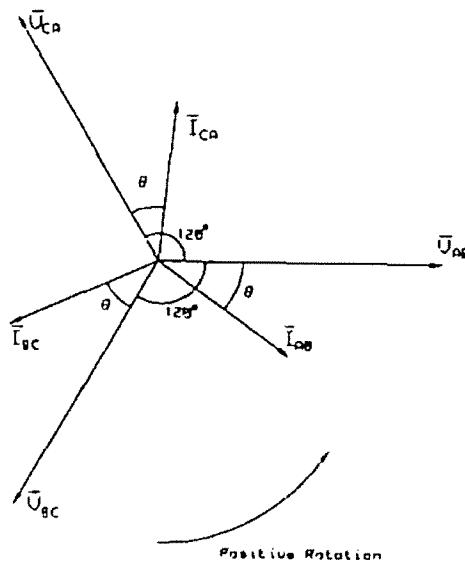


Figure 5. Three-phase voltage and current phasor diagram.

MIL-HDBK-299(SH)
 NOTICE 1
 APPENDIX
 15 OCTOBER 1991

Assume all phase loads are inductive. The total complex power for each phase can be determined as follows:

$$\bar{S} = \bar{V} \bar{I}_L^*$$

Where \bar{I}_L^* is the complex conjugate of \bar{I}_L .

The apparent power (S) for each phase (leg) is defined as:

$$S = |S| = \bar{V} I_L$$

For phase AB:

$$S_{AB} = V_{AB} I_{AB}$$

In rectangular form:

$$S_{AB} = V_{AB}(1 + j0) * I_{AB}[\cos(\theta_{AB}) + j\sin(\theta_{AB})]$$

$$S_{AB} = V_{AB} I_{AB} \cos(\theta_{AB}) + j V_{AB} I_{AB} \sin(\theta_{AB}), \quad (110-1)$$

Since,

$$P_{AB} = V_{AB} I_{AB} \cos(\theta_{AB}), \quad Q_{AB} = V_{AB} I_{AB} \sin(\theta_{AB})$$

Equation (110-1) becomes:

$$S_{AB} = P_{AB} + jQ_{AB}, \quad (110-2)$$

The apparent powers S_{BC} for phase BC and S_{CA} for phase CA can be referenced to the same axis as S_{AB} . For inductive loads, their horizontal projections are:

$$S_{BC} \cos(-120^\circ - \theta_{BC}) \quad \text{and} \quad S_{CA} \cos(120^\circ - \theta_{CA})$$

From the trigonometric identity:

$$\cos(\theta_1 - \theta_2) = \cos(\theta_1) \cos(\theta_2) + \sin(\theta_1) \sin(\theta_2)$$

$$\begin{aligned} S_{BC} \cos(-120^\circ - \theta_{BC}) &= S_{BC} [\cos(-120^\circ) \cos(\theta_{BC}) + \sin(-120^\circ) \sin(\theta_{BC})] \\ &= S_{BC} [-(1/2) \cos(\theta_{BC}) - (\sqrt{3}/2) \sin(\theta_{BC})] \end{aligned}$$

MIL-HDBK-299(SH)
 NOTICE 1
 APPENDIX
 15 OCTOBER 1991

For phase CA:

$$\begin{aligned} S_{CA} \cos(120^\circ - \theta_{CA}) &= S_{CA} [\cos(120^\circ) \cos(\theta_{CA}) + \sin(120^\circ) \sin(\theta_{CA})] \\ &= S_{CA} [-(1/2) \cos(\theta_{CA}) + (\sqrt{3}/2) \sin(\theta_{CA})] \end{aligned}$$

As indicated above, the two quantities can be rewritten:

$$S_{BC} \cos(-120^\circ - \theta_{BC}) = -(1/2)P_{BC} - (\sqrt{3}/2)Q_{BC}$$

$$S_{CA} \cos(120^\circ - \theta_{CA}) = -(1/2)P_{CA} + (\sqrt{3}/2)Q_{CA}$$

The apparent power S_A and real power P_A in line A (or at node A) can be calculated as follows:

$$S_A = S_{AB} - S_{CA}, \quad P_A = P_{AB} - P_{CA}$$

Substitute P_{CA} in the above equation:

$$\begin{aligned} P_A &= P_{AB} - S_{CA} \cos(120^\circ - \theta_{CA}) \\ &= P_{AB} - (1/2)P_{CA} + (\sqrt{3})Q_{CA} \\ &= P_{AB} + (1/2)P_{CA} - (\sqrt{3})Q_{CA}, \end{aligned} \quad (110-3)$$

For lines B and C:

$$\begin{aligned} P_B &= P_{BC} - P_{AB} \\ &= P_{BC} + (1/2)P_{AB} - (\sqrt{3})Q_{AB}, \end{aligned} \quad (110-4)$$

$$\begin{aligned} P_C &= P_{CA} - P_{BC} \\ &= P_{CA} + (1/2)P_{BC} - (\sqrt{3})Q_{BC}, \end{aligned} \quad (110-5)$$

Similarly,

$$\begin{aligned} Q_A &= Q_{AB} - Q_{CA} \\ &= Q_{AB} + (1/2)Q_{CA} - (\sqrt{3}/2)P_{CA}, \end{aligned} \quad (110-6)$$

$$\begin{aligned} Q_B &= Q_{BC} - Q_{AB} \\ &= Q_{BC} + (1/2)Q_{AB} - (\sqrt{3}/2)P_{AB}, \end{aligned} \quad (110-7)$$

MIL-HDBK-299(SH)
 NOTICE 1
 APPENDIX
 15 OCTOBER 1991

$$\begin{aligned} Q_C &= Q_{CA} - Q_{BC}, \\ &= Q_{CA} + (1/2)Q_{BC} - (\sqrt{3}/2)P_{BC}, \end{aligned} \quad (110-8)$$

The net power P_x at two nodes of a three-phase delta connected load is as follows:

Phase AB:

$$P_x(AB) = P_A - P_B, \quad (110-9)$$

In equation (110-4) for line B, P_B can be expressed as:

$$\begin{aligned} P_B &= P_{BC} - P_{AB} \\ &= S_{BC}[-(1/2)\cos(\theta_{BC}) - (\sqrt{3}/2)\sin(\theta_{BC})] - P_{AB} \\ &= -P_{AB} - (1/2)P_{BC} - (\sqrt{3}/2)Q_{BC}, \end{aligned} \quad (110-10)$$

Substitute P_A and P_B in equation (110-9), equation for P_x in phase AB is obtained:

$$P_x(AB) = 2P_{AB} + (1/2)(P_{BC} + P_{CA}) + (\sqrt{3}/2)(Q_{BC} - Q_{CA}), \quad (110-11)$$

For phases BC and CA:

$$P_x(BC) = 2P_{BC} + (1/2)(P_{CA} + P_{AB}) + (\sqrt{3}/2)(Q_{CA} - Q_{AB}), \quad (110-12)$$

$$P_x(CA) = 2P_{CA} + (1/2)(P_{AB} + P_{BC}) + (\sqrt{3}/2)(Q_{AB} - Q_{BC}), \quad (110-13)$$

Similarly, Q_x can be shown as:

$$Q_x(AB) = -(2Q_{AB} + (1/2)(Q_{BC} + Q_{CA}) - (\sqrt{3}/2)(P_{BC} - P_{CA})), \quad (110-14)$$

$$Q_x(BC) = -[2Q_{BC} + (1/2)(Q_{CA} + Q_{AB}) - (\sqrt{3}/2)(P_{CA} - P_{AB})], \quad (110-15)$$

$$Q_x(CA) = -[2Q_{CA} + (1/2)(Q_{AB} + Q_{BC}) - (\sqrt{3}/2)(P_{AB} - P_{BC})], \quad (110-16)$$

Equations for capacitive loads, or mixed inductive and capacitive loads can also be derived by assigning the proper sign to each phase angle (negative for inductive loads and positive for capacitive loads) in

MIL-HDBK-299(SH)

NOTICE 1

APPENDIX

15 OCTOBER 1991

determining the cosine and sine of $(\pm 120^\circ \pm \Theta)$. Therefore, for capacitive loads, the signs of the last terms in equations (110-11) through (110-16) should be reversed.

It should be noted that if these equations are divided by load voltage V , similar expressions involving resistive and reactive components of current will result. In some cases, the use of these equations may be more convenient than the vector rotation method when currents are used in the calculations.

For checking current carrying capacity of conductors, only the largest phase apparent power (S) or (S_x) needs to be considered. The general equations are:

$$S = \sqrt{P^2 + Q^2}$$

$$I = \frac{S}{V} = \left(\frac{P}{V} \right) \left(\frac{1}{\cos(\Theta)} \right)$$

$$\Theta = \cos^{-1} \left(\frac{P}{S} \right)$$

or

$$\Theta = \tan^{-1} \left(\frac{Q}{P} \right)$$

$$S_x = \sqrt{P_x^2 + Q_x^2}, \quad (110-17)$$

$$I_x = \frac{S_x}{V} = \left(\frac{P_x}{V} \right) \left(\frac{1}{\cos(\Theta_x)} \right), \quad (110-18)$$

$$\Theta_x = \cos^{-1} \left(\frac{P_x}{S_x} \right), \quad (110-19)$$

or

$$\Theta_x = \tan^{-1} \left(\frac{Q_x}{P_x} \right), \quad (11-20)$$

Θ_x is positive if Q_x is positive.

Θ_x is greater than 90° if P_x is negative.

Recall the general voltage drop equation for three-phase lighting systems derived in section 100:

$$D\% = I_x L \left(\frac{Z \cos(\alpha_x)}{E_x} \right) * 100, \quad (100-17)$$

MIL-HDBK-299(SH)
 NOTICE 1
 APPENDIX
 15 OCTOBER 1991

Since,

$$P_x = I_x V \cos(\Theta_x)$$

The current I_x is then:

$$I_x = \left(\frac{P_x}{V \cos(\Theta_x)} \right) \quad (110-21)$$

Substitution of I_x in equation (100-17) gives:

$$D\% = P_x L \left(\frac{1}{V \cos(\Theta_x)} \right) \left(\frac{z \cos(\alpha_x)}{E_x} \right) * 100, \quad (110-22)$$

From equation (110-22), a new drop factor is defined as:

$$DF' = \left(\frac{1}{V \cos(\Theta_x)} \right) \left(\frac{z \cos(\alpha_x)}{E_x} \right) * 100, \quad (110-23)$$

Finally,

$$D\% = P_x L (DF) \quad (110-24)$$

For single-phase circuits, in equation (110-22), the parameters E_x , P_x , α_x , and Θ_x become E , P , α , and Θ respectively. The percent voltage drop for a single-phase circuit is then:

$$D\% = 2PL(DF) \quad (110-25)$$

With,

$$DF' = \left(\frac{1}{V \cos(\Theta)} \right) \left(\frac{z \cos(\alpha)}{E} \right) * 100, \quad (110-26)$$

MIL-HDBK-299(SH)
 NOTICE 1
 APPENDIX
 15 OCTOBER 1991

The computed drop factors for LSTSGU cables from equations (110-23) or (110-26) are shown in table XVII. Now, let derive equation for D% in function of watts (P) and vars (Q). Equation (110-18) can be written as:

$$P_x = S_x \cos(\Theta_x), \quad (110-27)$$

Substitution of P_x in equation (110-22) gives:

$$D\% = \left(\frac{S_x L z \cos(\Theta_x) \cos(\alpha_x)}{E_x V \cos(\Theta_x)} \right) * 100, \quad (110-28)$$

$$D\% = \left(\frac{S_x L z \cos(\alpha_x)}{E_x V} \right) * 100, \quad (110-28)$$

Rewrite equation (110-28) as:

$$D\% = \left(\frac{S_x L z \cos(\beta \pm \Theta_x)}{E_x V} \right) * 100, \quad (110-29)$$

$$D\% = \left(\frac{S_x L z [\cos(\beta) \cos(\Theta_x) \pm \sin(\beta) \sin(\Theta_x)]}{E_x V} \right) * 100, \quad (110-30)$$

Recall:

$$\begin{aligned} P_x &= S_x \cos(\Theta_x), & Q_x &= S_x \sin(\Theta_x), \\ R &= z \cos(\beta), & X &= z \sin(\beta) \end{aligned}$$

After the substitution, equation (110-30) becomes:

$$D\% = \left(\frac{L (R P_x \pm X Q_x)}{E_x V} \right) * 100, \quad (110-31)$$

MIL-HDBK-299(SH)

NOTICE 1

APPENDIX

15 OCTOBER 1991

For lighting systems, let assume:

$$E_x = 120V, \quad V = 115V$$

Equation (110-31) can be written as:

$$D\% = (7.25) (10^{-5}) L (R_P \pm X_Q) * 100, \quad (110-32)$$

For a single phase system, equation (110-31) becomes:

$$D\% = 2 \left(\frac{L (R_P \pm X_Q)}{EV} \right) * 100, \quad (110-33)$$

The signs " + " and " - " are for inductive and capacitive loads respectively. The values of R and X for different types of cables can be found from Tables XI through XVII.

120. DERIVATION OF VOLTAGE DROP EQUATIONS FOR THREE-PHASE FOUR-WIRE SYSTEMS

Consider a three-phase four-wire (Wye) system as shown below:

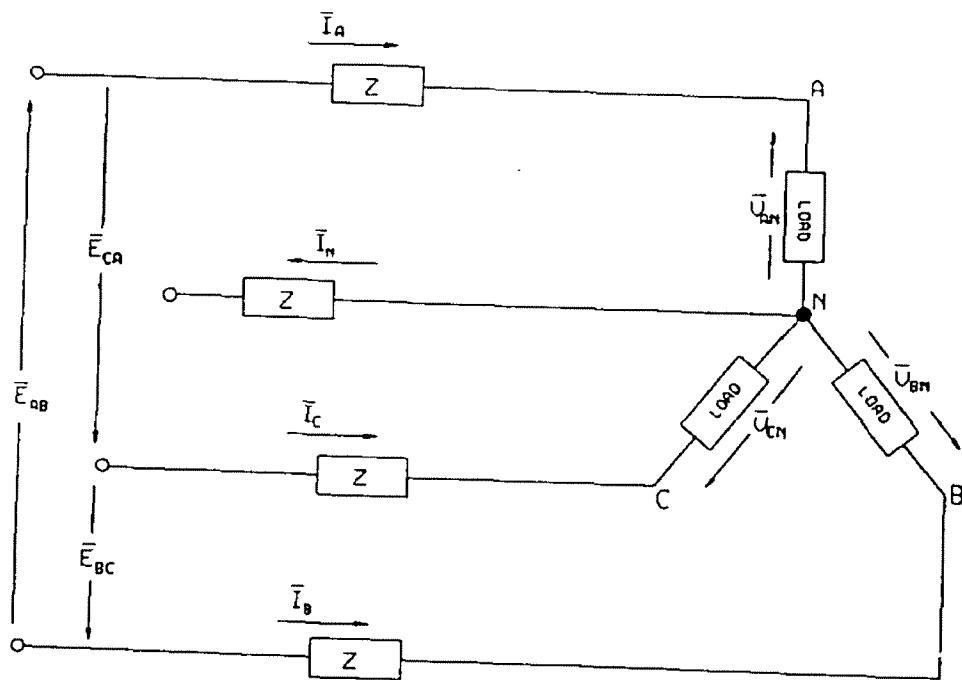


Figure 6. Three-phase Four-wire System.

If the system is balanced, the voltage drops for all lines are the same. For example, in line A, the percent drop is:

$$\text{Or } D_A \% = \left(\frac{E_{AN} - V_{AN}}{E_{AN}} \right) * 100, \quad (120-1)$$

$$D_A \% = IL \left(\frac{Z \cos(\alpha_A)}{E_{AN}} \right) * 100, \quad (120-2)$$

MIL-HDBK-299(SH)
 NOTICE 1
 APPENDIX
 15 OCTOBER 1991

Where:

$$I = I_A = \frac{V_{AN}}{Z_{AN}}, \quad (120-3)$$

$$\alpha = -\theta_A + \beta, \quad (100-7)$$

With, $E_{AN} = (E_{AB}/\sqrt{3}) = E$, equation (120-2) becomes:

$$D_A \% = IL \left(\frac{z \cos(\alpha_A)}{E} \right) * 100, \quad (120-4)$$

Or

$$D_A \% = IL(DF), \quad (120-5)$$

With,

$$DF = \left(\frac{z \cos(\alpha_A)}{E} \right) * 100$$

Now, let derive equations for the drop in each phase (the drop in phase A plus the drop in phase B). From figure 6, the source voltage in line A to line B is:

$$\bar{E}_{AB} = \bar{V}_{AN} - \bar{V}_{BN} + \bar{Z}(\bar{I}_A - \bar{I}_B), \quad (120-5)$$

For $\bar{V}_{BN} = \bar{V}_{AN}(1/-120^\circ)$,

$$\begin{aligned} \bar{E}_{AB} &= \bar{V}_{AN} - \bar{V}_{AN}(1/-120^\circ) + \bar{Z}(\bar{I}_A - \bar{I}_B) \\ &= \bar{V}_{AN}(1.5 + j0.866) + \bar{Z}(\bar{I}_A - \bar{I}_B) \\ &= \bar{V}_{AN}(\sqrt{3}/30^\circ) + \bar{Z}(\bar{I}_A - \bar{I}_B) \end{aligned}$$

Since $\bar{V}_{AB} = \bar{V}_{AN}(\sqrt{3}/30^\circ)$, equation (120-5) becomes:

$$\bar{E}_{AB} = \bar{V}_{AB} + \bar{Z}(\bar{I}_A - \bar{I}_B), \quad (120-6)$$

Similarly:

$$\bar{E}_{BC} = \bar{V}_{BC} + \bar{Z}(\bar{I}_B - \bar{I}_C), \quad (120-7)$$

MIL-HDBK-299(SH)
 NOTICE 1
 APPENDIX
 15 OCTOBER 1991

and

$$\bar{E}_{CA} = \bar{V}_{CA} + \bar{Z}(\bar{I}_C - \bar{I}_A), \quad (120-8)$$

Note that equations (120-6), (120-7), and (120-8) are similar to equations (100-4), (100-5), and (100-6) in section 100. After the line currents I are computed from equation (120-3), the currents I_x and the associated angles θ_x and α_x can be determined in accordance with the following equations as derived in section 100 :

$$\bar{I}_x(AB) = \bar{I}_A - \bar{I}_B, \quad (100-12)$$

$$\theta_x(AB) = 0^\circ - /I_x(AB) -$$

$$\alpha_x(AB) = -\theta_x(AB) + \beta$$

$$\bar{I}_x(BC) = \bar{I}_B - \bar{I}_C, \quad (100-13)$$

$$\theta_x(BC) = -120^\circ - /I_x(BC) -$$

$$\alpha_x(BC) = -\theta_x(BC) + \beta$$

$$\bar{I}_x(CA) = \bar{I}_C - \bar{I}_A, \quad (100-14)$$

$$\theta_x(CA) = 120^\circ - /I_x(CA) -$$

$$\alpha_x(CA) = -\theta_x(CA) + \beta$$

The percent drop in each phase is calculated from equation (100-17) as derived in section 100:

$$D\% = I_x L \left(\frac{z \cos(\alpha_x)}{E_x} \right) * 100, \quad (100-17)$$

With,

$$DF = \left(\frac{z \cos(\alpha_x)}{E_x} \right) * 100$$

Equation (100-17) reduces to:

$$D\% = I_x L (DF)$$

130. DERIVATION OF VOLTAGE DROP EQUATIONS FOR UNBALANCED SYSTEMS BY SYMMETRICAL COMPONENT METHOD

For analyzing unbalanced circuit, all loads are assumed unequal. Therefore, the currents in all phase loads are different. The symmetrical component method is preferred here to analyze the network. To use this method, it is convenient to keep the voltages, currents, and impedances in phasor forms. The following figures represent a three-phase unbalanced system and a three-phase unbalanced currents.

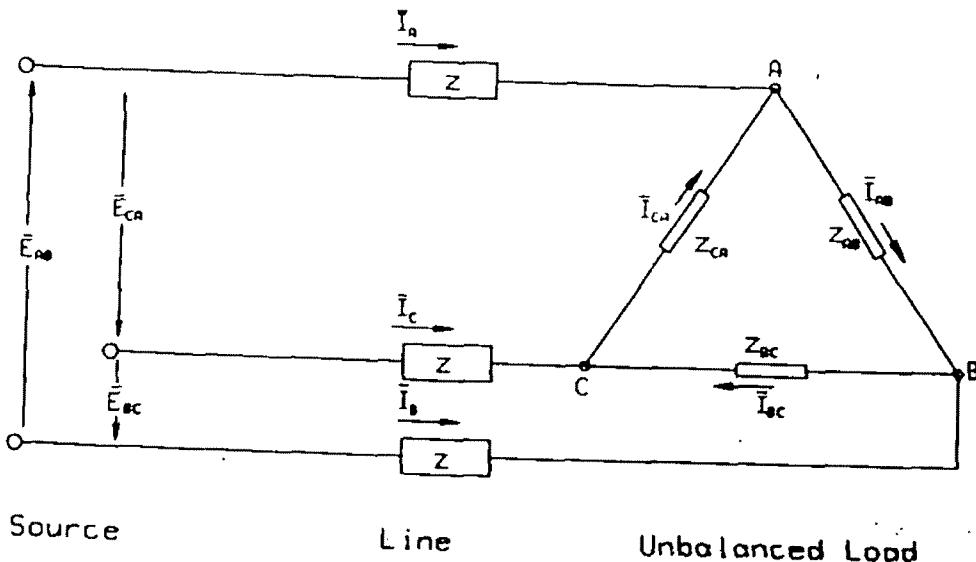


Figure 7. Three-phase unbalanced system.

MIL-HDBK-299(SH)
 NOTICE 1
 APPENDIX
 15 OCTOBER 1991

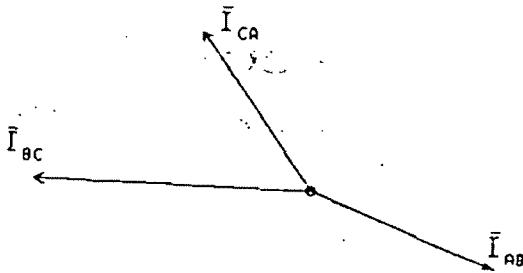


Figure 8. Three-phase unbalanced currents.

Assume all three loads are unbalanced. The load currents are:

$$|\bar{I}_{AB}| \neq |\bar{I}_{BC}| \neq |\bar{I}_{CA}|$$

and

$$\theta_{AB} \neq \theta_{BC} \neq \theta_{CA}$$

The line currents, as functions of load currents at nodes A, B, and C of figure 7, are determined from equations derived in section 100 as follows:

$$\bar{I}_A = \bar{I}_{AB} - \bar{I}_{CA}, \quad (100-7)$$

$$\bar{I}_B = \bar{I}_{BC} - \bar{I}_{AB}, \quad (100-8)$$

$$\bar{I}_C = \bar{I}_{CA} - \bar{I}_{BC}. \quad (100-9)$$

Rearranging equation (100-7) as follows:

$$\bar{I}_A + \bar{I}_{CA} - \bar{I}_{AB} = 0, \quad (130-1)$$

Substitution of equation (100-9) into equation (130-1) yields:

$$\bar{I}_A + \bar{I}_C + \bar{I}_{BC} - \bar{I}_{AB} = 0, \quad (130-2)$$

MIL-HDBK-299(SH)
 NOTICE 1
 APPENDIX
 15 OCTOBER 1991

Substitution of equation (100-8) into equation (130-2) yields:

$$\bar{I}_A + \bar{I}_B + \bar{I}_C = 0, \quad (130-3)$$

Consider the zero sequence component of \bar{I}_A :

$$\bar{I}_{A0} = (1/3)(\bar{I}_A + \bar{I}_B + \bar{I}_C), \quad (130-4)$$

Substitution from equation (130-4) gives:

$$\bar{I}_{A0} = (1/3)(0) = 0,$$

By similar derivation:

$$\bar{I}_{A0} = \bar{I}_{B0} = \bar{I}_{C0} = 0, \quad (130-5)$$

Thus, in a three-phase delta system the zero sequence currents are zero.

Now, let calculate the positive and negative sequence components of the line currents in term of current in phase AB.

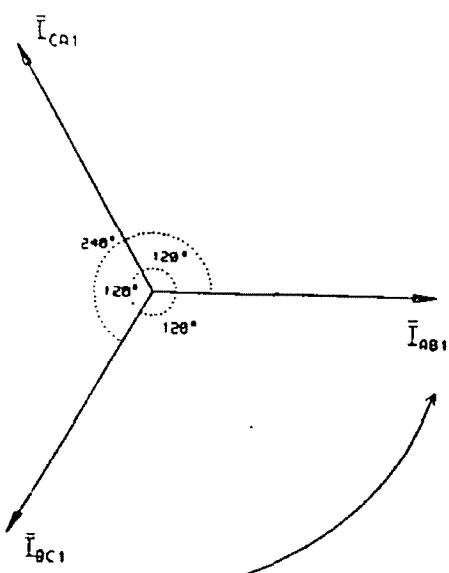


Figure 9. Positive sequence currents.

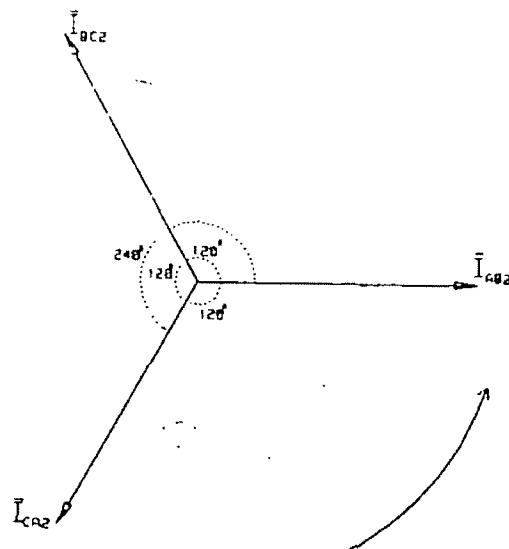


Figure 10. Negative sequence currents.

Components of \bar{I}_A

From equation (306), the positive sequence current is:

$$\bar{I}_{A1} = \bar{I}_{AB1} - \bar{I}_{CA1}, \quad (130-6)$$

From figure 9:

$$\bar{I}_{CA1} = \bar{I}_{AB1}/120^\circ, \quad (130-7)$$

Substitution equation (130-7) into equation (130-6) yields:

$$\begin{aligned} \bar{I}_{A1} &= \bar{I}_{AB1} - \bar{I}_{AB1}/120^\circ, \\ &= \bar{I}_{AB1}(1/0^\circ - 1/120^\circ) \\ &= \bar{I}_{AB1}(1 + 0.5 - j0.866) \\ &= \bar{I}_{AB1}(\sqrt{3}/-30^\circ), \end{aligned} \quad (130-8)$$

From equation (130-7), the negative sequence current is:

$$\bar{I}_{A2} = \bar{I}_{AB2} - \bar{I}_{CA2}, \quad (130-9)$$

MIL-HDBK-299(SH)
 NOTICE 1
 APPENDIX
 15 OCTOBER 1991

From figure 10:

$$\bar{I}_{CA2} = \bar{I}_{AB2}/240^\circ, \quad (130-10)$$

Substitution of equation (130-10) into equation (130-9) gives:

$$\begin{aligned} \bar{I}_{A2} &= \bar{I}_{AB2} - \bar{I}_{AB2}/240^\circ \\ &= \bar{I}_{AB2}(1/0^\circ - 1/240^\circ) \\ &= \bar{I}_{AB2}(1 + 0.5 + j0.866) \\ &= \bar{I}_{AB2}(\sqrt{3}/30^\circ), \end{aligned} \quad (130-11)$$

Components of \bar{I}_B

From equation (100-8), the positive sequence current is:

$$\bar{I}_{B1} = \bar{I}_{BC1} - \bar{I}_{AB1}, \quad (130-12)$$

From figure 9:

$$\bar{I}_{BC1} = \bar{I}_{AB1}/240^\circ, \quad (130-13)$$

Substitution of equation (13-13) into equation (130-12) yields:

$$\begin{aligned} \bar{I}_{B1} &= \bar{I}_{AB1}/240^\circ - \bar{I}_{AB1} \\ &= \bar{I}_{AB1}(1/240^\circ - 1/0^\circ) \\ &= \bar{I}_{AB1}(-1 - 0.5 - j.866) \\ &= \bar{I}_{AB1}(\sqrt{3}/-150^\circ), \end{aligned} \quad (130-14)$$

From equation (100-8), the negative sequence current is:

$$\bar{I}_{B2} = \bar{I}_{BC2} - \bar{I}_{AB2}, \quad (130-15)$$

From figure 10:

$$\bar{I}_{BC2} = \bar{I}_{AB2}/120^\circ, \quad (130-16)$$

MIL-HDBK-299(SH)
 NOTICE 1
 APPENDIX
 15 OCTOBER 1991

Substitution of equation (130-16) into equation (130-15) yields:

$$\begin{aligned}\bar{I}_{B2} &= \bar{I}_{AB2}/120^\circ - \bar{I}_{AB2} \\ &= \bar{I}_{AB2}(1/120^\circ - 1/0^\circ) \\ \bar{I}_{B2} &= \bar{I}_{AB2}(-1 - 0.5 + j.866) \\ &= \bar{I}_{AB2}(\sqrt{3}/150^\circ),\end{aligned}\tag{130-17}$$

Components of \bar{I}_C

From equation (100-9), the positive sequence current is:

$$\bar{I}_{C1} = \bar{I}_{CA1} - \bar{I}_{BC1},\tag{130-18}$$

From figure 9:

$$\bar{I}_{CA1} = \bar{I}_{AB1}/120^\circ,\tag{130-19}$$

$$\bar{I}_{BC1} = \bar{I}_{AB1}/240^\circ,\tag{130-20}$$

Substitution of equations (130-19) and (130-20) into equation (130-18) gives:

$$\begin{aligned}\bar{I}_{C1} &= \bar{I}_{AB1}/120^\circ - \bar{I}_{AB1}/240^\circ \\ &= \bar{I}_{AB1}(1/120^\circ - 1/240^\circ) \\ &= \bar{I}_{AB1}(0 + j1.732) \\ &= \bar{I}_{AB1}(\sqrt{3}/90^\circ),\end{aligned}\tag{130-21}$$

From equation (100-9), the negative sequence current is:

$$\bar{I}_{C2} = \bar{I}_{CA2} - \bar{I}_{BC2},\tag{130-22}$$

From figure 9:

$$\bar{I}_{CA2} = \bar{I}_{AB2}/240^\circ,\tag{130-23}$$

$$\bar{I}_{BC2} = \bar{I}_{AB2}/120^\circ,\tag{130-24}$$

MIL-HDBK-299(SH)
 NOTICE 1
 APPENDIX
 15 OCTOBER 1991

Substitution of equations (130-23) and (130-24) into equation (130-22) gives:

$$\begin{aligned}\bar{I}_{C2} &= \bar{I}_{AB2}/240^\circ - \bar{I}_{AB2}/120^\circ \\ &= \bar{I}_{AB2}(1/240^\circ - 1/120^\circ) \\ &= \bar{I}_{AB2}(0 - j1.732) \\ &= \bar{I}_{AB2}(\sqrt{3}/-90^\circ),\end{aligned}\tag{130-25}$$

Take phase AB as the reference, the line currents can be written in terms of the sequence currents as follows:

$$\begin{aligned}\bar{I}_A &= \bar{I}_{A0} + \bar{I}_{A1} + \bar{I}_{A2} \\ &= \bar{I}_{AB1}(\sqrt{3}/-30^\circ) + \bar{I}_{AB2}(\sqrt{3}/30^\circ),\end{aligned}\tag{130-26}$$

$$\begin{aligned}\bar{I}_B &= \bar{I}_{B0} + \bar{I}_{B1} + \bar{I}_{B2} \\ &= \bar{I}_{AB1}(\sqrt{3}/-150^\circ) + \bar{I}_{AB2}(\sqrt{3}/150^\circ),\end{aligned}\tag{130-27}$$

$$\begin{aligned}\bar{I}_C &= \bar{I}_{C0} + \bar{I}_{C1} + \bar{I}_{C2} \\ &= \bar{I}_{AB1}(\sqrt{3}/90^\circ) + \bar{I}_{AB2}(\sqrt{3}/-90^\circ),\end{aligned}\tag{130-28}$$

To complete the above equations, the positive and negative sequence currents of phase AB must be calculated. From figure 9, it can be shown that:

$$\bar{I}_{AB1} = (1/3)(\bar{I}_{AB} + a\bar{I}_{BC} + a^2\bar{I}_{CA}),\tag{130-29}$$

$$\bar{I}_{AB2} = (1/3)(\bar{I}_{AB} + a^2\bar{I}_{BC} + a\bar{I}_{CA}),\tag{130-30}$$

Where: $a = 1/120^\circ$, $a^2 = 1/240^\circ$

Finally, to determine \bar{I}_{AB} , \bar{I}_{BC} , and \bar{I}_{CA} , the information supplied by the systems must be used. This information must consist of at least one of the following sets:

Set 1:

- Power (P) in kW of each phase load with $\text{pf} = \cos(\Theta)$.

MIL-HDBK-299(SH)
 NOTICE 1
 APPENDIX
 15 OCTOBER 1991

- Terminal load voltage (V) of each phase.

Then,

$$\bar{I}_{AB} = [P_{AB}/V_{AB}\cos(\theta_{AB})] / 0^\circ - \theta_{AB}, \quad (130-31)$$

$$\bar{I}_{BC} = [P_{BC}/V_{BC}\cos(\theta_{BC})] / -120^\circ - \theta_{BC}, \quad (130-32)$$

$$\bar{I}_{CA} = [P_{CA}/V_{CA}\cos(\theta_{CA})] / 120^\circ - \theta_{CA}, \quad (130-33)$$

Set 2:

- Load impedance (z_L) of each phase.
- Load terminal voltage (V) of each phase.

Then,

$$\bar{I}_{AB} = \bar{V}_{AB} / \bar{z}_{AB}, \quad (130-34)$$

$$\bar{I}_{BC} = \bar{V}_{BC} / \bar{z}_{BC}, \quad (130-35)$$

$$\bar{I}_{CA} = \bar{V}_{CA} / \bar{z}_{CA}, \quad (130-36)$$

Once the line currents \bar{I} have been determined, the percent voltage drop for each line can be calculated from equation (100-10) as derived in section 100:

$$D\% = IL \left(\frac{z \cos(\alpha)}{E} \right) * 100, \quad (100-10)$$

Where:

L : Cable length.

z : Conductor impedance per phase per foot.

E : Line-to-neutral source voltage.

$$\alpha = -\theta + \beta, \quad (90-2)$$

In the above equation, θ is the angle by which the line current I lags the terminal load voltage, and it is calculated from equations (100-7), (100-8), or (100-9) as derived in section 100.

MIL-HDBK-299(SH)
NOTICE 1
APPENDIX
15 OCTOBER 1991

140. DERIVATION OF CABLE RESISTANCES AND REACTANCES

This section contains the derivation of cable resistances and reactances used in tables XI through XVII. These cables reflect conductor diameters of standard American Wire Gage (AWG) in accordance with MIL-C-24643.

140.1 Calculations of cable resistance. The ideal method of obtaining accurate cable resistance and reactance is by test measurements. In the absence of test data, these parameters can also be determined mathematically.

The method used in this handbook is based upon the one specified in the ASTM B 258 and ASTM B 8. This method may be used to calculate with reasonable accuracy the resistances of any cables of concentric-lay-stranded conductors. The overall approach is as follows:

- Calculate dc resistance at 20° Celsius for solid conductor using ASTM B 258.
- Adjust for concentric-lay-stranded conductors using ASTM B 8.
- Adjust for temperature for which cable service will be designed.
- Adjust for ac resistance by multiplying the dc resistance by the (ac/dc) resistance conversion ratio at any desired frequencies (60/400 Hz).

From the ASTM B 258, dc resistance at 20°C of conductor in ohm per 1000 feet is given by:

$$R_{dc} = 105.35 \left(\frac{\rho_0}{\delta d^2} \right) \quad (140-1)$$

Where:

$$\begin{aligned} \rho_0 &= \text{resistivity of conductor (copper) at } 20^\circ\text{C} \\ &= 875.20 \Omega \text{ lb/mile}^2 \end{aligned}$$

$$\begin{aligned} \delta &= \text{conductor (copper) density at } 20^\circ\text{C} \\ &= 8.89 \text{ g/cm}^3 \end{aligned}$$

d = conductor diameter in mil.

MIL-HDBK-299(SH)
 NOTICE 1
 APPENDIX
 15 OCTOBER 1991

Equation (140-1) becomes:

$$R_{dc} = 10371.46 \left(\frac{1}{d^2} \right) \Omega/1000ft, \quad (140-2)$$

From equation (140-2), R_{dc} resistances for type SG equivalent solid conductors are computed and shown in table XVIII below.

TABLE XVIII. Dc Conductor Resistances at 20°C.

<u>Designation</u>	<u>Conductor Diameter (mil)</u>	<u>R_{dc} ($\Omega/10^3$ ft)</u>
SG-3	50.79	4.021
SG-4	64.11	2.523
SG-9	101.88	0.999
SG-14	114.41	0.792
SG-23	144.29	0.498
SG-50	229.39	0.197
SG-75	289.29	0.124
SG-100	324.96	0.098
SG-150	409.63	0.062
SG-200	460.00	0.049
SG-300	547.72	0.035
SG-400	643.12	0.025

The data for these solid conductors must be adjusted for concentric-lay-stranded SG conductors. Due to the lay stranded conductors, the resistance per unit length of a stranded conductor will be slightly greater than that for an equivalent diameter solid conductor. ASTM B 8 provides a mathematical method for deriving the multiplying factor that is used to modify dc resistance of a solid conductor for an equivalent concentric-lay-stranded conductor. A lay factor (m_{ind}) is determined for each wire in a concentric-lay-stranded conductor from:

$$m_{ind} = \sqrt{1 + (9.8696/n^2)}, \quad (140-3)$$

Where:

n = length of lay/diameter of wire helical path.

MIL-HDBK-299(SH)
 NOTICE 1
 APPENDIX
 15 OCTOBER 1991

The lay factor (m) for the complete stranded conductor is the numerical average of the lay factors (m_{ind}) of the individual wires in the conductor. Finally, the increment factor K is calculated from:

$$K = (m-1) * 100, \quad (140-4)$$

K is the percentage increase in resistance of a solid conductor for an equivalent concentric-lay-stranded conductor. In lieu of performing many calculations based upon detailed conductor geometry, which would be required by the above method, an increment factor of 2 percent will be used in accordance with table 3 of ASTM B 8. Therefore, the concentric-lay-stranding of a solid conductor results in a nominal increase in electrical resistance of 2 percent. The previous tables for dc resistance of solid conductors can be used to generate a table for concentric-lay-stranded conductors by applying this increment factor.

TABLE XIX. Dc Stranded Conductor Resistances at 20°C

<u>Designation</u>	<u>Number of Strands</u>	$R_{dc} (\Omega/10^3 \text{ft})$
SG-3	7	4.101
SG-4	7	2.573
SG-9	7	1.019
SG-14	7	0.808
SG-23	7	0.508
SG-50	19	0.201
SG-75	37	0.126
SG-100	61	0.100
SG-150	61	0.063
SG-200	61	0.050
SG-300	91	0.036
SG-400	127	0.026

Next, R_{dc} must be adjusted to the designed temperature of cable service. Resistance (R_t) at a selected temperature (t) can be calculated from the following equation:

$$R_t = R_{t_0} [1 + 0.00393(t - 20)], \quad (140-5)$$

Where:

R_{t_0} = wire resistance at 20°C.

MIL-HDBK-299(SH)
NOTICE 1
APPENDIX
15 OCTOBER 1991

t = temperature at which resistance is required.

(0.00393) = temperature coefficient of resistance at 20°C.

At $t = 65^\circ\text{C}$:

$$\frac{R_t}{R_{t_0}} = [1 + 0.00393(65 - 20)]$$
$$R_{t_0} = 1.177$$

Therefore, resistances in the preceding table must be multiplied by the above ratio to yield the dc resistances at 65°C. The following results are obtained:

TABLE XX. Dc stranded conductor resistances at 65°C

<u>Designation</u>	R_{dc} ($\Omega/10^3 \text{ ft}$)
SG-3	4.827
SG-4	3.028
SG-9	1.199
SG-14	0.951
SG-23	0.598
SG-50	0.237
SG-75	0.148
SG-100	0.118
SG-150	0.074
SG-200	0.059
SG-300	0.042
SG-400	0.031

Similarly, the (R_t/R_{t_0}) ratio at 45°C is as follows:

$$\frac{R_t}{R_{t_0}} = [1 + 0.00393(45 - 20)]$$
$$R_{t_0} = 1.098$$

MIL-HDBK-299(SH)
 NOTICE 1
 APPENDIX
 15 OCTOBER 1991

The dc stranded-conductor resistances at 45°C for various cables are tabulated below:

TABLE XXI. Dc stranded conductor resistances at 45°C

<u>Designation</u>	R_{dc} ($\Omega/10^3$ ft)
SG-3	4.503
SG-4	2.825
SG-9	1.119
SG-14	0.887
SG-23	0.558
SG-50	0.221
SG-75	0.138
SG-100	0.110
SG-150	0.069
SG-200	0.055
SG-300	0.040
SG-400	0.029

The dc resistances must be converted to ac resistances. The converting factor known as the skin effect ratio (SER) is determined as follows:

Determine the factor F:

$$F = 0.0635598 \sqrt{(f\mu/R)}, \quad (140-6)$$

Where,

- f = System frequency.
- μ = Wire permeability.
- R = Dc resistance in Ω/mile .

Equation (140-6) can be rewritten as:

$$F = 0.027677 \sqrt{f/R}, \quad (140-7)$$

MIL-HDBK-299(SH)
 NOTICE 1
 APPENDIX
 15 OCTOBER 1991

Where the wire permeability μ is assumed equal to 1.0000 and the dc resistance R is in ohm per 1000 feet. Then, from the table below, the skin effect ratios are determined.

TABLE XXII. Skin effect ratio

F	SER	F	SER	F	SER
0.0	1.00000	1.3	1.01470	2.6	1.20056
0.1	1.00000	1.4	1.01969	2.7	1.22753
0.2	1.00000	1.5	1.02582	2.8	1.25620
0.3	1.00004	1.6	1.03323	2.9	1.28644
0.4	1.00013	1.7	1.04205	3.0	1.31809
0.5	1.00032	1.8	1.05240	3.1	1.35102
0.6	1.00067	1.9	1.06440	3.2	1.38504
0.7	1.00124	2.0	1.07816	3.3	1.41999
0.8	1.00212	2.1	1.09375	3.4	1.45570
0.9	1.00340	2.2	1.11126	3.5	1.49202
1.0	1.00519	2.3	1.13069	3.6	1.52879
1.1	1.00758	2.4	1.15207	3.7	1.56587
1.2	1.01071	2.5	1.17538	3.8	1.60314

With R_{dc} given in the previous tables, the ac resistance at 60 Hz and 400 Hz can be determined using the ac to dc resistance ratios in the following table:

TABLE XXIII. Dc to ac resistance conversion ratios

<u>Designation</u>	<u>Ac/dc Ratio at 60 Hz</u>	<u>Ac/dc Ratio at 400 Hz</u>
SG-3	1.000	1.000
SG-4	1.000	1.000
SG-9	1.000	1.000
SG-14	1.000	1.000
SG-23	1.000	1.000
SG-50	1.000	1.000
SG-75	1.000	1.033
SG-100	1.000	1.052
SG-150	1.000	1.111
SG-200	1.000	1.175
SG-300	1.007	1.286
SG-400	1.015	1.456

MIL-HDBK-299(SH)
 NOTICE 1
 APPENDIX
 15 OCTOBER 1991

Therefore, ac resistance of conductors at 60/400 Hz and at any temperatures can be calculated by multiplying the appropriate (ac/dc) resistance conversion factors by the R_{dc} of concentric-lay-stranded conductors in the previous tables.

TABLES XXIV. Ac resistance for SG conductors at 65°C

<u>Designation</u>	<u>R_{ac} at 60 Hz</u> ($\Omega/10^3$ ft)	<u>R_{ac} at 400 Hz</u> ($\Omega/10^3$ ft)
SG-3	4.827	4.827
SG-4	3.028	3.028
SG-9	1.199	1.199
SG-14	0.951	0.951
SG-23	0.598	0.598
SG-50	0.237	0.237
SG-75	0.148	0.153
SG-100	0.118	0.124
SG-150	0.074	0.082
SG-200	0.059	0.069
SG-300	0.042	0.054
SG-400	0.031	0.045

TABLES XXV. Ac resistance for SG conductors at 45°C

<u>Designation</u>	<u>R_{ac} at 60 Hz</u> ($\Omega/10^3$ ft)	<u>R_{ac} at 400 Hz</u> ($\Omega/10^3$ ft)
SG-3	4.503	4.503
SG-4	2.825	2.825
SG-9	1.199	1.199
SG-14	0.887	0.887
SG-23	0.558	0.558
SG-50	0.221	0.221
SG-75	0.138	0.143
SG-100	0.110	0.116
SG-150	0.069	0.077
SG-200	0.055	0.065
SG-300	0.040	0.051
SG-400	0.029	0.042

MIL-HDBK-299(SH)
NOTICE 1
APPENDIX
15 OCTOBER 1991

These resistance values are used in tables XI through XIV, and XVI through XVII. For type 6SG cables in table XV, two conductors are in parallel for each phase. Therefore, the resistance per phase is half of the ac resistance (400 Hz) calculated earlier at the required designed temperature of 65°C. The resulting resistances are shown in table XXVI.

TABLE XXVI. Ac resistance for 6SG conductors at 65°C

<u>Designation</u>	<u>R_{ac} at 400 Hz</u> ($\Omega/10^3 \text{ ft}$)
6SG-100	0.062
6SG-125	0.049
6SG-150	0.041
6SG-200	0.035

140.2 Calculations of cable reactances. The determination of cable reactances is relatively complicated since the reactances are not only dependent upon the geometry of conductors in the cable, but also on the external environment of the cable, e.g., conducting armor material and closeness to surrounding steel. Below are the step-by-step calculations for cable reactances per phase. These calculations give a reasonable estimate of the total cable reactances. The actual reactances will differ slightly when all magnetic effect are considered, and only for larger cables at high frequencies.

Step 1.

Determine the conductor geometric mean radius (GMR) as follows:

$$GMR = 0.779(d/2), \quad (140-8)$$

Where d is the conductor diameter.

Step 2.

Determine the conductor geometric mean distance (GMD) as follows:

$$GMD = \sqrt[3]{D_{AB} D_{BC} D_{CA}} \quad (140-9)$$

MIL-HDBK-299(SH)
NOTICE 1
APPENDIX
15 OCTOBER 1991

Where,

D_{AB} : Distance between centers of conductors A and B.

D_{BC} : Distance between centers of conductors B and C.

D_{CA} : Distance between centers of conductors C and A.

Step 3.

Determine the reactance per phase as follows:

$$X = 0.05292(f/60) \log_{10}(\text{GMD}/\text{GMR}) \Omega/1000\text{ft}, \quad (140-10)$$

Where f is the frequency at which the reactance is calculated.

From equation (140-10) with conductor characteristics listed in MIL-C-24643 the following tables for reactances can be generated.

TABLE XXVII. Reactances for SG conductors

<u>Designation</u>	<u>GMR</u>	<u>GMD</u>	<u>X at 60 Hz</u>	<u>X at 400 Hz</u>
			($\Omega/10^3\text{ft}$)	($\Omega/10^3\text{ft}$)
SG-3	0.0198	0.1300	0.0432	0.2883
SG-4	0.0250	0.1430	0.0401	0.2672
SG-9	0.0397	0.1870	0.0356	0.2374
SG-14	0.0446	0.2620	0.0407	0.2713
SG-23	0.0562	0.3100	0.0392	0.2616
SG-50	0.0893	0.3340	0.0303	0.2021
SG-75	0.1127	0.4070	0.0295	0.1967
SG-100	0.1266	0.4530	0.0293	0.1953
SG-150	0.1596	0.5570	0.0287	0.1915
SG-200	0.1792	0.6340	0.0290	0.1936
SG-300	0.2133	0.7480	0.0288	0.1922
SG-400	0.2463	0.8620	0.0288	0.1919

Again, the reactances for 6SG conductors are equal to half of the SG conductor reactances as shown in Table XXVIII.

MIL-HDBK-299(SH)

NOTICE 1

APPENDIX

15 OCTOBER 1991

TABLE XXVIII. Reactances for 6SG conductors at 65°C

<u>Designation</u>	<u>X at 400 Hz</u> $(\Omega/10^3 \text{ ft})$
6SG-100	0.0977
6SG-125	0.0974
6SG-150	0.0958
6SG-200	0.0968